



Package Air Conditioner  
RLNL-G Series

## Ruud Commercial Achiever® Series Package Air Conditioner featuring HumidiDry™ Technology



### RLNL-G Series

With ClearControl™  
and VFD Technology

Nominal Sizes 15-25 Tons [52.8-87.9 kW]

ASHRAE 90.1-2019 Compliant



25 TON MODEL IS OUTSIDE THE  
SCOPE OF AHRI STANDARD 340/360

RELY ON RUUD.™

FORM NO. S22-962 REV. 6


## TABLE OF CONTENTS

Unit Features & Benefits .....	3-9
Model Number Identification .....	10
Options .....	11
Selection Procedure .....	12
General Data	
RLNL-G Series .....	13-15
General Data Notes .....	16
Gross Systems Performance Data	
RLNL-G Series .....	17-19
Gross Systems Performance Data – Reheat	
RLNL-G Series .....	20-22
Indoor Airflow Performance	
RLNL-G Series .....	23-28
Electrical Data	
RLNL-G Series .....	29-30
Electric Heater Kits .....	31-32
Dimensional Data .....	33-36
Accessories .....	37-51
Mechanical Specifications .....	52-57
Limited Warranty .....	58




## RLNL-G STANDARD FEATURES INCLUDE:

- R-410A HFC refrigerant.
- Complete factory charged, wired and run tested.
- Scroll compressors with internal line break overload and high-pressure protection.
- Dual stage compressor on all models.
- Convertible airflow – vertical downflow or horizontal sideflow.
- TXV refrigerant metering system on each circuit.
- High Pressure and Low Pressure/Loss of charge protection standard on all models.
- Solid Core liquid line filter drier on each circuit.
- Single slab, single pass designed evaporator and condenser coils facilitate easy cleaning for maintaining high efficiencies.
- Cooling operation up to 125 degree F ambient.
- Foil faced insulation encapsulated throughout entire unit minimizes airborne fibers from the air stream.
- Hinged major access door with heavy-duty gasketing, 1/4 turn latches and door retainers.
- Slide Out Indoor fan assembly for added service convenience.
- Powder Paint Finish meets ASTM B117 steel coated on each side for maximum protection. G90 galvanized.
- Base pan with drawn supply and return opening for superior water management.
- Forkable base rails for easy handling and lifting.
- Single point electrical connections.
- Internally sloped slide out condensate pan conforms to ASHRAE 62 standards.
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system.
- Permanently lubricated evaporator, condenser and gas heat inducer motors.
- Condenser motors are internally protected, totally enclosed with shaft down design.
- 2 inch filter standard with slide out design.
- 24 volt control system with resettable circuit breakers.
- Colored and labeled wiring.
- Copper tube/Aluminum Fin coils.
- Supplemental electric heat provides 100% efficient heating.
- Factory Installed ClearControl™ (DDC) and sensors which can connect to LonWorks™ or BACnet® BAS systems for remote monitoring and control.
- Variable Frequency Drive (VFD).
- HumidiDry™ Dehumidification System.
- MERV 8 and MERV 13 filters are available as an accessory.
- Standard Modbus interface

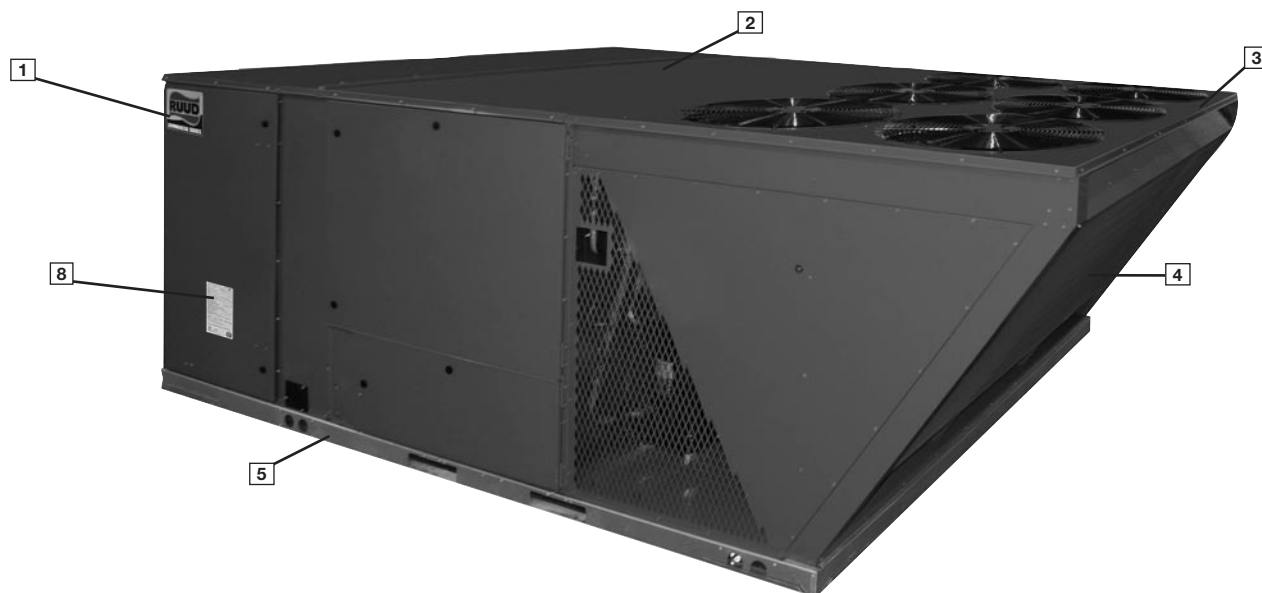

Ruud Package equipment is designed from the ground up with the latest features and benefits required to compete in today's market. The clean design stands alone in the industry and is a testament to the quality, reliability, ease of installation and serviceability that goes into each unit. Outwardly, the large Ruud *Commercial Series*™ label (1) identifies the brand to the customer. The sheet-metal cabinet (2) uses nothing less than 20-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a top with a 1/8" drip lip (3), gasket-protected panels and screws. (4) The outdoor coil is slanted to protect from hail. Every Ruud package unit uses the toughest finish in the industry, using electro deposition baked-on enamel tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.

Anything built to last must start with the right foundation. In this case, the foundation is 14-gauge, commercial-grade, full-perimeter base rails (5), which integrate fork slots and rigging holes to save set-up time on the job site. The base pan is stamped, which forms a 1-1/8" flange around the supply and return cover and has eliminated the worry of water entering the conditioned space (6). The drainpan (7) is made of plastic that resists the growth of harmful bacteria and is sloped for the latest IAQ benefits. Furthermore, the drain pan slides out for easy cleaning. The insulation has been placed on the underside of the basepan, removing areas that would allow for potential moisture accumulation, which can facilitate growth of harmful bacteria. All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden.

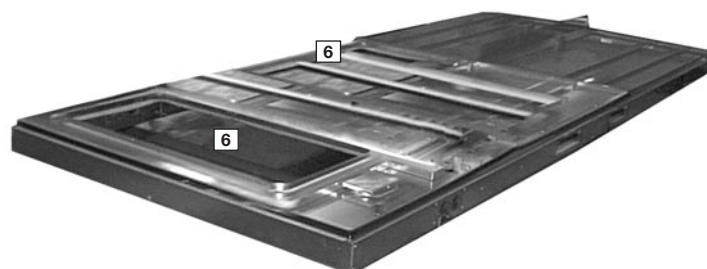


During development, each unit was tested to U.L. 1995, AHRI 340-360 and other Ruud-required reliability tests. Ruud adheres to stringent ISO 9001:2015 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate (8). Contractors can rest assured that when a Ruud package unit arrives at the job, it is ready to go with a factory charge and quality checks.


Access to all major compartments is from the front of the unit, including the filter and electrical compartment, blower compartment, heating section, and outdoor section. Each panel is permanently embossed with the compartment name (control/filter access, blower access and furnace access).

Electrical and filter compartment access is through a large, hinged-access panel with 1/4 turn latches. On the outside of the panel is the unit nameplate, which contains the model and serial number, electrical data and other important unit information.

The unit charging chart is located on the inside of the electrical and filter compartment door. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. To the right of the control box the model and serial number can be found. Having this information on the inside will assure model identification for the life of the product. The production line quality test assurance label is also placed in this location (9). The two-inch throwaway filters (10) are easily removed on a tracked system for easy replacement.

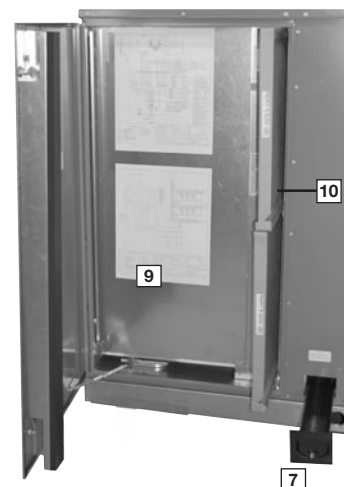



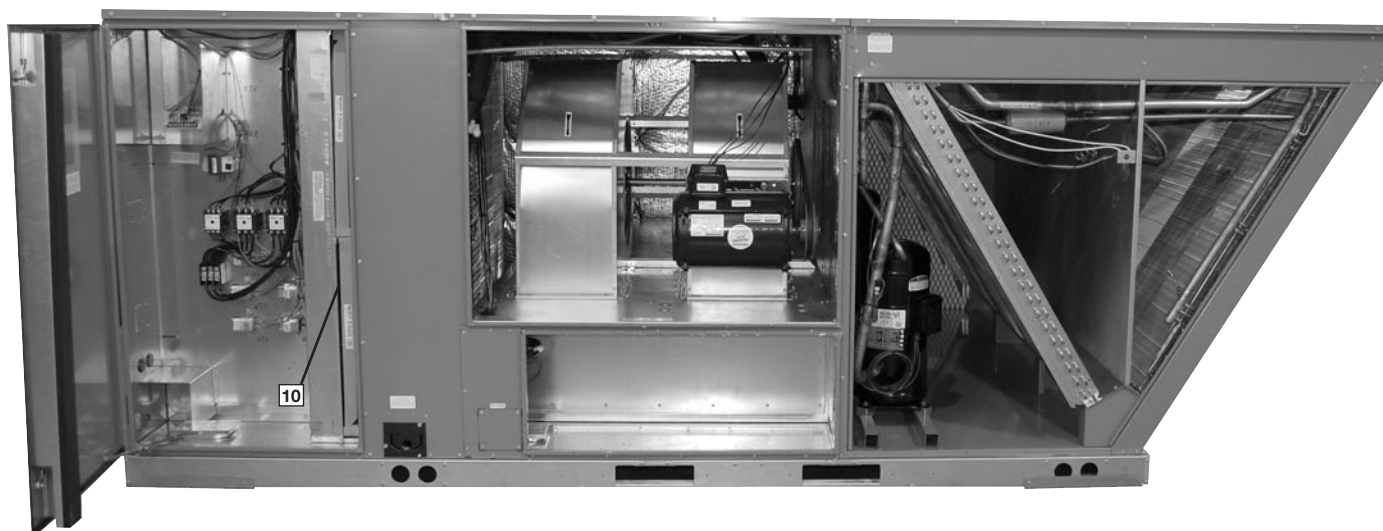

Inside the control box (10), each electrical component is clearly identified with a label that matches the component to the wire diagram for ease of trouble shooting. All wiring is numbered on each end of the termination and color-coded to match the wiring diagram. The control transformer has a low voltage circuit breaker that trips if a low voltage electrical short occurs. There is a blower contactor and contactor for each compressor.

As part of the ClearControl™ system which allows real time monitoring and communication between rooftop units, the RLNL-G Package Air Conditioner has a Rooftop Unit Controller (RTU-C) factory mounted and wired in the control panel. The RTU-C is a solid-state microprocessor-based control board that provides flexible control and extensive diagnostics for all unit functions. The RTU-C through proportional/integral control algorithms perform specific unit functions that govern unit operation in response to: zone conditions, system temperatures, system pressures, ambient conditions and electrical inputs. The RTU-C features a 16 x 2 character LCD display and a five-button keypad for local configuration and direct diagnosis of the system (12). New features include a clogged filter switch (CFS), fan proving switch (FPS), return air temperature sensor (RAT), discharge air temperature sensor (DAT) and outdoor air temperature sensor (OAT). Freeze sensors (FS) are used in place of freezestats to allow measurement of refrigerant suction line temperatures. The RLNL-G Package Air Conditioner with the ClearControl™ is specifically designed to be applied in four distinct applications:



The RLNL-G is compatible with a third party building management system that supports the BACnet Application Specific Controller device profile, with the use of a field installed BACnet Communication Module. The BACnet Communication Module plugs into the unit RTU-C controller and allows communication between ClearControl™ and the BACnet MSTP or IP network. A zone sensor, a BACnet network zone sensor, a BACnet thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The BACnet Communication Module is compatible with MSTP EIA-485 daisy chain networks communicating at 38.4 bps. It is compatible with twisted pair, shielded cables.

The RLNL-G is compatible with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. This is accomplished with a field installed LonMark communication module. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between ClearControl™ and a LonWorks Network. A zone sensor, a LonTalk network zone sensor, or a LonTalk thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The LonMark Communication Module utilizes an FTT-10A free topology transceiver communicating at 78.8 kbps. It is compatible with Echelon qualified twisted pair cable, Belden 8471 or NEMA Level 4 cables. The Module can communicate up to 1640 ft. with no repeater. The LonWorks limit of 64 nodes per segment applies to this device.

The RLNL-G is compatible with a programmable 24 volt thermostat. Connections are made via conventional thermostat screw terminals. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

The RLNL-G is compatible with a zone sensor and mechanical or solid state time clock connected to the RTU-C. Extensive unit status and diagnostics are displayed on the LCD screen of the ClearControl™.

A factory or field installed Comfort Alert® module is available for power phase-monitoring protection and additional compressor diagnostics. The alarms can be displayed on the ClearControl™ display, through the (BAS) network, or connected to the "L-Terminal" of a thermostat for notification.

## Unit Features & Benefits RLNL-G Series


Factory installed VFD (variable frequency drive) supply fan optimizes energy usage year round by providing a lower speed for first stage cooling operation improving IEER's over the conventional constant fan system. Furthermore, operating in the constant fan mode at the reduced speed can use as little as 1/5<sup>th</sup> of the energy of a conventional constant fan system. Also, by operating at a lower speed on first stage cooling up to 51% more moisture is removed improving comfort during low load operation. The VFD supply fan factory option meets California Title 24 and ASHRAE 90.1-2019 requirements for multi blower speed control. VFD also ramps up to the desired speed reducing stress on the supply fan components and reducing the noise from sudden inrush of air. Because the airflow is cut in half during first stage cooling and constant fan operation, noise is much less during these modes of operation.



For added convenience in the field, a factory-installed convenience outlet (13) is available. Low and High voltage can enter either from the side or through the base. Low-voltage connections are made through the low-voltage terminal strip. For ease of access, the U.L.-required low voltage barrier can be temporarily removed for low-voltage termination and then reinstalled. The high-voltage connection is terminated at the high voltage terminal block. The suggested mounting for the field-installed disconnect is on the exterior side of the electrical control box.



The blower compartment is to the right of the control box and can be accessed by 1/4 turn latches. To allow easy maintenance of the blower assembly, the entire assembly easily slides out by removing four #10 screws from the blower assembly. The adjustable motor pulley (14) can easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the pulley is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 1 to 6 turns open. Where the demands for the job require high static, Ruud has high-static drives available that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing (15) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing which firmly secures the pulley to the blower shaft for years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the

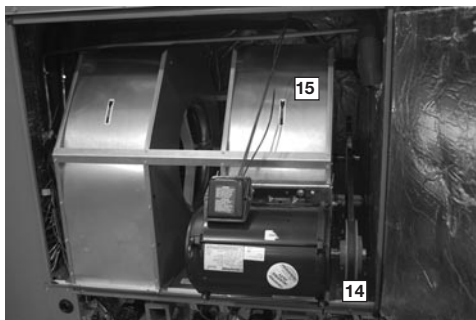


shaft, as opposed to the use of a set screw, which can score the shaft, creating burrs that make blower-pulley removal difficult.

Also inside the blower compartment are the optional low-ambient controls (16). The optional low-ambient controls allow for operation of the compressors down to 0 degrees ambient temperature by cycling the outdoor fans on high pressure. The freeze sensor protects the compressor if the evaporator coil gets too cold (below freezing) due to low airflow, and allows monitoring of the suction line temperature on the controller display. The sensor clips on the suction line near the evaporator outlet.




Inside the blower compartment the interlaced evaporator can also be viewed. The evaporator uses enhanced fin technology for maximum heat transfer. The TXV metering device assures even distribution of refrigerant throughout the evaporator.

Wiring throughout the unit is neatly bundled and routed. Where wire harnesses go through the condenser bulkhead or blower deck, a molded wire harness assembly (17) provides an air-tight and water-tight seal, and provides strain relief. Care is also taken to tuck raw edges of insulation behind sheet metal to improve indoor air quality.

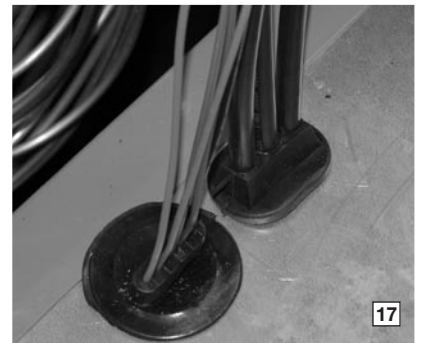


The heating compartment contains the latest electric furnace technology on the market. The 100% efficient electric furnace can be factory-installed or easily field-installed. Built with ease-of-installation in mind, the electric furnace is completely wired up for slide-in, plug-and-play installation in the field. With choices of up to four kilowatt offerings, the contractor is assured to get the correct amount of heating output to meet the designed heating load.

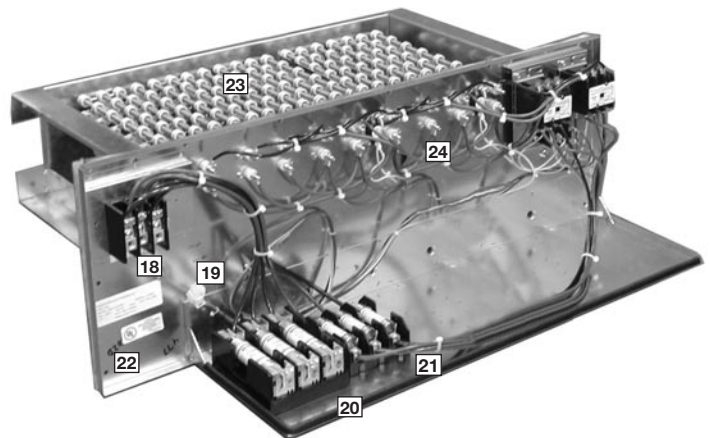

Power hook-up in the field is easy with single-point wiring to a terminal block (18) and a polarized plug for the low-voltage connection (19). The electric furnace comes with fuses for the unit (20) and for the electric furnace (21), and is UL certified (22). The electric heating elements are of a wound-wire construction (23) and isolated with ceramic bushings. The limit switch (24) protects the design from over-temperature conditions.




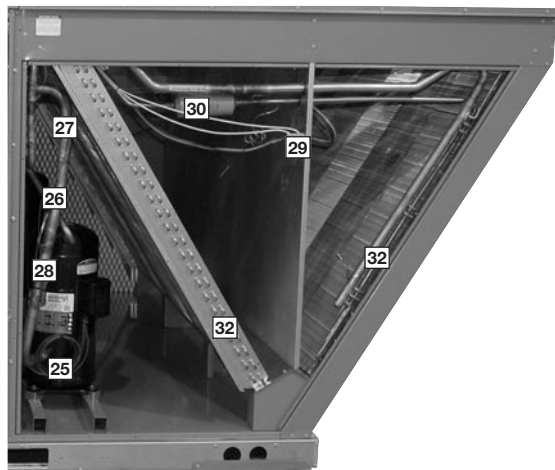


The compressor compartment houses the heartbeat of the unit. The scroll compressor ([25]) is known for its long life, and for reliable, quiet, and efficient operation. The suction and discharge lines are designed with shock loops ([26]) to absorb the strain and stress that the starting torque, steady state operation, and shut down cycle impose on the refrigerant tubing. Each compressor and circuit is independent for built-in redundancy, and each circuit is clearly marked throughout the system. Each unit has two stages of efficient cooling operation, first stage is approximately 50% of second stage.

In the outdoor section are the external gauge ports ([27]). With the gauge ports mounted externally, an accurate diagnosis of system operation can be performed quickly and easily. Also located in this area are the refrigerant safety devices: the low-pressure switches ([28]) and the high-pressure switches. ([29]) The high-pressure switches will shut off the compressors if pressures exceeding 610 psig are detected as may occur if the outdoor fan motor fails. The low pressure switches shut off the compressors if low pressure is detected due to loss of refrigerant charge. The factory-installed high and low pressure switches are brazed into the appropriate high or low side and wired appropriately.

Each unit comes standard with filter dryer ([30]). The condenser fan motor ([31]) can easily be accessed and maintained by removing the protective fan grille. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit.

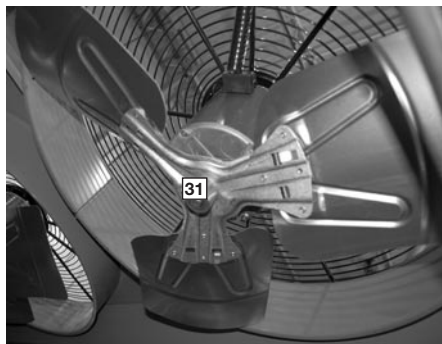

The outdoor coil uses the latest enhanced fin design ([32]) for the most effective method of heat transfer. The outdoor coil is slanted to protect the unit from Mother Nature.

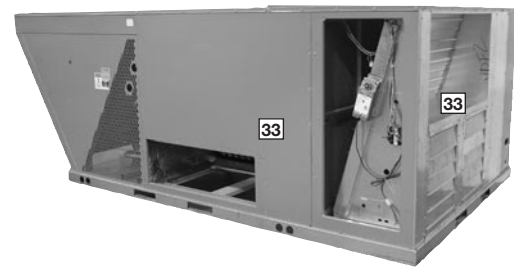

Each unit is designed for both downflow or horizontal applications ([33]) for job configuration flexibility. The return air compartment can also contain an economizer ([34]). Three models exist; two for downflow applications, and one for horizontal applications. (A downflow economizer with factory installed smoke detector in the return section is available). Each unit is pre-wired for the economizer to allow quick plug-in installation. The downflow economizer is also available as a factory-installed option.

The economizer, which provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements, comes standard with single enthalpy controls. The controls can be upgraded to dual enthalpy easily in the field.



The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field. The economizer control has a minimum position setpoint, an outdoor-air setpoint, a mix-air setpoint, and a CO<sub>2</sub> setpoint. Barometric relief is standard on all economizers. Power Exhaust is easily field-installed. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plug-in assembly. The wire harness to the economizer also has accommodations for a smoke detector.



The damper minimum position, actual damper position, power exhaust on/off setpoint, mixed air temperature limit setpoint and Demand Controlled Ventilation (DCV) setpoint can be read and adjusted at the unit controller display or remotely through a network connection.

The Space CO<sub>2</sub> level, mixed air temperature, and Economizer Status (Free Cooling Available, Single or Dual Enthalpy) can be read at the unit controller display or remotely through a network connection. Economizer Faults will trigger a network Alarm and can be read at the unit controller display or remotely through a network connection.

The Ruud roofcurb ([35]) is made for toolless assembly at the jobsite by inserting a pin into the hinged corners ([36]), which makes the assembly process quick and easy.

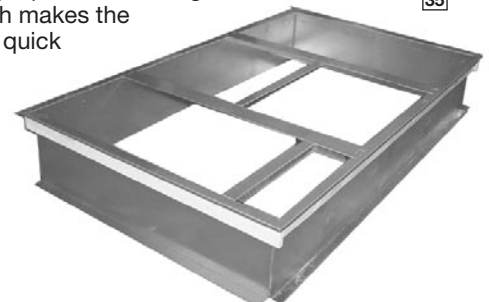

# HumidiDry™ System Features

HumidiDry™ is Ruud's exclusive dehumidification packaged unit solution. It delivers maximum humidity control without compromising desired temperature set point for a high degree of comfort. HumidiDry™ maintains humidity levels at a desired set point when there's little or no demand for air conditioning. The HumidiDry™ rooftop unit is controlled by a thermostat and humidistat. The thermostat takes priority on single-stage system. When the thermostat is activated by temperatures that exceed it set point, HumidiDry™ operates like a standard rooftop unit. It can operate on first stage cooling when demand is low or at full capacity when air conditioning load is high. Unlike other rooftop or reheat units, HumidiDry™ is uniquely designed so the VFD will operate at a low speed, increasing moisture removal during first-stage cooling operation. This provides initial defense for controlling humidity. When temperature is desirable but humidity exceeds the humidistat set point, the HumidiDry™ rooftop unit initiates a dehumidification cycle using a combination of hot gas and sub-cooled liquid reheat and the VFD operates at low speed. During this cycle, the HumidiDry™ rooftop unit delivers dry, neutral air. On a two-stage system, it is possible for both a thermostat and humidistat to register readings above set point. Under this condition, the first-stage system runs in the dehumidification cycle, the second-stage system runs in a cooling cycle and the VFD operates on high speed. This provides dry conditioned air.

Figure 1 shows the refrigerant path during the normal cooling mode. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The superheated refrigerant vapor next carries the heat to the outside coil where the heat is then rejected and the refrigerant condenses into a subcooled liquid where the process repeats itself.

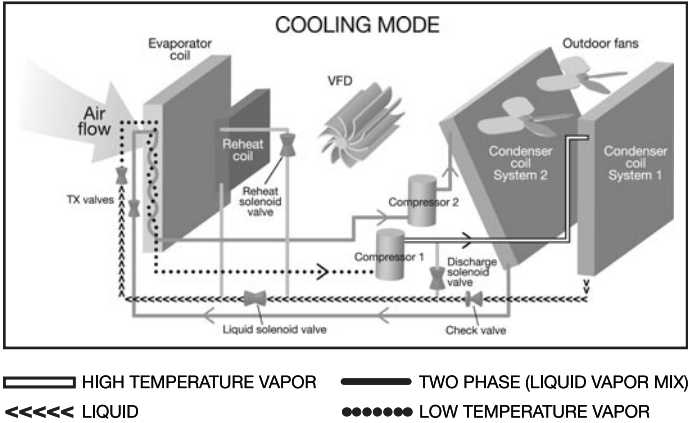


Figure 1

Figure 2 shows the refrigerant path during the reheat mode. When the reheat cycle is energized by the RTU-C, the reheat solenoid valve, upstream of the reheat coil opens. The liquid solenoid valve ahead of the TXV, closes. The discharge solenoid valve, in the compressor discharge line, opens. The liquid refrigerant leaves the TXV with the sudden pressure drop causing the liquid to expand to a vapor and absorbing the heat from the supply air going through the evaporator coil. The refrigerant vapor then travels to the compressor where it is elevated to a higher pressure and temperature. The refrigerant next carries the heat to a parallel path between the outside condenser coil and a bypass circuit. Some of the heat is rejected outdoor. The ratio of heat rejected outdoors versus indoors is controlled by an outdoor fan motor controller (OFMC) that monitors the two-phase temperature and varies the fan speed. This 2-phase refrigerant vapor is then sent to the reheat coil. As the refrigerant travels through the reheat coil it condenses into a subcooled liquid where the process repeats itself.




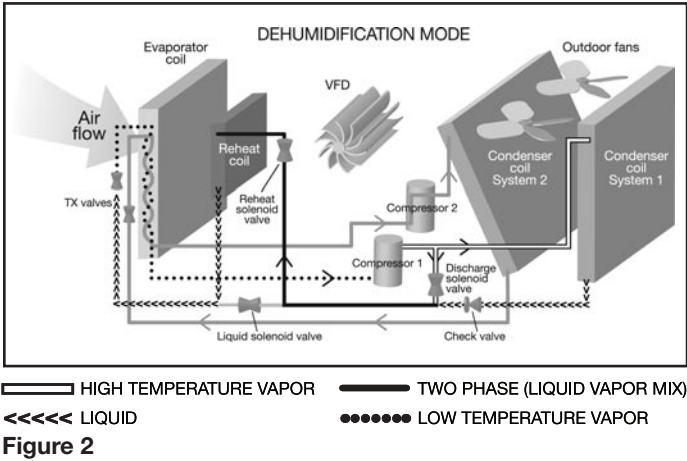


Figure 2

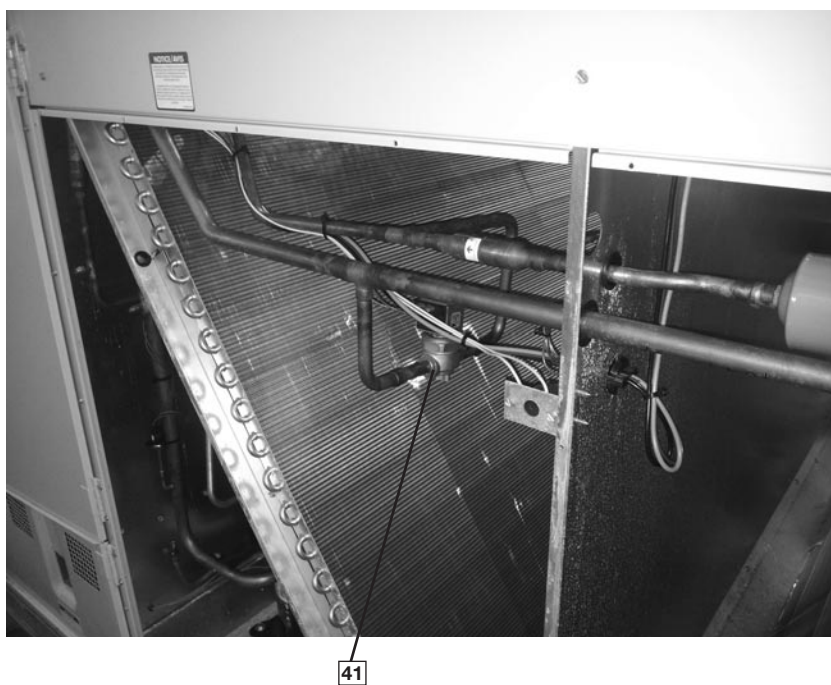

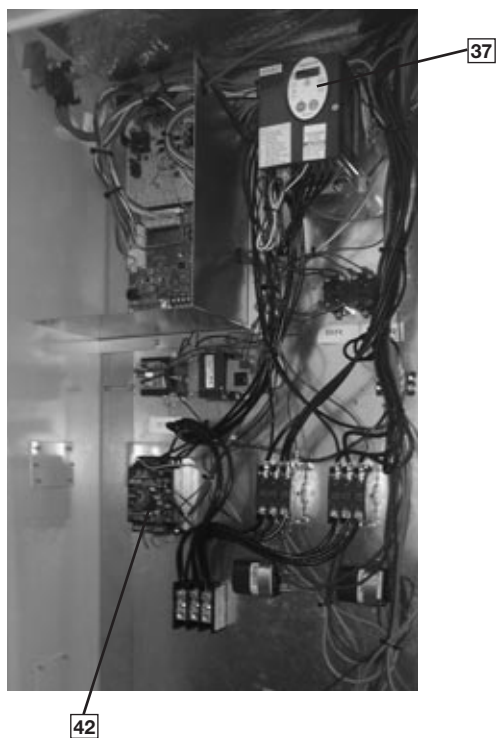

[ ] Designates Metric Conversions

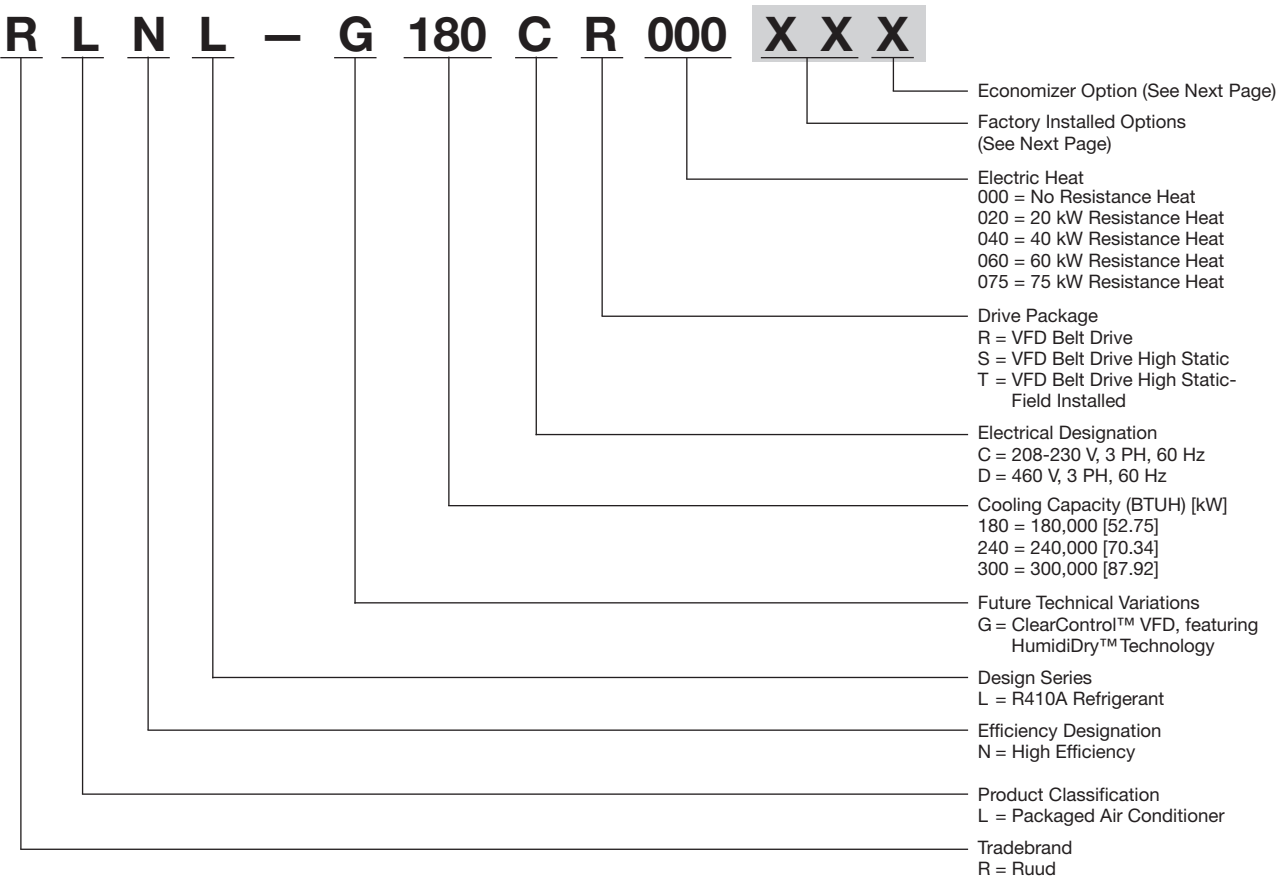

**FACTORY INSTALLED OPTION CODES FOR RLNL-G (15-25 TON) [52.8-87.9 kW]**

Option Code	Hail Guard	Non-Powered Convenience Outlet	Low Ambient/Comfort Alert
AA	NO OPTIONS		
AD	X		
AG		X	
AR			X
JD	X		X
BJ	X	X	
JE		X	X
CZ	X	X	X

Example: RLNL-G180CL000XXX (where **XX** is factory installed option)

Example: No Options

RLNL-G180CR000AAK

Example: No Options with factory installed economizer

RLNL-G180CR000AAM

Example: Options with low ambient/comfort alert and no factory installed economizer

RLNL-G180CR000ARK

Example: Options same as above with factory installed economizer

RLNL-G180CR000ARM

**ECONOMIZER SELECTION FOR RLNL-G (15-25 TON) [52.8-87.9 kW]**

Option Code	Reheat Only	DDC Single Enthalpy Economizer * With Barometric Relief and Reheat	DDC Single Enthalpy Economizer* With Barometric Relief and Smoke Detector and Reheat
K	X		
M		X	
N			X

"x" indicates factory installed option.

\*Downflow economizer only.

**Instructions for Factory Installed Option(s) Selection**

**Note:** Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, nothing follows the model number.

**Step 1.** After a basic rooftop model is selected, choose a *two-character* option code from the FACTORY INSTALLED OPTION SELECTION TABLE.

Proceed to Step 2.

**Step 2.** The last option code character is utilized for factory-installed economizers. Choose a character from the FACTORY INSTALLED ECONOMIZER SELECTION TABLE.

[ ] Designates Metric Conversions

To select an RLNL-G Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

**1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.**

**Example:**

Voltage—	240 V – 3 Phase – 60 Hz
Total Cooling Capacity—	205,000 BTUH [60.0 kW]
Sensible Cooling Capacity—	155,000 BTUH [45.4 kW]
Heating Capacity—	235,000 BTUH [68.8 kW]
*Condenser Entering Air—	95°F [35°C] DB
*Evaporator Mixed Air Entering—	65°F [ 18.3] WB; 78°F [ 25.6] DB
*Indoor Air Flow (vertical)—	7200 CFM [3398 L/s]
*External Static Pressure—	0.70 in. WG [ .17 kPa]

**2. SELECT UNIT TO MEET COOLING REQUIREMENTS.**

Since total cooling is within the range of a nominal 20 ton [70.3 kW] unit, enter cooling performance table at 95°F [35.0 °C] DB condenser inlet air. Interpolate between 63°F [17.2 °C] WB and 67°F [19.4 °C] WB to determine total and sensible capacity and power input for 65°F [18.3 °C] WB evaporator inlet air at 7725 CFM [3645 L/s] indoor air flow (table basis):

Total Cooling Capacity = 238,300 BTUH [69.76 kW]  
Sensible Cooling Capacity = 192,500 BTUH [56.38 kW]  
Power Input (Compressor and Cond. Fans) = 18,200 watts

Use formula in note ① to determine sensible capacity at 78°F [25.6] DB evaporator entering air:

$$192,550 + (1.10 \times 7,200 \times (1 - 0.11) \times (78 - 80))$$

Sensible Cooling Capacity = 178,452 BTUH [52.25 kW]

**3. CORRECT CAPACITIES OF STEP 2 FOR ACTUAL AIR FLOW.**

Select factors from airflow correction table at 7200 CFM [3398 L/s] and apply to data obtained in step 2 to obtain gross capacity:

Total Capacity =  $238,300 \times .99 = 235,868$  BTUH [69.06 kW]  
Sensible Capacity =  $178,452 \times 0.96 = 171,314$  BTUH [50.16 kW]  
Power Input =  $18,200 \times 0.99 = 18,018$  Watts

These are Gross Capacities, not corrected for blower motor heat or power.

**4. DETERMINE BLOWER SPEED AND WATTS TO MEET SYSTEM DESIGN.**

Enter Indoor Blower performance table at 7200 CFM [3398 L/s]. Total ESP (external static pressure) per the spec of 0.70 in. WG [ .17 kPa] includes the system duct and grilles. Add from the table 'Component Air Resistance', 0.01 in. WG [ .00 kPa] for wet coil, 0.08 in. WG [ .02 kPa] for downflow air flow, for a total selection static pressure of 0.79 (0.8) in. WG [ .20 kPa], and determine:

RPM = 739

WATTS = 2,862

DRIVE = L (standard 5 H.P. motor)

**5. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR WATTS, STEP 4.**

$$2,862 \times 3.412 = 9,765 \text{ BTUH [2.86 kW]}$$

**6. CALCULATE NET COOLING CAPACITIES, EQUAL TO GROSS CAPACITY, STEP 3, MINUS INDOOR BLOWER MOTOR HEAT.**

$$\text{Net Total Capacity} = 235,868 - 9,765 = 226,103 \text{ BTUH [66.21 kW]}$$

$$\text{Net Sensible Capacity} = 171,314 - 9,765 = 161,549 \text{ BTUH [47.30 kW]}$$

**7. CALCULATE UNIT INPUT AND JOB EER.**

$$\text{Total Power Input} = 18,018 \text{ (step 3)} + 2,862 \text{ (step 4)} = 20,880 \text{ Watts}$$

$$\text{EER} = \frac{\text{Net Total BTUH [kW] (step 6)}}{\text{Power Input, Watts (above)}} = \frac{226,103}{20,880} = 10.83$$

**8. SELECT UNIT HEATING CAPACITY.**

From Heater Kit Table select kW to meet heating capacity requirement; multiply kW x 3412 to convert to BTUH

Use 75 kW Heater Kit

Heater Kit Model: RXJJ-CE75C

Heater Kit Capacity: 245,323 BTUH [71.8 kW]

Add indoor blower heat effect (step 5) to Heater Kit Capacity to get total heating capacity:

$$245,323 + 9,765 = 255,088 \text{ BTUH [74.7 kW]}$$

**9. CHOOSE MODEL RLNL-G240CR075**

\*NOTE: These operating conditions are typical of a commercial application in a 95°F/79°F [35°C/26°C] design area with indoor design of 76°F [24°C] DB and 50% RH and 10% ventilation air, with the unit roof mounted and centered on the zone it conditions by ducts.

[ ] Designates Metric Conversions

**NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS**

Model RLNL- Series	G180CR	G180CS	G180DR	G180DS
<b>Cooling Performance<sup>A</sup></b>				<b>CONTINUED →</b>
Gross Cooling Capacity Btu [kW]	188,000 [53.47]	188,000 [53.47]	188,000 [53.47]	188,000 [53.47]
EER	11	11	11	11
IEER <sup>B</sup>	14.2	14.2	14.2	14.2
Nominal CFM/AHRI Rated CFM [L/s]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]	6000/5900 [2831/2784]
AHRI Net Cooling Capacity Btu [kW]	172,000 [48.92]	172,000 [48.92]	172,000 [48.92]	172,000 [48.92]
Net Sensible Capacity Btu [kW]	125700 [35.75]	125700 [35.75]	125700 [35.75]	125700 [35.75]
Net Latent Capacity Btu [kW]	46300 [13.17]	46300 [13.17]	46300 [13.17]	46300 [13.17]
Net System Power [kW]	15.64	15.64	15.64	15.64
<b>Compressor</b>				2/Scroll
No./Type	2/Scroll	2/Scroll	2/Scroll	91
<b>Outdoor Sound Rating (dB)<sup>C</sup></b>	91	91	91	Louvered
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Rifled
Tube Type	Rifled	Rifled	Rifled	0.375 [9.5]
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	53.3 [4.95]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	1 / 22 [9]
Rows / FPI [FPcm]	1 / 22 [9]	1 / 22 [9]	1 / 22 [9]	Louvered
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Rifled
Tube Type	Rifled	Rifled	Rifled	0.375 [9.5]
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	26.67 [2.48]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	2 / 18 [7]
Rows / FPI [FPcm]	2 / 18 [7]	2 / 18 [7]	2 / 18 [7]	TX Valves
Refrigerant Control	TX Valves	TX Valves	TX Valves	1/1 [25.4]
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	Louvered
<b>Re-Heat Coil—Fin Type</b>	Louvered	Louvered	Louvered	MicroChannel
Tube Type	MicroChannel	MicroChannel	MicroChannel	0.709 [18]
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	19.9 [1.85]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	1 / 23 [9]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	Propeller
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	4/24 [609.6]
No. Used/Diameter in. [mm]	4/24 [609.6]	4/24 [609.6]	4/24 [609.6]	Direct/1
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	16000 [7550]
CFM [L/s]	16000 [7550]	16000 [7550]	16000 [7550]	4 at 1/3 HP
No. Motors/HP	4 at 1/3 HP	4 at 1/3 HP	4 at 1/3 HP	1075
Motor RPM	1075	1075	1075	FC Centrifugal
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	2/18x9 [457x229]
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	Belt (Adjustable)
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Multiple
No. Speeds	Multiple	Multiple	Multiple	1
No. Motors	1	1	1	3
Motor HP	5	3	5	1725
Motor RPM	1725	1725	1725	56
Motor Frame Size	184	56	184	Disposable
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Yes
Furnished	Yes	Yes	Yes	(8)2x25x20 [51x635x508]
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	299/211 [8477/5982]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>	299/211 [8477/5982]	299/211 [8477/5982]	299/211 [8477/5982]	
<b>Weights</b>				1906 [865]
Net Weight lbs. [kg]	1935 [878]	1906 [865]	1935 [878]	2032 [922]
Ship Weight lbs. [kg]	2061 [935]	2032 [922]	2061 [935]	

See Page 16 for Notes.

[ ] Designates Metric Conversions

## NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS

Model RLNL- Series	G240CR	G240CS	G240DR	G240DS
<b>Cooling Performance<sup>A</sup></b>				<b>CONTINUED →</b>
Gross Cooling Capacity Btu [kW]	244,000 [69.40]	244,000 [69.40]	244,000 [69.40]	244,000 [69.40]
EER	11	11	11	11
IEER <sup>B</sup>	14.2	14.2	14.2	14.2
Nominal CFM/AHRI Rated CFM [L/s]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]	8000/7725 [3775/3645]
AHRI Net Cooling Capacity Btu [kW]	228,000 [64.85]	228,000 [64.85]	228,000 [64.85]	228,000 [64.85]
Net Sensible Capacity Btu [kW]	165,600 [47.10]	165,600 [47.10]	165,600 [47.10]	165,600 [47.10]
Net Latent Capacity Btu [kW]	62,400 [17.75]	62,400 [17.75]	62,400 [17.75]	62,400 [17.75]
Net System Power [kW]	20.73	20.73	20.73	20.73
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>C</sup></b>	91	91	91	91
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]	3 / 13 [5]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Re-Heat Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	5	7 1/2	5	7 1/2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	184	213	184	184
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]	430/331 [12190/9384]
<b>Weights</b>				
Net Weight lbs. [kg]	2231 [1012]	2269 [1029]	2231 [1012]	2269 [1029]
Ship Weight lbs. [kg]	2357 [1069]	2395 [1086]	2357 [1069]	2395 [1086]

See Page 16 for Notes.

[ ] Designates Metric Conversions

**NOM. SIZES 15-25 TONS [52.8-87.9 kW] MODELS**

Model RLNL- Series	G300CR	G300CS	G300DR	G300DS
<b>Cooling Performance<sup>A</sup></b>				<b>CONTINUED →</b>
Gross Cooling Capacity Btu [kW]	312,000 [88.74]	312,000 [88.74]	312,000 [88.74]	312,000 [88.74]
EER	10	10	10	10
IEER <sup>B</sup>	13	13	13	13
Nominal CFM/AHRI Rated CFM [L/s]	10000/9700 [4719/4577]	10000/9700 [4719/4577]	10000/9700 [4719/4577]	10000/9700 [4719/4577]
AHRI Net Cooling Capacity Btu [kW]	290,000 [84.49]	290,000 [84.49]	290,000 [84.49]	290,000 [84.49]
Net Sensible Capacity Btu [kW]	208900 [61.22]	208900 [61.22]	208900 [61.22]	208900 [61.22]
Net Latent Capacity Btu [kW]	81,100 [23.76]	81,100 [23.76]	81,100 [23.76]	81,100 [23.76]
Net System Power [kW]	29	29	29	29
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>C</sup></b>	91	91	91	91
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]	53.3 [4.95]
Rows / FPI [FPcm]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]	2 / 22 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows / FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Re-Heat Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	0.709 [18]	0.709 [18]	0.709 [18]	0.709 [18]
Face Area sq. ft. [sq. m]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]	19.9 [1.85]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP	6 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	7 1/2	10	7 1/2	10
Motor RPM	1725	1725	1725	1725
Motor Frame Size	213	215	213	215
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]	464/357 [13154/10121]
<b>Weights</b>				
Net Weight lbs. [kg]	2330 [1057]	2341 [1062]	2330 [1057]	2341 [1062]
Ship Weight lbs. [kg]	2456 [1114]	2467 [1119]	2456 [1114]	2467 [1119]

See Page 16 for Notes.

[ ] Designates Metric Conversions

## NOTES:

- A. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to  $\pm 20\%$  of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 210/240 or 360.
- B. EER and Integrated Energy Efficiency Ratio (IEER) are rated at AHRI conditions in accordance with AHRI Standard 340/360.
- C. Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

[ ] Designates Metric Conversions



## GROSS SYSTEMS PERFORMANCE DATA—G180

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
DR ①			.12	.08	.04	.12	.08	.04	.12	.08	.04
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	229.8 [67.3]	220.9 [64.7]	213.5 [62.5]	214.3 [62.8]	206 [60.4]	199 [58.3]	205.3 [60.1]	197.4 [57.8]	190.7 [55.9]
		Sens BTUH [kW]	134.3 [39.4]	121.8 [35.7]	111.2 [32.6]	165.1 [48.4]	149.7 [43.9]	136.7 [40.1]	189.9 [55.6]	172.2 [50.5]	157.2 [46.1]
		Power	12.6	12.3	12.1	12.4	12.2	12.0	12.2	12.0	11.8
	80 [26.7]	Total BTUH [kW]	225.5 [66.1]	216.8 [63.5]	209.4 [61.4]	209.9 [61.5]	201.9 [59.2]	195 [57.1]	200.9 [58.9]	193.2 [56.6]	186.7 [54.7]
		Sens BTUH [kW]	132.1 [38.7]	119.8 [35.1]	109.4 [32.1]	163 [47.8]	147.8 [43.3]	134.9 [39.5]	187.7 [55]	170.2 [49.9]	155.4 [45.5]
		Power	13.2	12.9	12.7	13.0	12.7	12.5	12.8	12.6	12.4
	85 [29.4]	Total BTUH [kW]	220.8 [64.7]	212.3 [62.2]	205.1 [60.1]	205.3 [60.2]	197.4 [57.8]	190.7 [55.9]	196.3 [57.5]	188.7 [55.3]	182.3 [53.4]
		Sens BTUH [kW]	129.8 [38.1]	117.7 [34.5]	107.5 [31.5]	160.7 [47.1]	145.7 [42.7]	133 [39]	185.4 [54.3]	168.1 [49.3]	153.5 [45]
		Power	13.8	13.5	13.3	13.6	13.4	13.1	13.4	13.2	13.0
	90 [32.2]	Total BTUH [kW]	215.8 [63.2]	207.5 [60.8]	200.4 [58.7]	200.3 [58.7]	192.5 [56.4]	186 [54.5]	191.3 [56]	183.9 [53.9]	177.7 [52.1]
		Sens BTUH [kW]	127.4 [37.3]	115.5 [33.9]	105.5 [30.9]	158.2 [46.4]	143.5 [42]	131 [38.4]	183 [53.6]	165.9 [48.6]	151.5 [44.4]
		Power	14.5	14.2	14.0	14.3	14.0	13.8	14.1	13.9	13.6
	95 [35]	Total BTUH [kW]	210.4 [61.7]	202.3 [59.3]	195.5 [57.3]	194.9 [57.1]	187.4 [54.9]	181 [53.1]	185.9 [54.5]	178.7 [52.4]	172.7 [50.6]
		Sens BTUH [kW]	124.8 [36.6]	113.2 [33.2]	103.3 [30.3]	155.6 [45.6]	141.1 [41.3]	128.8 [37.7]	180.4 [52.9]	163.6 [47.9]	149.3 [43.8]
		Power	15.2	14.9	14.7	15.1	14.8	14.5	14.9	14.6	14.4
	100 [37.8]	Total BTUH [kW]	204.7 [60]	196.9 [57.7]	190.2 [55.7]	189.2 [55.4]	181.9 [53.3]	175.8 [51.5]	180.2 [52.8]	173.3 [50.8]	167.4 [49.1]
		Sens BTUH [kW]	122 [35.8]	110.7 [32.4]	101 [29.6]	152.9 [44.8]	138.6 [40.6]	126.5 [37.1]	177.6 [52]	161.1 [47.2]	147 [43.1]
		Power	16.0	15.7	15.5	15.8	15.5	15.3	15.7	15.4	15.1
	105 [40.6]	Total BTUH [kW]	198.7 [58.2]	191 [56]	184.6 [54.1]	183.2 [53.7]	176.1 [51.6]	170.1 [49.9]	174.2 [51]	167.5 [49.1]	161.8 [47.4]
		Sens BTUH [kW]	119.1 [34.9]	108 [31.7]	98.6 [28.9]	149.9 [43.9]	136 [39.8]	124.1 [36.4]	174.2 [51]	158.4 [46.4]	144.6 [42.4]
		Power	16.9	16.5	16.3	16.7	16.4	16.1	16.5	16.2	15.9
	110 [43.3]	Total BTUH [kW]	192.3 [56.4]	184.9 [54.2]	178.6 [52.3]	176.8 [51.8]	170 [49.8]	164.2 [48.1]	167.8 [49.2]	161.3 [47.3]	155.8 [45.7]
		Sens BTUH [kW]	116.1 [34]	105.2 [30.8]	96.1 [28.2]	146.9 [43]	133.2 [39]	121.6 [35.6]	167.8 [49.2]	155.6 [45.6]	142.1 [41.6]
		Power	17.8	17.4	17.1	17.6	17.3	17.0	17.4	17.1	16.8
	115 [46.1]	Total BTUH [kW]	185.6 [54.4]	178.4 [52.3]	172.4 [50.5]	170 [49.8]	163.5 [47.9]	158 [46.3]	161 [47.2]	154.8 [45.4]	149.6 [43.8]
		Sens BTUH [kW]	112.9 [33.1]	102.3 [30]	93.4 [27.4]	143.7 [42.1]	130.3 [38.2]	118.9 [34.9]	161 [47.2]	152.7 [44.8]	139.4 [40.9]
		Power	18.7	18.4	18.1	18.5	18.2	17.9	18.4	18.0	17.7
	120 [48.9]	Total BTUH [kW]	178.5 [52.3]	171.6 [50.3]	165.8 [48.6]	163 [47.8]	156.7 [45.9]	151.4 [44.4]	154 [45.1]	148 [43.4]	143 [41.9]
		Sens BTUH [kW]	109.5 [32.1]	99.3 [29.1]	90.6 [26.6]	140.3 [41.1]	127.2 [37.3]	116.2 [34]	154 [45.1]	148 [43.4]	136.7 [40]
		Power	19.7	19.3	19.0	19.5	19.2	18.9	19.4	19.0	18.7
	125 [51.7]	Total BTUH [kW]	171.1 [50.1]	164.5 [48.2]	158.9 [46.6]	155.5 [45.6]	149.6 [43.8]	144.5 [42.3]	146.5 [42.9]	140.9 [41.3]	136.1 [39.9]
		Sens BTUH [kW]	106 [31.1]	96.1 [28.2]	87.7 [25.7]	136.8 [40.1]	124 [36.3]	113.2 [33.2]	146.5 [42.9]	140.9 [41.3]	133.7 [39.2]
		Power	20.8	20.4	20.0	20.6	20.2	19.9	20.4	20.0	19.7

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ .

[ ] Designates Metric Conversions

## GROSS SYSTEMS PERFORMANCE DATA—G240

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
DR ①			.12	.08	.04	.12	.08	.04	.12	.08	.04
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	286.7 [84] 167.1 [49] 15.5	274.6 [80.5] 150.1 [44] 15.1	266 [78] 138.1 [40.5] 14.9	269.6 [79] 208 [61] 15.3	258.2 [75.7] 186.8 [54.8] 15	250.1 [73.3] 171.9 [50.4] 14.7	257.6 [75.5] 240.7 [70.5] 15.1	246.7 [72.3] 216.2 [63.4] 14.8	239 [70] 198.9 [58.3] 14.5
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	284.1 [83.3] 166.1 [48.7] 16.2	272.1 [79.7] 149.2 [43.7] 15.9	263.6 [77.3] 137.3 [40.2] 15.6	267 [78.2] 207 [60.7] 16	255.7 [74.9] 186 [54.5] 15.7	247.7 [72.6] 171.1 [50.1] 15.5	255 [74.7] 239.7 [70.2] 15.9	244.2 [71.6] 215.3 [63.1] 15.5	236.6 [69.3] 198.1 [58.1] 15.3
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	280.7 [82.3] 164.7 [48.3] 17.1	268.8 [78.8] 147.9 [43.4] 16.7	260.5 [76.3] 136.1 [39.9] 16.4	263.6 [77.2] 205.6 [60.3] 16.9	252.4 [74] 184.7 [54.1] 16.5	244.6 [71.7] 169.9 [49.8] 16.3	251.6 [73.7] 238.3 [69.8] 16.7	241 [70.6] 214.1 [62.7] 16.3	233.4 [68.4] 196.9 [57.7] 16.1
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	276.4 [81] 162.9 [47.7] 17.9	264.8 [77.6] 146.3 [42.9] 17.5	256.5 [75.2] 134.6 [39.4] 17.3	259.3 [76] 203.8 [59.7] 17.7	248.3 [72.8] 183.1 [53.7] 17.4	240.6 [70.5] 168.4 [49.4] 17.1	247.3 [72.5] 236.5 [69.3] 17.5	236.9 [69.4] 212.4 [62.3] 17.2	229.5 [67.3] 195.4 [57.3] 16.9
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	271.4 [79.5] 160.7 [47.1] 18.8	259.9 [76.2] 144.3 [42.3] 18.5	251.8 [73.8] 132.8 [38.9] 18.2	254.2 [74.5] 201.6 [59.1] 18.7	243.5 [71.3] 181.1 [53.1] 18.3	235.9 [69.1] 166.6 [48.8] 18	242.2 [71] 234.3 [68.7] 18.5	232 [68] 210.4 [61.7] 18.1	224.8 [65.9] 193.6 [56.7] 17.8
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	265.4 [77.8] 158 [46.3] 19.8	254.2 [74.5] 141.9 [41.6] 19.4	246.3 [72.2] 130.6 [38.3] 19.1	248.3 [72.8] 198.9 [58.3] 19.6	237.8 [69.7] 178.7 [52.4] 19.2	230.4 [67.5] 164.4 [48.2] 18.9	236.3 [69.3] 231.6 [67.9] 19.4	226.3 [66.3] 208.1 [61] 19.0	219.3 [64.3] 191.4 [56.1] 18.7
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	258.7 [75.8] 154.9 [45.4] 20.8	247.8 [72.6] 139.2 [40.8] 20.4	240 [70.3] 128 [37.5] 20.1	241.6 [70.8] 195.8 [57.4] 20.7	231.3 [67.8] 175.9 [51.6] 20.2	224.1 [65.7] 161.8 [47.4] 19.9	229.6 [67.3] 228.5 [67] 20.5	219.9 [64.4] 205.3 [60.2] 20.0	213 [62.4] 188.9 [55.3] 19.7
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	251.1 [73.6] 151.4 [44.4] 21.9	240.5 [70.5] 136 [39.9] 21.5	233 [68.3] 125.1 [36.7] 21.1	234 [68.6] 192.3 [56.4] 21.7	224.1 [65.7] 172.8 [50.6] 21.3	217.1 [63.6] 158.9 [46.6] 21.0	222 [65.1] 222 [65.1] 21.5	212.6 [62.3] 202.1 [59.2] 21.1	206 [60.4] 186 [54.5] 20.8
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	242.7 [71.1] 147.5 [43.2] 23.1	232.5 [68.1] 132.5 [38.8] 22.6	225.2 [66] 121.9 [35.7] 22.2	225.6 [66.1] 188.4 [55.2] 22.9	216 [63.3] 169.3 [49.6] 22.4	209.3 [61.3] 155.7 [45.6] 22.0	213.6 [62.6] 213.6 [62.6] 22.7	204.6 [60] 198.6 [58.2] 22.2	198.2 [58.1] 182.7 [53.5] 21.9
	120 [48.9]	Total BTUH [kW] Sens BTUH [kW] Power	233.5 [68.4] 143.2 [41.9] 24.2	223.6 [65.5] 128.6 [37.7] 23.7	216.6 [63.5] 118.3 [34.7] 23.4	216.3 [63.4] 184.1 [53.9] 24.0	207.2 [60.7] 165.4 [48.5] 23.5	200.7 [58.8] 152.1 [44.6] 23.2	204.4 [59.9] 204.4 [59.9] 23.9	195.7 [57.4] 194.7 [57.1] 23.4	189.6 [55.6] 179.1 [52.5] 23.0
125 [51.7]	Total BTUH [kW] Sens BTUH [kW] Power	223.4 [65.5] 138.4 [40.6] 25.5	214 [62.7] 124.3 [36.4] 24.9	207.3 [60.7] 114.4 [33.5] 24.69	206.3 [60.4] 179.3 [52.5] 25.3	197.6 [57.9] 161.1 [47.2] 24.8	191.4 [56.1] 148.2 [43.4] 24.4	194.3 [56.9] 194.3 [56.9] 25.1	186.1 [54.5] 186.1 [54.5] 24.6	180.3 [52.8] 175.2 [51.3] 24.2	

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[ ] Designates Metric Conversions

## GROSS SYSTEMS PERFORMANCE DATA—G300

ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①											
wbE			71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]		
CFM [L/s]			10615 [5010]	9650 [4554]	8202 [3871]	10615 [5010]	9650 [4554]	8202 [3871]	10615 [5010]	9650 [4554]	8202 [3871]
DR ①			.13	.11	.08	.13	.11	.08	.13	.11	.08
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	343.6 [100.7]	337.4 [98.9]	328.2 [96.2]	326.8 [95.8]	321 [94.1]	312.2 [91.5]	315.2 [92.4]	309.5 [90.7]	301.1 [88.2]
		Sens BTUH [kW]	205.7 [60.3]	196.5 [57.6]	182.7 [53.5]	244.1 [71.5]	233.3 [68.4]	216.9 [63.6]	274.9 [80.5]	262.6 [77]	244.2 [71.6]
		Power	21.3	21.2	20.9	21.2	21.0	20.7	21.0	20.8	20.5
	80 [26.7]	Total BTUH [kW]	341 [99.9]	334.9 [98.1]	325.8 [95.5]	324.3 [95]	318.5 [93.3]	309.8 [90.8]	312.6 [91.6]	307 [90]	298.7 [87.5]
		Sens BTUH [kW]	204.7 [60]	195.6 [57.3]	181.9 [53.3]	243.2 [71.3]	232.4 [68.1]	216.1 [63.3]	274 [80.3]	261.7 [76.7]	243.4 [71.3]
		Power	22.1	21.9	21.6	21.9	21.7	21.4	21.7	21.5	21.2
	85 [29.4]	Total BTUH [kW]	337.7 [99]	331.6 [97.2]	322.6 [94.5]	321 [94.1]	315.2 [92.4]	306.6 [89.9]	309.3 [90.6]	303.8 [89]	295.5 [86.6]
		Sens BTUH [kW]	203.4 [59.6]	194.4 [57]	180.7 [53]	241.9 [70.9]	231.1 [67.7]	214.9 [63]	272.6 [79.9]	260.5 [76.3]	242.2 [71]
		Power	22.9	22.7	22.4	22.7	22.5	22.2	22.5	22.3	22.0
	90 [32.2]	Total BTUH [kW]	333.5 [97.7]	327.6 [96]	318.6 [93.4]	316.8 [92.8]	311.1 [91.2]	302.7 [88.7]	305.1 [89.4]	299.7 [87.8]	291.5 [85.4]
Sens BTUH [kW]		201.7 [59.1]	192.7 [56.5]	179.2 [52.5]	240.2 [70.4]	229.5 [67.2]	213.4 [62.5]	270.9 [79.4]	258.9 [75.9]	240.7 [70.5]	
Power		23.8	23.6	23.2	23.6	23.4	23.1	23.4	23.2	22.9	
95 [35]	Total BTUH [kW]	328.6 [96.3]	322.7 [94.6]	313.9 [92]	311.8 [91.4]	306.3 [89.8]	297.9 [87.3]	300.2 [88]	294.8 [86.4]	286.8 [84]	
	Sens BTUH [kW]	199.6 [58.5]	190.7 [55.9]	177.4 [52]	238.1 [69.8]	227.5 [66.7]	211.5 [62]	268.8 [78.8]	256.8 [75.3]	238.9 [70]	
	Power	24.7	24.5	24.1	24.5	24.3	24.0	24.3	24.1	23.8	
100 [37.8]	Total BTUH [kW]	322.8 [94.6]	317 [92.9]	308.4 [90.4]	306.1 [89.7]	300.6 [88.1]	292.4 [85.7]	294.4 [86.3]	289.1 [84.7]	281.3 [82.4]	
	Sens BTUH [kW]	197.1 [57.8]	188.3 [55.2]	175.1 [51.3]	235.6 [69]	225.1 [66]	209.3 [61.3]	266.3 [78]	254.5 [74.6]	236.6 [69.3]	
	Power	25.6	25.4	25.1	25.5	25.2	24.9	25.3	25	24.7	
105 [40.6]	Total BTUH [kW]	316.2 [92.7]	310.6 [91]	302.1 [88.5]	299.5 [87.8]	294.2 [86.2]	286.1 [83.8]	287.8 [84.3]	282.7 [82.8]	275 [80.6]	
	Sens BTUH [kW]	194.2 [56.9]	185.6 [54.4]	172.6 [50.6]	232.7 [68.2]	222.3 [65.1]	206.8 [60.6]	263.4 [77.2]	251.7 [73.8]	234.1 [68.6]	
	Power	26.7	26.4	26.1	26.5	26.2	25.9	26.3	26.1	25.7	
110 [43.3]	Total BTUH [kW]	308.8 [90.5]	303.3 [88.9]	295 [86.5]	292.1 [85.6]	286.9 [84.1]	279.1 [81.8]	280.4 [82.2]	275.4 [80.7]	267.9 [78.5]	
	Sens BTUH [kW]	190.9 [55.9]	182.4 [53.5]	169.6 [49.7]	229.4 [67.2]	219.2 [64.2]	203.8 [59.7]	260.1 [76.2]	248.5 [72.8]	231.1 [67.7]	
	Power	27.7	27.5	27.1	27.5	27.3	26.9	27.3	27.1	26.8	
115 [46.1]	Total BTUH [kW]	300.6 [88.1]	295.3 [86.5]	287.2 [84.2]	283.9 [83.2]	278.8 [81.7]	271.2 [79.5]	272.2 [79.8]	267.4 [78.4]	260.1 [76.2]	
	Sens BTUH [kW]	187.2 [54.9]	178.9 [52.4]	166.4 [48.8]	225.7 [66.1]	215.7 [63.2]	200.6 [58.8]	256.5 [75.2]	245 [71.8]	227.9 [66.8]	
	Power	28.8	28.6	28.2	28.7	28.4	28.0	28.5	28.2	27.8	
120 [48.9]	Total BTUH [kW]	291.6 [85.5]	286.4 [83.9]	278.6 [81.6]	274.9 [80.6]	270 [79.1]	262.6 [77]	263.2 [77.1]	258.5 [75.8]	251.5 [73.7]	
	Sens BTUH [kW]	183.2 [53.7]	175 [51.3]	162.7 [47.7]	221.6 [64.9]	211.8 [62.1]	196.9 [57.7]	252.4 [74]	241.1 [70.7]	224.2 [65.7]	
	Power	30.0	29.7	29.4	29.8	29.6	29.2	29.6	29.4	29.0	
125 [51.7]	Total BTUH [kW]	281.8 [82.6]	276.8 [81.1]	269.2 [78.9]	265.1 [77.7]	260.4 [76.3]	253.3 [74.2]	253.4 [74.3]	248.9 [72.9]	242.1 [70.9]	
	Sens BTUH [kW]	178.7 [52.4]	170.7 [50]	158.8 [46.5]	217.2 [63.6]	207.5 [60.8]	193 [56.5]	247.9 [72.6]	236.8 [69.4]	220.3 [64.5]	
	Power	31.2	31.0	30.5	31.0	30.8	30.4	30.9	30.6	30.2	

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[ ] Designates Metric Conversions

## GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G180

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			3600 [1699]	2950 [1392]	2400 [1133]	3600 [1699]	2950 [1392]	2400 [1133]	3600 [1699]	2950 [1392]	2400 [1133]
OUTDOOR DRY BULB TEMPERATURE  °F [°C]	60 [15.6]	Total BTUH [kW]	49.6 [14.5]	47.7 [14.0]	46.0 [13.5]	46.7 [13.7]	44.9 [13.2]	43.4 [12.7]	45.1 [13.2]	43.4 [12.7]	41.9 [12.3]
		Sens BTUH [kW]	9.0 [2.6]	8.1 [2.4]	7.4 [2.2]	14.1 [4.1]	12.8 [3.8]	11.7 [3.4]	20.6 [6.0]	18.6 [5.5]	17.0 [5.0]
		Power	5.9	5.8	5.7	5.9	5.8	5.7	5.9	5.8	5.7
	65 [18.3]	Total BTUH [kW]	48.6 [14.2]	46.7 [13.7]	45.1 [13.2]	45.7 [13.4]	44.0 [12.9]	42.5 [12.5]	44.2 [12.9]	42.5 [12.4]	41.0 [12.0]
		Sens BTUH [kW]	8.0 [2.4]	7.3 [2.1]	6.6 [1.9]	13.2 [3.9]	12.0 [3.5]	10.9 [3.2]	19.6 [5.7]	17.8 [5.2]	16.2 [4.8]
		Power	6.0	5.9	5.8	6.0	5.9	5.8	5.9	5.8	5.7
	70 [21.1]	Total BTUH [kW]	47.5 [13.9]	45.7 [13.4]	44.1 [12.9]	44.7 [13.1]	43.0 [12.6]	41.5 [12.2]	43.1 [12.6]	41.4 [12.1]	40.0 [11.7]
		Sens BTUH [kW]	7.1 [2.1]	6.4 [1.9]	5.9 [1.7]	12.2 [3.6]	11.1 [3.3]	10.1 [3.0]	18.7 [5.5]	16.9 [5.0]	15.4 [4.5]
		Power	6.1	6.0	5.9	6.1	6.0	5.9	6.0	5.9	5.8
	75 [23.9]	Total BTUH [kW]	46.4 [13.6]	44.6 [13.1]	43.1 [12.6]	43.5 [12.8]	41.9 [12.3]	40.4 [11.9]	42.0 [12.3]	40.3 [11.8]	39.0 [11.4]
		Sens BTUH [kW]	6.1 [1.8]	5.6 [1.6]	5.1 [1.5]	11.3 [3.3]	10.2 [3.0]	9.4 [2.7]	17.7 [5.2]	16.1 [4.7]	14.7 [4.3]
		Power	6.2	6.1	6.0	6.2	6.1	6.0	6.1	6.0	5.9
80 [26.7]	Total BTUH [kW]	45.2 [13.2]	43.4 [12.7]	42.0 [12.3]	42.3 [12.4]	40.7 [11.9]	39.3 [11.5]	40.7 [11.9]	39.2 [11.5]	37.8 [11.1]	
	Sens BTUH [kW]	5.2 [1.5]	4.7 [1.4]	4.3 [1.3]	10.3 [3.0]	9.4 [2.7]	8.6 [2.5]	16.7 [4.9]	15.2 [4.5]	13.9 [4.1]	
	Power	6.3	6.2	6.1	6.3	6.2	6.1	6.2	6.1	6.0	
85 [29.4]	Total BTUH [kW]	43.9 [12.9]	42.2 [12.4]	40.8 [11.9]	41.0 [12.0]	39.5 [11.6]	38.1 [11.2]	39.4 [11.6]	37.9 [11.1]	36.6 [10.7]	
	Sens BTUH [kW]	4.2 [1.2]	3.8 [1.1]	3.5 [1.0]	9.4 [2.7]	8.5 [2.5]	7.8 [2.3]	15.8 [4.6]	14.3 [4.2]	13.1 [3.8]	
	Power	6.4	6.3	6.2	6.4	6.3	6.2	6.4	6.3	6.1	
90 [32.2]	Total BTUH [kW]	42.5 [12.5]	40.9 [12.0]	39.5 [11.6]	39.7 [11.6]	38.1 [11.2]	36.8 [10.8]	38.1 [11.2]	36.6 [10.7]	35.4 [10.4]	
	Sens BTUH [kW]	3.2 [1.0]	2.9 [0.9]	2.7 [0.8]	8.4 [2.5]	7.6 [2.2]	7.0 [2.0]	14.8 [4.3]	13.4 [3.9]	12.3 [3.6]	
	Power	6.6	6.5	6.4	6.6	6.4	6.3	6.5	6.4	6.3	

## GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G180

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]	7200 [3398]	5900 [2784]	4800 [2265]
OUTDOOR DRY BULB TEMPERATURE  °F [°C]	60 [15.6]	Total BTUH [kW]	162.1 [47.5]	155.9 [45.7]	150.6 [44.1]	158.6 [46.5]	152.5 [44.7]	147.3 [43.2]	153.8 [45.1]	147.9 [43.3]	142.9 [41.9]
		Sens BTUH [kW]	81.5 [23.9]	73.9 [21.7]	67.5 [19.8]	93.0 [27.3]	84.3 [24.7]	77.0 [22.6]	103.2 [30.2]	93.6 [27.4]	85.4 [25.0]
		Power	11.5	11.3	11.1	11.4	11.2	11.0	11.3	11.1	10.9
	70 [21.1]	Total BTUH [kW]	156.6 [45.9]	150.6 [44.1]	145.4 [42.6]	153.0 [44.8]	147.1 [43.1]	142.1 [41.7]	148.3 [43.5]	142.6 [41.8]	137.7 [40.4]
		Sens BTUH [kW]	77.9 [22.8]	70.6 [20.7]	64.5 [18.9]	89.4 [26.2]	81.0 [23.7]	74.0 [21.7]	99.5 [29.2]	90.3 [26.5]	82.4 [24.1]
		Power	12.2	12.0	11.8	12.1	11.9	11.7	12.0	11.8	11.6
	80 [26.7]	Total BTUH [kW]	148.4 [43.5]	142.6 [41.8]	137.8 [40.4]	144.8 [42.4]	139.2 [40.8]	134.5 [39.4]	140.1 [41.0]	134.7 [39.5]	130.1 [38.1]
		Sens BTUH [kW]	71.8 [21.0]	65.1 [19.1]	59.4 [17.4]	83.3 [24.4]	75.5 [22.1]	68.9 [20.2]	93.4 [27.4]	84.7 [24.8]	77.3 [22.7]
		Power	13.0	12.8	12.6	12.9	12.7	12.5	12.8	12.6	12.4
	90 [32.2]	Total BTUH [kW]	137.5 [40.3]	132.2 [38.7]	127.7 [37.4]	133.9 [39.2]	128.8 [37.7]	124.4 [36.5]	129.2 [37.9]	124.2 [36.4]	120.0 [35.2]
		Sens BTUH [kW]	63.2 [18.5]	57.3 [16.8]	52.3 [15.3]	74.7 [21.9]	67.7 [19.8]	61.8 [18.1]	84.9 [24.9]	76.9 [22.5]	70.2 [20.6]
		Power	13.9	13.7	13.5	13.9	13.6	13.4	13.8	13.5	13.3
100 [37.8]	Total BTUH [kW]	123.9 [36.3]	119.2 [34.9]	115.1 [33.7]	120.4 [35.3]	115.7 [33.9]	111.8 [32.8]	115.6 [33.9]	111.2 [32.6]	107.4 [31.5]	
	Sens BTUH [kW]	52.1 [15.3]	47.3 [13.9]	43.2 [12.6]	63.6 [18.6]	57.7 [16.9]	52.7 [15.4]	73.8 [21.6]	66.9 [19.6]	61.1 [17.9]	
	Power	15.0	14.7	14.5	14.9	14.6	14.4	14.8	14.5	14.3	
110 [43.3]	Total BTUH [kW]	107.7 [31.6]	103.6 [30.4]	100.1 [29.3]	104.2 [30.5]	100.2 [29.4]	96.8 [28.4]	99.4 [29.1]	95.6 [28.0]	92.4 [27.1]	
	Sens BTUH [kW]	38.6 [11.3]	35.0 [10.3]	32.0 [9.4]	50.1 [14.7]	45.4 [13.3]	41.5 [12.2]	60.3 [17.7]	54.7 [16.0]	49.9 [14.6]	
	Power	16.2	15.9	15.6	16.1	15.8	15.5	16.0	15.7	15.4	
120 [48.9]	Total BTUH [kW]	88.9 [26.0]	85.4 [25.0]	82.5 [24.2]	85.3 [25.0]	82.0 [24.0]	79.2 [23.2]	80.6 [23.6]	77.5 [22.7]	74.8 [21.9]	
	Sens BTUH [kW]	22.6 [6.6]	20.5 [6.0]	18.7 [5.5]	34.1 [10.0]	30.9 [9.1]	28.2 [8.3]	44.3 [13.0]	40.1 [11.8]	36.7 [10.7]	
	Power	17.4	17.1	16.8	17.4	17.0	16.8	17.3	16.9	16.7	

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ .

[ ] Designates Metric Conversions

**GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G240**

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	63.5 [18.6]	60.8 [17.8]	58.9 [17.3]	60.1 [17.6]	57.6 [16.9]	55.8 [16.3]	58.5 [17.1]	56.0 [16.4]	54.3 [15.9]
		Sens BTUH [kW]	10.7 [3.1]	9.6 [2.8]	8.8 [2.6]	15.0 [4.4]	13.5 [4.0]	12.4 [3.6]	29.1 [8.5]	26.1 [7.7]	24.0 [7.0]
		Power	8.3	8.2	8.0	8.3	8.1	8.0	8.3	8.1	8.0
	65 [18.3]	Total BTUH [kW]	61.8 [18.1]	59.2 [17.3]	57.3 [16.8]	58.4 [17.1]	55.9 [16.4]	54.2 [15.9]	56.8 [16.6]	54.4 [15.9]	52.7 [15.4]
		Sens BTUH [kW]	9.0 [2.6]	8.1 [2.4]	7.4 [2.2]	13.3 [3.9]	12.0 [3.5]	11.0 [3.2]	27.4 [8.0]	24.6 [7.2]	22.7 [6.6]
		Power	8.4	8.3	8.1	8.4	8.2	8.1	8.4	8.2	8.1
	70 [21.1]	Total BTUH [kW]	60.1 [17.6]	57.6 [16.9]	55.8 [16.4]	56.7 [16.6]	54.4 [15.9]	52.7 [15.4]	55.1 [16.2]	52.8 [15.5]	51.2 [15.0]
		Sens BTUH [kW]	7.3 [2.1]	6.5 [1.9]	6.0 [1.8]	11.6 [3.4]	10.4 [3.1]	9.6 [2.8]	25.7 [7.5]	23.1 [6.8]	21.3 [6.2]
		Power	8.6	8.4	8.3	8.6	8.4	8.2	8.5	8.3	8.2
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	58.5 [17.2]	56.1 [16.4]	54.3 [15.9]	55.2 [16.2]	52.8 [15.5]	51.2 [15.0]	53.5 [15.7]	51.3 [15.0]	49.7 [14.6]
		Sens BTUH [kW]	5.5 [1.6]	4.9 [1.4]	4.5 [1.3]	9.9 [2.9]	8.9 [2.6]	8.1 [2.4]	23.9 [7.0]	21.5 [6.3]	19.8 [5.8]
		Power	8.7	8.5	8.4	8.7	8.5	8.4	8.7	8.5	8.3
	80 [26.7]	Total BTUH [kW]	57.0 [16.7]	54.6 [16.0]	52.9 [15.5]	53.6 [15.7]	51.3 [15.0]	49.7 [14.6]	52.0 [15.2]	49.8 [14.6]	48.3 [14.1]
		Sens BTUH [kW]	3.7 [1.1]	3.3 [1.0]	3.0 [0.9]	8.0 [2.4]	7.2 [2.1]	6.6 [1.9]	22.1 [6.5]	19.9 [5.8]	18.3 [5.4]
		Power	8.9	8.7	8.6	8.9	8.7	8.5	8.8	8.6	8.5
	85 [29.4]	Total BTUH [kW]	55.5 [16.3]	53.2 [15.6]	51.5 [15.1]	52.1 [15.3]	49.9 [14.6]	48.4 [14.2]	50.5 [14.8]	48.4 [14.2]	46.9 [13.7]
		Sens BTUH [kW]	1.8 [0.5]	1.6 [0.5]	1.5 [0.4]	6.1 [1.8]	5.5 [1.6]	5.1 [1.5]	20.2 [5.9]	18.2 [5.3]	16.7 [4.9]
		Power	9.1	8.9	8.7	9.0	8.9	8.7	9.0	8.8	8.7
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	54.1 [15.9]	51.8 [15.2]	50.2 [14.7]	50.7 [14.9]	48.6 [14.2]	47.1 [13.8]	49.1 [14.4]	47.0 [13.8]	45.6 [13.4]
		Sens BTUH [kW]	-0.1 [0.0]	-0.1 [0.0]	-0.1 [0.0]	4.2 [1.2]	3.8 [1.1]	3.5 [1.0]	18.3 [5.4]	16.4 [4.8]	15.1 [4.4]
		Power	9.3	9.1	8.9	9.3	9.1	8.9	9.2	9.0	8.9

**GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G240**

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	192.6 [56.4]	184.4 [54.0]	178.7 [52.4]	187.7 [55.0]	179.7 [52.7]	174.1 [51.0]	184.2 [54.0]	176.4 [51.7]	170.9 [50.1]
		Sens BTUH [kW]	88.3 [25.9]	79.3 [23.2]	72.9 [21.4]	102.9 [30.2]	92.5 [27.1]	85.1 [24.9]	118.4 [34.7]	106.3 [31.2]	97.8 [28.7]
		Power	14.1	13.8	13.6	14.0	13.7	13.5	14.0	13.7	13.5
	70 [21.1]	Total BTUH [kW]	186.2 [54.6]	178.4 [52.3]	172.8 [50.6]	181.4 [53.1]	173.7 [50.9]	168.3 [49.3]	177.9 [52.1]	170.4 [49.9]	165.0 [48.4]
		Sens BTUH [kW]	86.1 [25.2]	77.4 [22.7]	71.2 [20.9]	100.8 [29.5]	90.5 [26.5]	83.3 [24.4]	116.2 [34.1]	104.4 [30.6]	96.1 [28.1]
		Power	14.9	14.5	14.3	14.8	14.5	14.2	14.7	14.4	14.2
	80 [26.7]	Total BTUH [kW]	177.2 [51.9]	169.7 [49.7]	164.4 [48.2]	172.3 [50.5]	165.0 [48.4]	159.9 [46.8]	168.8 [49.5]	161.7 [47.4]	156.6 [45.9]
		Sens BTUH [kW]	81.3 [23.8]	73.0 [21.4]	67.2 [19.7]	96.0 [28.1]	86.2 [25.3]	79.3 [23.2]	111.4 [32.6]	100.1 [29.3]	92.1 [27.0]
		Power	15.9	15.5	15.3	15.8	15.5	15.2	15.7	15.4	15.2
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	165.3 [48.5]	158.4 [46.4]	153.4 [45.0]	160.5 [47.0]	153.7 [45.0]	148.9 [43.6]	157.0 [46.0]	150.4 [44.1]	145.7 [42.7]
		Sens BTUH [kW]	73.8 [21.6]	66.3 [19.4]	61.0 [17.9]	88.5 [25.9]	79.5 [23.3]	73.1 [21.4]	103.9 [30.4]	93.3 [27.3]	85.9 [25.2]
		Power	17.2	16.8	16.6	17.1	16.7	16.5	17.0	16.7	16.4
	100 [37.8]	Total BTUH [kW]	150.8 [44.2]	144.4 [42.3]	139.9 [41.0]	145.9 [42.8]	139.7 [40.9]	135.4 [39.7]	142.4 [41.7]	136.4 [40.0]	132.1 [38.7]
		Sens BTUH [kW]	63.6 [18.6]	57.1 [16.7]	52.6 [15.4]	78.3 [22.9]	70.3 [20.6]	64.7 [19.0]	93.7 [27.5]	84.2 [24.7]	77.4 [22.7]
		Power	18.8	18.4	18.1	18.7	18.3	18.0	18.6	18.2	17.9
	110 [43.3]	Total BTUH [kW]	133.4 [39.1]	127.8 [37.5]	123.8 [36.3]	128.6 [37.7]	123.1 [36.1]	119.3 [35.0]	125.1 [36.7]	119.8 [35.1]	116.1 [34.0]
		Sens BTUH [kW]	50.7 [14.9]	45.6 [13.4]	41.9 [12.3]	65.4 [19.2]	58.8 [17.2]	54.0 [15.8]	80.8 [23.7]	72.6 [21.3]	66.8 [19.6]
		Power	20.6	20.2	19.9	20.5	20.1	19.8	20.5	20.0	19.7
OUTDOOR DRY BULB TEMPERATURE °F [°C]	120 [48.9]	Total BTUH [kW]	113.4 [33.2]	108.6 [31.8]	105.2 [30.8]	108.5 [31.8]	103.9 [30.4]	100.7 [29.5]	105.0 [30.8]	100.6 [29.5]	97.4 [28.6]
		Sens BTUH [kW]	35.2 [10.3]	31.6 [9.3]	29.1 [8.5]	49.9 [14.6]	44.8 [13.1]	41.2 [12.1]	65.3 [19.1]	58.7 [17.2]	54.0 [15.8]
		Power	22.8	22.3	22.0	22.7	22.2	21.9	22.6	22.1	21.8

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ .

[ ] Designates Metric Conversions

## GROSS SYSTEMS PERFORMANCE DATA (LOW REHEAT MODE)—G300

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]	4800 [2265]	3863 [1823]	3200 [1510]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	71.4 [20.9]	68.4 [20.1]	66.3 [19.4]	67.6 [19.8]	64.7 [19.0]	62.7 [18.4]	65.4 [19.2]	62.7 [18.4]	60.7 [17.8]
		Sens BTUH [kW]	11.7 [3.4]	10.5 [3.1]	9.7 [2.8]	18.4 [5.4]	16.6 [4.9]	15.2 [4.5]	28.6 [8.4]	25.7 [7.5]	23.7 [6.9]
		Power	8.9	8.7	8.6	8.8	8.7	8.5	8.8	8.6	8.5
	65 [18.3]	Total BTUH [kW]	69.5 [20.4]	66.5 [19.5]	64.5 [18.9]	65.6 [19.2]	62.8 [18.4]	60.9 [17.8]	63.5 [18.6]	60.8 [17.8]	58.9 [17.3]
		Sens BTUH [kW]	9.8 [2.9]	8.8 [2.6]	8.1 [2.4]	16.5 [4.8]	14.8 [4.4]	13.7 [4.0]	26.7 [7.8]	24.0 [7.0]	22.1 [6.5]
		Power	9.0	8.8	8.7	9.0	8.8	8.6	8.9	8.7	8.6
	70 [21.1]	Total BTUH [kW]	67.3 [19.7]	64.5 [18.9]	62.4 [18.3]	63.4 [18.6]	60.8 [17.8]	58.9 [17.3]	61.3 [18.0]	58.7 [17.2]	56.9 [16.7]
		Sens BTUH [kW]	7.8 [2.3]	7.0 [2.1]	6.4 [1.9]	14.5 [4.3]	13.1 [3.8]	12.0 [3.5]	24.7 [7.2]	22.2 [6.5]	20.4 [6.0]
		Power	9.2	9.0	8.8	9.1	8.9	8.8	9.1	8.9	8.7
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW]	64.9 [19.0]	62.2 [18.2]	60.3 [17.7]	61.1 [17.9]	58.5 [17.1]	56.7 [16.6]	58.9 [17.3]	56.4 [16.5]	54.7 [16.0]
		Sens BTUH [kW]	5.7 [1.7]	5.2 [1.5]	4.7 [1.4]	12.5 [3.7]	11.2 [3.3]	10.3 [3.0]	22.7 [6.6]	20.4 [6.0]	18.7 [5.5]
		Power	9.4	9.2	9.0	9.3	9.1	9.0	9.3	9.1	8.9
	80 [26.7]	Total BTUH [kW]	62.4 [18.3]	59.7 [17.5]	57.9 [17.0]	58.5 [17.2]	56.1 [16.4]	54.3 [15.9]	56.4 [16.5]	54.0 [15.8]	52.3 [15.3]
		Sens BTUH [kW]	3.6 [1.1]	3.2 [0.9]	3.0 [0.9]	10.3 [3.0]	9.3 [2.7]	8.5 [2.5]	20.5 [6.0]	18.4 [5.4]	17.0 [5.0]
		Power	9.6	9.4	9.3	9.6	9.4	9.2	9.5	9.3	9.2
	85 [29.4]	Total BTUH [kW]	59.6 [17.5]	57.1 [16.7]	55.3 [16.2]	55.8 [16.3]	53.4 [15.7]	51.8 [15.2]	53.6 [15.7]	51.4 [15.0]	49.8 [14.6]
		Sens BTUH [kW]	1.4 [0.4]	1.2 [0.4]	1.1 [0.3]	8.1 [2.4]	7.3 [2.1]	6.7 [2.0]	18.3 [5.4]	16.4 [4.8]	15.1 [4.4]
		Power	9.9	9.7	9.5	9.9	9.7	9.5	9.8	9.6	9.5
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	56.7 [16.6]	54.3 [15.9]	52.6 [15.4]	52.8 [15.5]	50.6 [14.8]	49.0 [14.4]	50.7 [14.9]	48.5 [14.2]	47.0 [13.8]
		Sens BTUH [kW]	-0.9 [-0.3]	-0.8 [-0.2]	-0.8 [-0.2]	5.8 [1.7]	5.2 [1.5]	4.8 [1.4]	16.0 [4.7]	14.4 [4.2]	13.2 [3.9]
		Power	10.2	10.0	9.9	10.2	10.0	9.8	10.1	9.9	9.8

## GROSS SYSTEMS PERFORMANCE DATA (HIGH REHEAT MODE)—G300

ENTERING INDOOR AIR @ 75°F [23.9°C] dbE ①											
wbE			65.3°F [18.5°C]			64°F [17.8°C]			62.5°F [16.9°C]		
CFM [L/s]			9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]	9600 [4531]	7725 [3646]	6400 [3020]
OUTDOOR DRY BULB TEMPERATURE °F [°C]	60 [15.6]	Total BTUH [kW]	248.3 [72.8]	237.8 [69.7]	230.4 [67.5]	242.5 [71.1]	232.2 [68.1]	225.0 [65.9]	236.6 [69.3]	226.6 [66.4]	219.6 [64.3]
		Sens BTUH [kW]	123.3 [36.1]	110.8 [32.5]	101.9 [29.9]	140.7 [41.2]	126.4 [37.0]	116.2 [34.1]	162.1 [47.5]	145.6 [42.7]	134.0 [39.3]
		Power	17.6	17.3	17.0	17.5	17.1	16.9	17.4	17.0	16.7
	70 [21.1]	Total BTUH [kW]	239.0 [70.0]	228.9 [67.1]	221.7 [65.0]	233.2 [68.3]	223.3 [65.4]	216.4 [63.4]	227.3 [66.6]	217.7 [63.8]	210.9 [61.8]
		Sens BTUH [kW]	116.1 [34.0]	104.3 [30.6]	96.0 [28.1]	133.5 [39.1]	119.9 [35.1]	110.3 [32.3]	154.9 [45.4]	139.2 [40.8]	128.0 [37.5]
		Power	18.7	18.3	18.0	18.6	18.2	17.9	18.4	18.0	17.8
	80 [26.7]	Total BTUH [kW]	226.9 [66.5]	217.3 [63.7]	210.5 [61.7]	221.1 [64.8]	211.8 [62.1]	205.2 [60.1]	215.2 [63.1]	206.1 [60.4]	199.7 [58.5]
		Sens BTUH [kW]	106.9 [31.3]	96.0 [28.1]	88.3 [25.9]	124.2 [36.4]	111.6 [32.7]	102.6 [30.1]	145.7 [42.7]	130.8 [38.3]	120.4 [35.3]
		Power	20.1	19.7	19.4	20.0	19.6	19.3	19.9	19.4	19.2
OUTDOOR DRY BULB TEMPERATURE °F [°C]	90 [32.2]	Total BTUH [kW]	212.0 [62.1]	203.1 [59.5]	196.7 [57.7]	206.2 [60.4]	197.5 [57.9]	191.4 [56.1]	200.4 [58.7]	191.9 [56.2]	185.9 [54.5]
		Sens BTUH [kW]	95.5 [28.0]	85.8 [25.1]	78.9 [23.1]	112.9 [33.1]	101.4 [29.7]	93.3 [27.3]	134.3 [39.4]	120.6 [35.4]	111.0 [32.5]
		Power	22.0	21.5	21.2	21.8	21.4	21.0	21.7	21.2	20.9
	100 [37.8]	Total BTUH [kW]	194.4 [57.0]	186.2 [54.6]	180.4 [52.9]	188.6 [55.3]	180.6 [52.9]	175.0 [51.3]	182.7 [53.6]	175.0 [51.3]	169.6 [49.7]
		Sens BTUH [kW]	82.1 [24.1]	73.7 [21.6]	67.8 [19.9]	99.4 [29.1]	89.3 [26.2]	82.2 [24.1]	120.9 [35.4]	108.6 [31.8]	99.9 [29.3]
		Power	24.2	23.7	23.3	24.0	23.5	23.2	23.9	23.4	23.0
	110 [43.3]	Total BTUH [kW]	174.0 [51.0]	166.6 [48.8]	161.4 [47.3]	168.2 [49.3]	161.1 [47.2]	156.1 [45.7]	162.3 [47.6]	155.5 [45.6]	150.6 [44.1]
		Sens BTUH [kW]	66.6 [19.5]	59.8 [17.5]	55.0 [16.1]	83.9 [24.6]	75.4 [22.1]	69.3 [20.3]	105.4 [30.9]	94.6 [27.7]	87.1 [25.5]
		Power	26.7	26.2	25.8	26.6	26.0	25.7	26.5	25.9	25.5
OUTDOOR DRY BULB TEMPERATURE °F [°C]	120 [48.9]	Total BTUH [kW]	150.8 [44.2]	144.4 [42.3]	139.9 [41.0]	145.0 [42.5]	138.9 [40.7]	134.5 [39.4]	139.1 [40.8]	133.3 [39.0]	129.1 [37.8]
		Sens BTUH [kW]	49.0 [14.4]	44.0 [12.9]	40.5 [11.9]	66.3 [19.4]	59.6 [17.5]	54.8 [16.1]	87.8 [25.7]	78.8 [23.1]	72.5 [21.2]
		Power	29.7	29.1	28.6	29.6	28.9	28.5	29.4	28.8	28.4

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE—Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power—KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$ .

[ ] Designates Metric Conversions



## AIRFLOW PERFORMANCE— 15 TON [52.7 kW] — 60 Hz — SIDEFLOW

Air Flow CFM [L/s]	Capacity 15 Tons [52.7 kW]										External Static Pressure—Inches of Water [kPa]																															
	0.1 [0.02]		0.2 [0.05]		0.3 [0.07]		0.4 [0.10]		0.5 [0.12]		0.6 [0.15]		0.7 [0.17]		0.8 [0.20]		0.9 [0.22]		1.0 [0.25]		1.1 [0.27]		1.2 [0.30]		1.3 [0.32]		1.4 [0.35]		1.5 [0.37]		1.6 [0.40]		1.7 [0.42]		1.8 [0.45]		1.9 [0.47]		2.0 [0.50]			
	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W		
4800 [2265]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5000 [2359]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5200 [2454]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5400 [2548]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5600 [2643]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
5800 [2737]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6000 [2831]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6200 [2926]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6400 [3020]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6600 [3114]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
6800 [3209]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
7000 [3303]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
7200 [3398]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

NOTE: L-Drive left of bold line, M-Drive right of bold line, N-Drive right of double line.

Drive Package	R										S									
	3.0 [2237.1]										5.0 [3728.5.4]									
Motor H.P. [W]																				
Blower Sheave	BK105H										BK105H									
Motor Sheave	1VP-44										1VP-56									
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6	1	2
RPM	716	689	655	624	593	560	920	888	860	826	795	761	920	888	860	826	795	761	920	888

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.

4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[ ] Designates Metric Conversions

COMPONENT AIR RESISTANCE — 15 TON [52.8 kW]

CFM [L/s]	Resistance — Inches of Water [kPa]													
	4800 [2265]	5000 [2360]	5200 [2454]	5400 [2549]	5600 [2643]	5800 [2737]	6000 [2832]	6200 [2926]	6400 [3020]	6600 [3115]	6800 [3209]	7000 [3304]	7200 [3398]	
Wet Coil	0.03 [0.01]	0.04 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	0.07 [0.02]	0.08 [0.02]	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	
Downflow	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	0.06 [0.01]	0.07 [0.02]	0.08 [0.02]	0.08 [0.02]	
Downflow Economizer R.A. Damper Open	0.09 [0.02]	0.10 [0.02]	0.10 [0.02]	0.11 [0.03]	0.12 [0.03]	0.13 [0.03]	0.13 [0.03]	0.14 [0.03]	0.15 [0.04]	0.16 [0.04]	0.16 [0.04]	0.17 [0.04]	0.18 [0.04]	
Horizontal Economizer R.A. Damper Open	0.00 [0.00]	0.01 [0.00]	0.01 [0.00]	0.02 [0.00]	0.02 [0.00]	0.03 [0.01]	0.03 [0.01]	0.04 [0.01]	0.04 [0.01]	0.05 [0.01]	0.05 [0.01]	0.06 [0.01]	0.06 [0.01]	
Concentric Grill RXRN-AD80 or RXRN-AD81 & Transition RXMC-CJ07	0.21 [0.05]	0.25 [0.06]	0.28 [0.07]	0.32 [0.08]	0.35 [0.09]	0.39 [0.10]	0.43 [0.11]	0.46 [0.11]	0.50 [0.12]	0.54 [0.13]	0.57 [0.14]	0.61 [0.15]	0.64 [0.16]	
Pressure Drop MERV 8	0.068 [.02]	0.072 [.02]	0.076 [.02]	0.08 [.02]	0.084 [.02]	0.088 [.02]	0.092 [.02]	0.096 [.02]	0.1 [.02]	0.104 [.02]	0.108 [.03]	0.112 [.03]	0.116 [.03]	
Pressure Drop MERV 13	0.009 [.00]	0.015 [.00]	0.021 [.00]	0.028 [.01]	0.034 [.01]	0.04 [.01]	0.046 [.01]	0.052 [.01]	0.058 [.01]	0.065 [.02]	0.071 [.02]	0.077 [.02]	0.083 [.02]	

NOTE: Add component resistance to duct resistance to determine total external static pressure.

AIRFLOW CORRECTION FACTORS — 15 TON [52.8 kW]

ACTUAL—CFM [L/s]	4800 [2265]	5000 [2360]	5200 [2454]	5400 [2549]	5600 [2643]	5800 [2737]	6000 [2832]	6200 [2926]	6400 [3020]	6600 [3115]	6800 [3209]	7000 [3304]	7200 [3398]
TOTAL MBTUH	0.97	0.97	0.98	0.98	0.99	1.00	1.00	1.01	1.02	1.02	1.03	1.03	1.04
SENSIBLE MBTUH	0.87	0.90	0.92	0.94	0.97	0.99	1.02	1.04	1.06	1.09	1.11	1.14	1.16
POWER kW	0.98	0.98	0.99	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions

# AIRFLOW PERFORMANCE — 20 TON [70.3 kW]—SIDEFLOW

Air Flow CFM (L/s)	Capacity 20 Tons (70.3 kW)																																							
	External Static Pressure—Inches of Water (kPa)																																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]																				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W																			
6400 [3020]	—	—	—	—	—	628	2260	652	2378	675	2498	697	2621	719	2746	740	2873	762	3004	782	3136	802	3272	822	3410	842	3550	860	3693	879	3838	897	3986	915	4136					
6600 [3114]	—	—	—	—	615	2247	638	2367	661	2489	684	2613	706	2740	728	2869	749	3001	770	3136	790	3273	810	3412	830	3555	849	3699	867	3846	886	3996	903	4148	921	4303				
6800 [3209]	—	—	—	—	625	2358	648	2482	671	2608	694	2736	715	2868	737	3001	758	3138	778	3277	798	3418	818	3562	837	3708	856	3857	875	4008	893	4162	910	4319	927	4478				
7000 [3303]	—	—	—	612	2352	636	2477	659	2605	681	2735	703	2868	725	3004	746	3142	767	3282	787	3426	807	3571	826	3719	845	3870	864	4023	882	4179	900	4337	917	4498	934	4661			
7200 [3398]	—	—	—	623	2475	646	2605	669	2737	691	2872	713	3009	734	3149	755	3291	776	3436	796	3583	815	3733	834	3885	853	4040	871	4198	889	4358	907	4520	924	4685	940	4853			
7400 [3492]	—	—	634	2607	651	2741	679	2877	701	3016	723	3158	744	3294	764	3448	784	3597	804	3749	824	3903	843	4060	861	4219	878	4381	897	4545	914	4712	930	4881	947	5053				
7600 [3586]	—	—	622	2611	645	2747	667	2885	689	3026	711	3169	732	3315	753	3463	774	3614	794	3767	813	3923	832	4082	851	4243	869	4406	887	4572	904	4741	921	4912	937	5085	953	5261		
7800 [3681]	—	—	633	2756	656	2895	678	3038	700	3183	721	3331	742	3481	763	3633	783	3788	803	3946	822	4106	841	4269	859	4434	877	4602	895	4772	912	4945	928	5120	944	5298	960	5478		
8000 [3775]	—	622	2767	644	2908	667	3053	689	3199	711	3349	732	3500	752	3655	773	3812	793	3971	812	4133	831	4297	849	4464	868	4634	885	4806	902	4980	919	5157	936	5337	952	5519	967	5704	
8200 [3869]	—	633	2923	656	3069	679	3218	700	3369	721	3523	742	3679	762	3837	783	3998	802	4162	821	4328	840	4497	858	4668	876	4842	894	5018	910	5197	927	5378	943	5562	959	5749	974	5937	
8400 [3964]	622	2941	645	3089	667	3239	689	3392	711	3547	732	3702	752	3865	772	4194	812	4362	831	4532	849	4705	867	4881	885	5059	902	5239	919	5422	935	5608	951	5796	966	5987	981	6180		
8600 [4058]	634	3111	657	3263	679	3417	701	3574	722	3734	743	3896	763	4061	783	4228	802	4397	822	4570	840	4744	858	4922	876	5101	893	5284	910	5468	927	5656	943	5846	958	6038	974	6233	988	6430
8800 [4153]	647	3289	669	3445	691	3604	712	3765	733	3929	754	4095	774	4264	793	4436	813	4610	831	4786	850	4965	868	5147	885	5331	902	5517	919	5706	935	5898	951	6092	966	6289	981	6488		
9000 [4247]	659	3475	681	3635	702	3799	724	3964	744	4132	765	4303	784	4476	804	4652	823	4830	841	5011	859	5194	877	5380	894	5568	911	5759	927	5952	943	6148	959	6347	974	6548	989	6751		
9200 [4341]	671	3670	693	3835	714	4002	735	4172	756	4344	776	4519	795	4697	814	4877	833	5059	851	5244	869	5432	887	5622	904	5814	920	6009	936	6207	952	6407	967	6610	982	6815	—	—		
9400 [4436]	684	3873	705	4042	726	4214	747	4388	767	4565	787	4744	795	4925	825	5110	843	5297	861	5486	879	5678	896	5872	913	6069	929	6268	945	6470	965	6675	975	6881	990	7091	—	—		
9600 [4530]	696	4085	717	4258	738	4434	759	4612	779	4793	798	4977	817	5163	836	5351	854	5542	872	5736	889	5932	906	6131	922	6332	938	6535	954	6742	969	6950	7162	—	—	—	—			

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package	R								S								T (field installed only)							
Motor H.P. [W]	5.0 [3728.5.4]								7.5 [5592.7]								7.5 [5592.7]							
Blower Sheave	BK130H								BK130H								BK120H							
Motor Sheave	1VP-56								1VP-71								1VP-71							
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
RPM	748	723	696	668	641	614	927	902	875	848	820	793	994	967	940	912	883	853	994	967	940	912	883	853

- NOTES: 1. Factory sheave settings are shown in bold type.  
2. Do not set motor sheave below minimum turns open shown.  
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.  
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[ ] Designates Metric Conversions

COMPONENT AIRFLOW RESISTANCE—20 TON [70.3 kW]

CFM [L/s]	Resistance — Inches of Water [kPa]																
	6400 [3020]	6600 [3114]	6800 [3209]	7000 [3303]	7200 [3398]	7400 [3492]	7600 [3586]	7800 [3681]	8000 [3775]	8200 [3869]	8400 [3964]	8600 [4058]	8800 [4153]	9000 [4247]	9200 [4341]	9400 [4436]	9600 [4530]
Wet Coil	0.00 [.00]	0.00 [.00]	0.00 [.00]	0.01 [.00]	0.01 [.00]	0.02 [.00]	0.02 [.00]	0.03 [.01]	0.03 [.01]	0.04 [.01]	0.04 [.01]	0.05 [.01]	0.05 [.01]	0.06 [.01]	0.06 [.01]	0.07 [.02]	0.07 [.02]
Downflow	0.06 [.01]	0.06 [.01]	0.07 [.02]	0.08 [.02]	0.08 [.02]	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.18 [.04]	0.19 [.05]	0.20 [.05]	0.22 [.05]
Downflow Economizer R.A. Damper Open	0.15 [.04]	0.16 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]	0.20 [.05]	0.21 [.05]	0.22 [.05]	0.23 [.06]	0.24 [.06]	0.25 [.06]	0.26 [.06]	0.27 [.07]	0.28 [.07]	0.29 [.07]	0.30 [.07]
Horizontal Economizer R.A. Damper Open	0.04 [.01]	0.05 [.01]	0.05 [.01]	0.06 [.01]	0.06 [.01]	0.07 [.02]	0.07 [.02]	0.08 [.02]	0.09 [.02]	0.10 [.02]	0.10 [.02]	0.10 [.02]	0.11 [.03]	0.11 [.03]	0.12 [.03]	0.12 [.03]	0.13 [.03]
Concentric Grill RXRN-AD86 & Transition RXMC-CK08	0.26 [.06]	0.29 [.07]	0.32 [.08]	0.35 [.09]	0.38 [.09]	0.41 [.10]	0.44 [.11]	0.47 [.12]	0.50 [.12]	0.53 [.13]	0.56 [.14]	0.59 [.15]	0.62 [.15]	0.65 [.16]	0.69 [.17]	0.72 [.18]	0.75 [.19]
Pressure Drop MERV 8	0.1 [.02]	0.104 [.02]	0.108 [.03]	0.112 [.03]	0.116 [.03]	0.12 [.03]	0.124 [.03]	0.128 [.03]	0.132 [.03]	0.136 [.03]	0.14 [.03]	0.144 [.03]	0.148 [.04]	0.152 [.04]	0.156 [.04]	0.16 [.04]	0.164 [.04]
Pressure Drop MERV 13	0.058 [.01]	0.065 [.02]	0.071 [.02]	0.077 [.02]	0.083 [.02]	0.089 [.02]	0.095 [.02]	0.102 [.02]	0.108 [.03]	0.114 [.03]	0.12 [.03]	0.126 [.03]	0.132 [.03]	0.138 [.03]	0.145 [.04]	0.151 [.04]	0.157 [.04]

AIRFLOW CORRECTION FACTORS—20 TON [70.3 kW]

ACTUAL—CFM [L/s]	6400 [3020]	6600 [3114]	6800 [3209]	7000 [3303]	7200 [3398]	7400 [3492]	7600 [3586]	7800 [3681]	8000 [3775]	8200 [3869]	8400 [3964]	8600 [4058]	8800 [4153]	9000 [4247]	9200 [4341]	9400 [4436]	9600 [4530]
TOTAL MBH	0.97	0.97	0.98	0.98	0.99	0.99	1.00	1.00	1.01	1.01	1.02	1.02	1.03	1.03	1.03	1.04	1.04
SENSIBLE MBH	0.88	0.90	0.92	0.94	0.96	0.97	0.99	1.01	1.03	1.05	1.07	1.09	1.10	1.12	1.14	1.16	1.18
POWER kW	0.98	0.99	0.99	0.99	0.99	1.00	1.00	1.00	1.00	1.01	1.01	1.01	1.01	1.01	1.02	1.02	1.02

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions

# AIRFLOW PERFORMANCE — 25 TON [87.9 kW]—SIDEFLOW

Air Flow CFM [L/s]		Capacity 25 Tons [87.9 kW]																																								
		External Static Pressure—Inches of Water [kPa]																																								
0.1 [0.02]		0.2 [0.05]		0.3 [0.07]		0.4 [0.10]		0.5 [0.12]		0.6 [0.15]		0.7 [0.17]		0.8 [0.20]		0.9 [0.22]		1.0 [0.25]		1.1 [0.27]		1.2 [0.30]		1.3 [0.32]		1.4 [0.35]		1.5 [0.37]		1.6 [0.40]		1.7 [0.42]		1.8 [0.45]		1.9 [0.47]		2.0 [0.50]				
RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	RPM	W	
8000 [3775]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
8200 [3869]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
8400 [3964]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
8600 [4058]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
8800 [4153]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
9000 [4247]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
9200 [4341]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
9400 [4436]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
9600 [4530]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
9800 [4624]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
10000 [4719]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
10200 [4813]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
10400 [4908]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
10600 [5002]	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
10800 [5096]	789	5736	807	5960	826	6186	845	6416	863	6648	881	6883	899	7121	916	7362	934	7606	951	7853	968	8103	985	8355	1001	8611	980	7914	996	8161	1013	8410	1029	8662	1045	8917	1061	9175	—	—	—	—
11000 [5191]	801	6031	820	6261	839	6494	857	6729	875	6967	893	7209	910	7453	928	7700	945	7950	962	8203	979	8458	996	8717	1012	8979	1029	9243	1045	9511	1061	9781	—	—	—	—	—	—	—	—	—	
11200 [5285]	814	6340	833	6575	851	6814	869	7056	887	7300	905	7547	923	7797	940	8051	957	8307	974	8566	991	8827	1007	9092	1024	9360	1040	9630	1056	9904	1071	10180	—	—	—	—	—	—	—	—	—	
11400 [5379]	827	6661	846	6903	864	7148	882	7395	900	7646	917	7899	935	8155	952	8414	969	8677	986	8942	1002	9209	1019	9480	1035	9754	1051	10031	1067	10310	—	—	—	—	—	—	—	—	—	—	—	
11600 [5474]	841	6996	859	7244	877	7494	895	7748	912	8004	930	8264	947	8526	964	8791	981	9060	998	9331	1014	9605	1030	9881	1046	10161	1062	10444	—	—	—	—	—	—	—	—	—	—	—	—	—	
11800 [5568]	854	7343	872	7597	890	7854	908	8114	925	8376	943	8642	960	8910	977	9181	993	9456	1010	9733	1026	10013	1042	10296	1058	10582	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
12000 [5663]	868	7704	886	7964	903	8227	921	8493	938	8761	955	9033	972	9307	989	9585	1006	9865	1022	10148	1038	10434	1054	10723	1070	11015	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

NOTE: L-Drive left of bold line, M-Drive right of bold line.

Drive Package		R										S									
Motor H.P. [W]		7.5 [5592.7]										10 [7457.0]									
Blower Sheave		BK130H										BK120H									
Motor Sheave		1VP-71										1VP-75									
Turns Open		1	2	3	4	5	6	7	8	9	10	1	2	3	4	5	6	7	8	9	10
RPM		922	894	870	843	818	791	764	737	710	683	1067	1041	1010	987	954	929	902	875	848	821

- NOTES: 1. Factory sheave settings are shown in bold type.  
2. Do not set motor sheave below minimum turns open shown.  
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.  
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

## [ ] Designates Metric Conversions

COMPONENT AIR RESISTANCE—25 TON [87.9 kW]

CFM [L/s]	8000	8400	8800	9200	9600	10000	10400	10800	11200	11600	12000
	[3775]	[3964]	[4153]	[4341]	[4530]	[4719]	[4908]	[5096]	[5285]	[5474]	[5663]
Resistance — Inches of Water [kPa]											
Wet Coil	0.07 [.02]	0.09 [.02]	0.10 [.02]	0.12 [.03]	0.13 [.03]	0.15 [.04]	0.16 [.04]	0.18 [.04]	0.19 [.05]	0.21 [.05]	0.22 [.05]
Downflow	0.12 [.03]	0.14 [.03]	0.16 [.04]	0.19 [.05]	0.22 [.05]	0.25 [.06]	0.29 [.07]	0.33 [.08]	0.37 [.09]	0.42 [.10]	0.46 [.11]
Downflow Economizer	0.22 [.05]	0.24 [.06]	0.26 [.06]	0.28 [.07]	0.30 [.07]	0.32 [.08]	0.34 [.08]	0.37 [.09]	0.39 [.10]	0.41 [.10]	0.44 [.11]
R.A. Damper Open	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]
Horizontal Economizer	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]
R.A. Damper Open	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]
Concentric Grill RXRN-AD88 & Transition RXMC-CL09	0.17 [.04]	0.23 [.06]	0.30 [.07]	0.36 [.09]	0.43 [.11]	0.50 [.12]	0.56 [.14]	0.63 [.16]	0.69 [.17]	0.76 [.19]	0.82 [.20]
Pressure Drop MERV 8	0.132 [.03]	0.14 [.03]	0.148 [.04]	0.156 [.04]	0.164 [.04]	0.172 [.04]	0.18 [.04]	0.188 [.05]	0.196 [.05]	0.204 [.05]	0.212 [.05]
Pressure Drop MERV 13	0.108 [.03]	0.12 [.03]	0.132 [.03]	0.145 [.04]	0.157 [.04]	0.169 [.04]	0.182 [.04]	0.194 [.05]	0.206 [.05]	0.219 [.05]	0.231 [.06]

AIRFLOW CORRECTION FACTORS—25 TON [87.9 kW]

ACTUAL—CFM [L/s]	8000 [3775]	8400 [3964]	8800 [4153]	9200 [4341]	9600 [4530]	10000 [4719]	10400 [4908]	10800 [5096]	11200 [5285]	11600 [5474]	12000 [5663]
TOTAL MBTUH	0.97	0.98	0.99	0.99	1.00	1.01	1.02	1.03	1.03	1.04	1.05
SENSIBLE MBTUH	0.89	0.92	0.95	0.98	1.01	1.04	1.08	1.11	1.14	1.17	1.20
POWER kW	0.99	0.99	1.00	1.00	1.00	1.01	1.01	1.01	1.02	1.02	1.02

NOTES: Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions



ELECTRICAL DATA – RLNL- SERIES							
		G180CR	G180CS	G180DR	G180DS	G240CR	G240CS
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	187-253	187-253
	Volts	208/230	208/230	460	460	208/230	208/230
	Minimum Circuit Ampacity	78/78	81/81	38	40	101/101	109/109
	Minimum Overcurrent Protection Device Size	90/90	90/90	45	45	110/110	125/125
	Maximum Overcurrent Protection Device Size	100/100	100/100	45	50	125/125	125/125
Compressor Motor	No.	2	2	2	2	2	2
	Volts	200/230	200/230	460	460	200/230	200/230
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7	7	7	7	10	10
	Amps (RLA), Comp. 1	25/25	25/25	12.2	12.2	33.3/33.3	33.3/33.3
	Amps (LRA), Comp. 1	164/164	164/164	100	100	239/239	239/239
	HP, Compressor 2	7	7	7	7	7 1/2	7 1/2
	Amps (RLA), Comp. 2	25/25	25/25	12.2	12.2	29.5/29.5	29.5/29.5
	Amps (LRA), Comp. 2	164/164	164/164	100	100	195/195	195/195
Condenser Motor	No.	4	4	4	4	6	6
	Volts	208/230	208/230	460	460	208/230	208/230
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	2.4/2.4	2.4/2.4
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4	4.7/4.7	4.7/4.7
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	208/230	208/230
	Phase	3	3	3	3	3	3
	HP	3	5	3	5	5	7 1/2
	Amps (FLA, each)	11.5/11.5	14.9/14.9	4.6	6.6	14.7/14.7	23.1/23.1
	Amps (LRA, each)	74.5/74.5	82.6/82.6	38.1	46.3	82.6/82.6	136/136

ELECTRICAL DATA – RLNL- SERIES							
		G240DR	G240DS	G300CR	G300CS	G300DR	G300DS
Unit Information	Unit Operating Voltage Range	414-506	414-506	187-253	187-253	414-506	414-506
	Volts	460	460	208/230	208/230	460	460
	Minimum Circuit Ampacity	52	56	147/147	149/149	60	63
	Minimum Overcurrent Protection Device Size	60	60	175/175	175/175	70	70
	Maximum Overcurrent Protection Device Size	60	70	175/175	175/175	70	80
Compressor Motor	No.	2	2	2	2	2	2
	Volts	460	460	200/240	200/240	460	460
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 1	17.9	17.9	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 1	125	125	245/245	245/245	125	125
	HP, Compressor 2	7 1/2	7 1/2	11 1/2	11 1/2	11 1/2	11 1/2
	Amps (RLA), Comp. 2	14.7	14.7	48.1/48.1	48.1/48.1	18.6	18.6
	Amps (LRA), Comp. 2	95	95	245/245	245/245	125	125
Condenser Motor	No.	6	6	6	6	6	6
	Volts	460	460	208/230	208/230	460	460
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	1.4	1.4	2.4/2.4	2/2	1.4	1.4
	Amps (LRA, each)	2.4	2.4	4.7/4.7	3.9/3.9	2.4	2.4
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	460	460	208/230	208/230	460	460
	Phase	3	3	3	3	3	3
	HP	5	7 1/2	7 1/2	10	7 1/2	10
	Amps (FLA, each)	6.6	9.6	24.2/24.2	28.5/28.5	9.6	12.5
	Amps (LRA, each)	46.3	67	136/136	178/178	67	74.6

208/240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION													
Single Power Supply for Both Unit and Heater Kit							Separate Power Supply for Both Unit and Heater Kit						
Model No. RLNL-	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240V	Heater kBTU/Hr @ 208/240V	Heater Amps @ 208/240V	Air Conditioner			Heater Kit		Air Conditioner		
						Unit Min. Ckt. Ampacity @ 208/240V	Over Current Protective Device Size		Min. Ckt. Ampacity 208/240V	Max. Fuse Size 208/240V	Min. Circuit Ampacity 208/240V	Over Current Protective Device Size	
							Min./Max. 208V	Min./Max. 240V				Min./Max. 208V	Min./Max. 240V
G180CR	No Heat	—	—	—	—	78/78	90/100	90/100	—	—	78/78	90/100	90/100
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	78/78	90/100	90/100	50/58	50/60	—	—	—
	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	115/130	125/125	150/150	100/116	100/125	—	—	—
	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	165/188	175/175	200/200	150/173	150/175	—	—	—
G240CR	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	202/231	225/225	250/250	188/217	200/225	—	—	—
	No Heat	—	—	—	—	101/101	110/125	110/125	—	—	101/101	110/125	110/125
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	101/101	110/125	110/125	50/58	50/60	—	—	—
	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	119/134	125/125	150/150	100/116	100/125	—	—	—
G300CR	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	169/192	175/175	200/200	150/173	150/175	—	—	—
	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	206/235	225/225	250/250	188/217	200/225	—	—	—
	No Heat	—	—	—	—	147/147	175/175	175/175	—	—	147/147	175/175	175/175
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	147/147	175/175	175/175	50/58	50/60	—	—	—
G180CS	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	147/147	175/175	175/175	100/116	100/125	—	—	—
	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	181/204	200/200	225/225	150/173	150/175	—	—	—
	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	218/247	225/225	250/250	188/217	200/225	—	—	—
	No Heat	—	—	—	—	81/81	90/100	90/100	—	—	81/81	90/100	90/100
G240CS	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	81/81	90/100	90/100	50/58	50/60	—	—	—
	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	119/134	125/125	150/150	100/116	100/125	—	—	—
	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	169/192	175/175	200/200	150/173	150/175	—	—	—
	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	206/235	225/225	250/250	188/217	200/225	—	—	—
G300CS	No Heat	—	—	—	—	109/109	125/125	125/125	—	—	109/109	125/125	125/125
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	109/109	125/125	125/125	50/58	50/60	—	—	—
	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	129/145	150/150	150/150	100/116	100/125	—	—	—
	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	179/202	200/200	225/225	150/173	150/175	—	—	—
G240CT	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	217/245	225/225	250/250	188/217	200/225	—	—	—
	No Heat	—	—	—	—	149/149	175/175	175/175	—	—	149/149	175/175	175/175
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	149/149	175/175	175/175	50/58	50/60	—	—	—
	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	149/151	175/175	175/175	100/116	100/125	—	—	—
G300CT	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	186/209	200/200	225/225	150/173	150/175	—	—	—
	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	223/252	225/225	300/300	188/217	200/225	—	—	—
	No Heat	—	—	—	—	109/109	125/125	125/125	—	—	109/109	125/125	125/125
	CE20C	1	14.4/19.2	49.13/65.5	40/46.2	109/109	125/125	125/125	50/58	50/60	—	—	—
G240CT	CE40C	2	28.8/38.3	98.25/130.66	79.9/92.2	129/145	150/150	150/150	100/116	100/125	—	—	—
	CE60C	2	43.2/57.5	147.38/196.16	119.9/138.3	179/202	200/200	225/225	150/173	150/175	—	—	—
	CE75C	2	54/71.9	184.22/245.29	149.8/172.8	217/245	225/225	250/250	188/217	200/225	—	—	—
	No Heat	—	—	—	—	109/109	125/125	125/125	—	—	109/109	125/125	125/125


\* = For Canadian use only. Uses "P" fuses for inductive circuit.

+ = Field installed only.

480 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION													
Single Power Supply for Both Unit and Heater Kit							Separate Power Supply for Both Unit and Heater Kit						
Model No. RLNL-	Heater Kit			Air Conditioner				Heater Kit			Air Conditioner		
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 480V	Heater kBtu/Hr @ 480V	Heater Amps @ 480V	Unit Min. Ckt. Ampacity @ 480V	Over Current Protective Device Size		Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Circuit Ampacity 480V	Over Current Protective Device Size	
							Min./Max. 480V	Min./Max. 480V				Min./Max. 480V	Min./Max. 480V
G180DR	No Heat	—	—	—	—	38	45/45	—	—	—	38	45/45	—
	CE20D	1	19.2	65.5	23.1	38	45/45	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	64	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	93	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	114	125/125	109	—	110	—	—	—
G240DR	No Heat	—	—	—	—	52	60/60	—	—	—	52	60/60	—
	CE20D	1	19.2	65.5	23.1	52	60/60	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	67	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	95	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	117	125/125	109	—	110	—	—	—
G300DR	No Heat	—	—	—	—	60	70/70	—	—	—	60	70/70	—
	CE20D	1	19.2	65.5	23.1	60	70/70	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	70	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	99	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	121	125/125	109	—	110	—	—	—
G180DS	No Heat	—	—	—	—	40	45/50	—	—	—	40	45/50	—
	CE20D	1	19.2	65.5	23.1	40	45/50	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	67	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	95	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	117	125/125	109	—	110	—	—	—
G240DS	No Heat	—	—	—	—	56	60/70	—	—	—	56	60/70	—
	CE20D	1	19.2	65.5	23.1	56	60/70	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	70	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	99	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	121	125/125	109	—	110	—	—	—
G300DS	No Heat	—	—	—	—	63	70/80	—	—	—	63	70/80	—
	CE20D	1	19.2	65.5	23.1	63	70/80	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	74	80/80	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	103	110/110	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	124	125/125	109	—	110	—	—	—
G240DT	No Heat	—	—	—	—	56	60/70	—	—	—	56	60/70	—
	CE20D	1	19.2	65.5	23.1	56	60/70	29	—	30	—	—	—
	CE40D	2	38.4	131	46.2	70	70/70	58	—	60	—	—	—
	CE60D	2	57.6	196.5	69.3	99	100/100	87	—	90	—	—	—
	CE75D	2	72	245.63	86.6	121	125/125	109	—	110	—	—	—

\*= For Canadian use only. Uses "P" fuses for inductive circuit.  
+ = Field installed only.

Illustration  
ST-A1125-01B

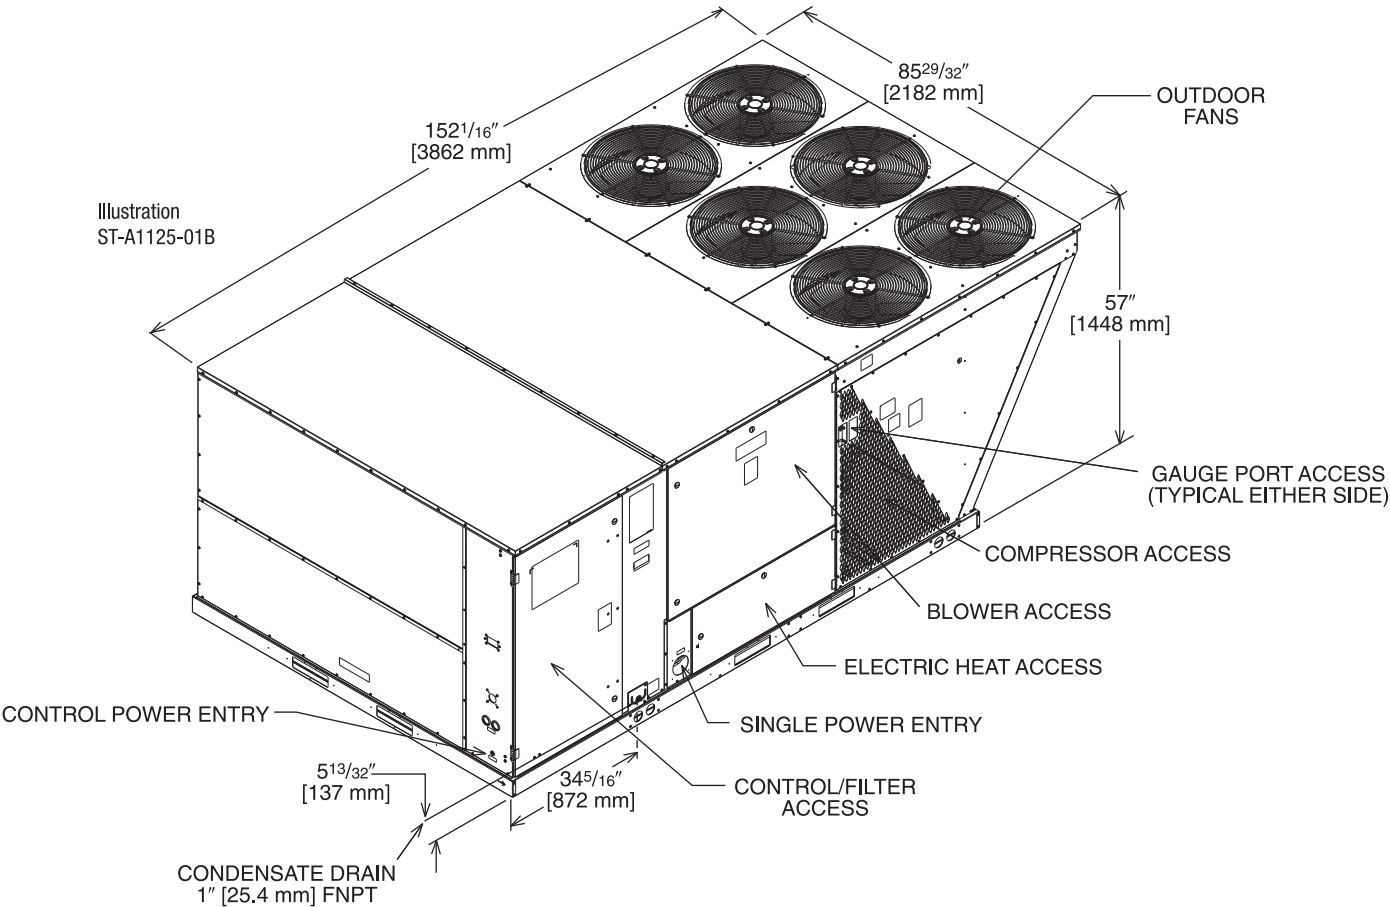

**BOTTOM VIEW**



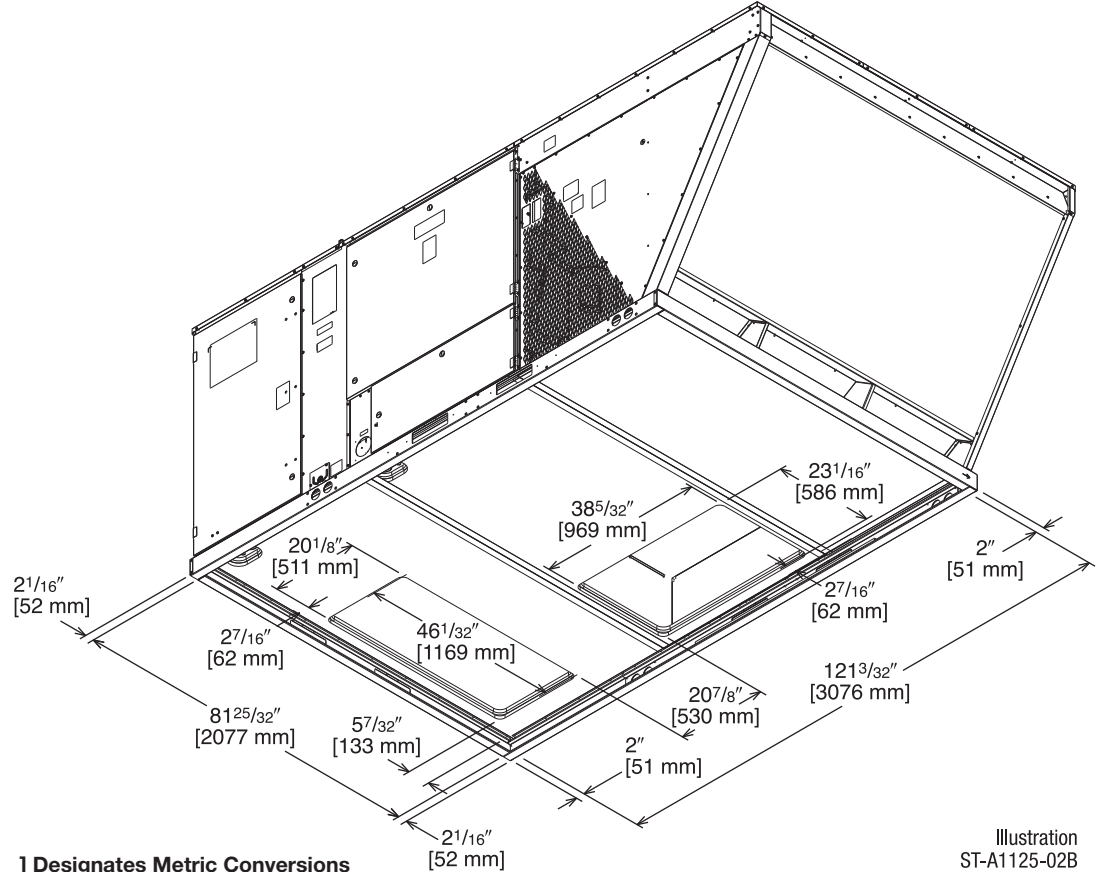


Illustration  
ST-A1125-02B

[ ] Designates Metric Conversions



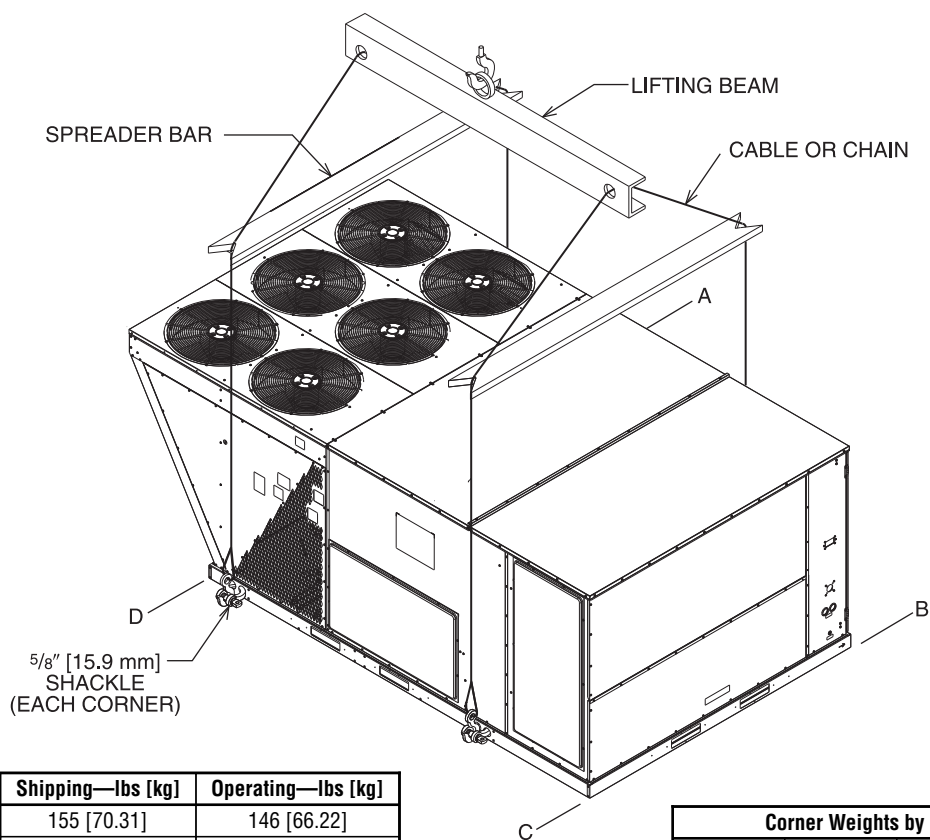

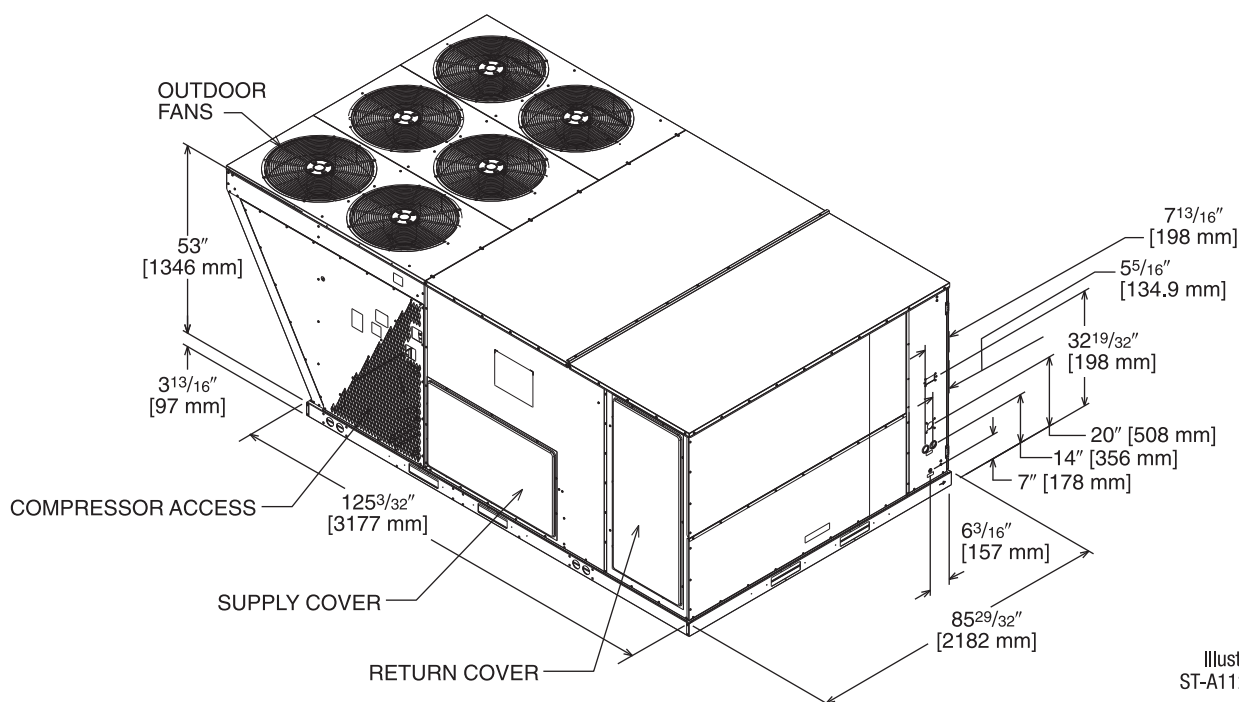

## WEIGHTS


Accessory	Shipping—lbs [kg]	Operating—lbs [kg]
Economizer—Downflow	155 [70.31]	146 [66.22]
Economizer—Horizontal	165 [74.84]	155 [70.31]
Power Exhaust	44 [19.96]	42 [19.05]
Fresh Air Damper (Manual)	51 [23.13]	40 [18.14]
Fresh Air Damper (Motorized)	46 [20.87]	35 [15.88]
Roof Curb 14"	170 [77.11]	164 [74.39]

Corner Weights by Percentage			
A	B	C	D
32%	27%	16%	24%

\*Note: Corner weights measured at base of unit.


[ ] Designates Metric Conversions

SLAB INSTALLATION

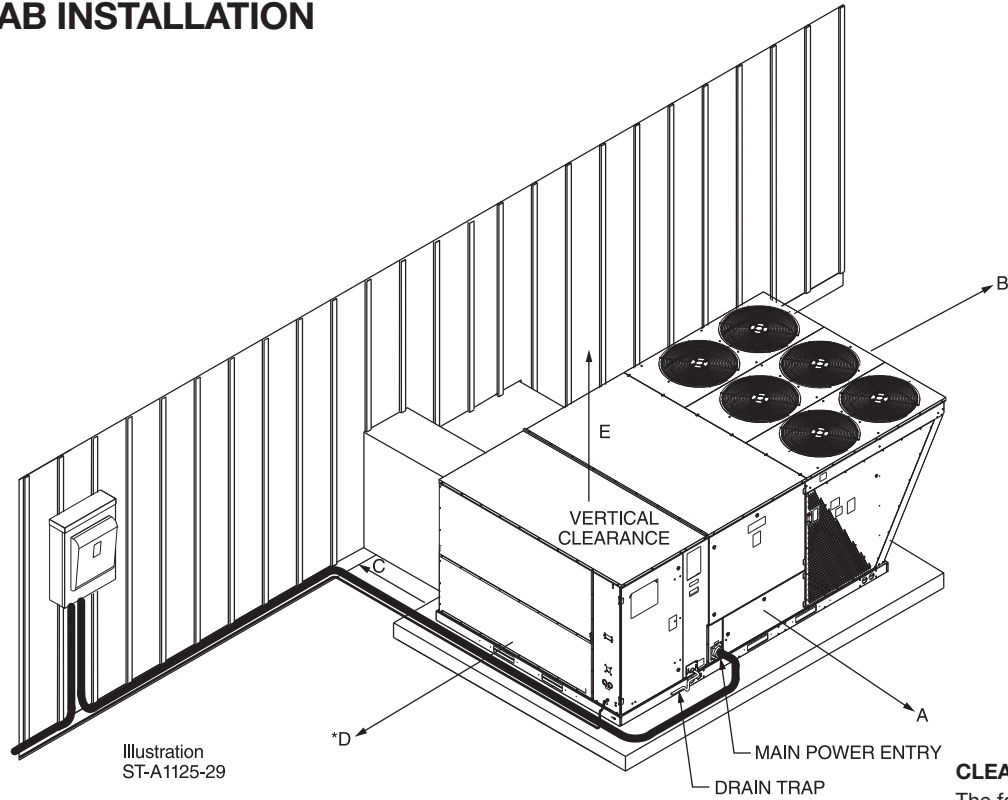

CLEARANCES

The following minimum clearances are recommended for proper unit performance and serviceability.

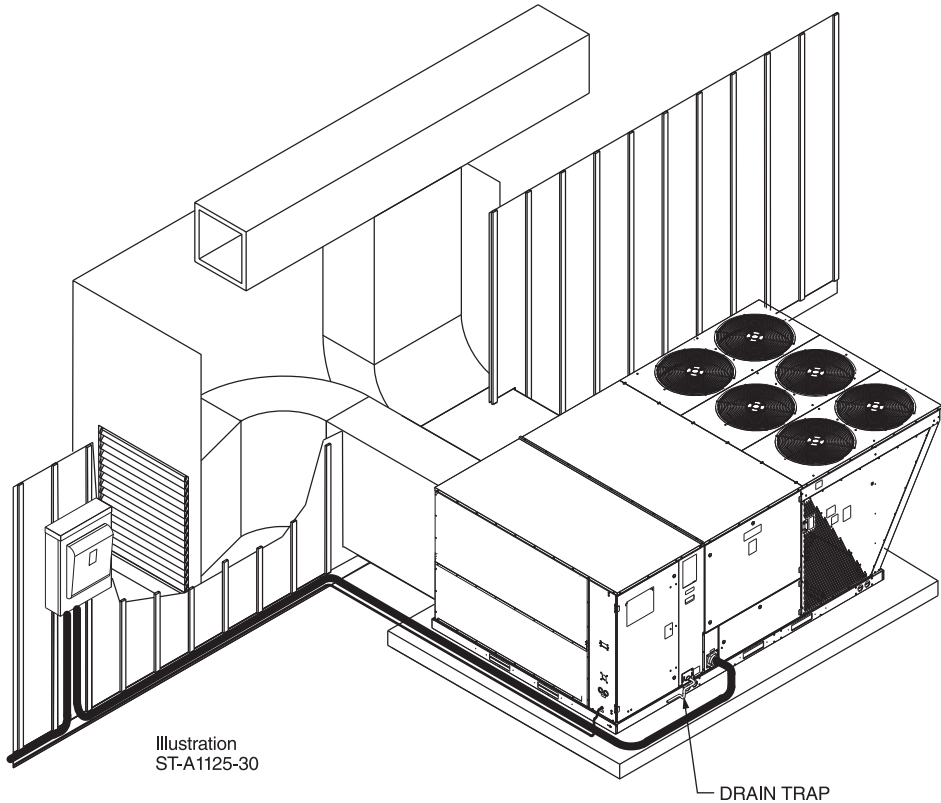

Recommended Clearance In. [mm]	Location
80 [2032]	A - Front
18 [457]	B - Condenser Coil
18 [457]	+C - Duct Side
18 [457]	*D - Evaporator End
60 [1524]	E - Above
*Without Economizer 18" [457 mm]. With Economizer 48" [1219 mm]. +Without Horizontal Economizer 18" [457 mm]. With Horizontal Economizer 42" [1067 mm].	

[ ] Designates Metric Conversions

**FIELD INSTALLED ACCESSORY EQUIPMENT—SELF CONTAINED AIR CONDITIONER**

Accessory	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Electric Heaters	RXJJ-CE20 (C, D, Y)	41 [18.6]	31 [14.1]	Yes
	RXJJ-CE40 (C, D, Y)	44 [20.0]	34 [15.4]	Yes
	RXJJ-CE60 (C, D, Y)	45 [20.4]	35 [15.9]	Yes
	RXJJ-CE75 (C, D, Y)	46 [20.8]	36 [16.3]	Yes
Downflow Economizer w/Single Enthalpy (DDC)	AXRD-01RGDAM3	277 [125.6]	168 [76.2]	Yes
Downflow Economizer w/Smoke Detector (DDC)	AXRD-01RGDBM3	280 [127.0]	171 [77.6]	Yes
Dual Enthalpy Kit	RXXR-AV04	1 [.5]	.5 [0.2]	No
Horizontal Economizer w/Single Enthalpy (DDC)	AXRD-01RGHAM3	333 [151.0]	301 [36.5]	No
Carbon Dioxide Sensor (Wall Mount)	RXXR-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust (208/230V)	RXXR-BGF05C	119 [54.0]	59 [26.8]	No
Power Exhaust (460V)	RXXR-BGF05D	119 [54.0]	59 [26.8]	No
Manual Fresh Air Damper*	AXRF-KFA1	61 [27.7]	52 [23.6]	No
Motorized Kit for Manual Fresh Air Damper*	RXXR-AW03	42 [19.1]	35 [15.9]	No
Modulating Motor Kit w/position feedback for RXRF-KFA1	RXXR-AW05	45 [20.4]	38 [17.2]	No
Roofcurb, 14"	RXKG-CBH14	184 [83.5]	176 [79.8]	No
Roofcurb Adapter to RXRK-E56	RXXR-CJCE56	465 [210.9]	415 [88.2]	No
Roofcurb Adapter to RXKG-CAF14	RXXR-CJCF14	555 [251.7]	505 [29.1]	No
Concentric Diffuser (Step-Down, 18" x 36")	RXRN-AD81	310 [140.6]	157 [71.2]	No
Concentric Diffuser (Step-Down, 24" x 48")	RXRN-AD86	367 [166.5]	212 [96.2]	No
Concentric Diffuser (Step-Down, 28" x 60")	RXRN-AD88	410 [186.0]	370 [67.8]	No
Concentric Diffuser (Flush, 18" x 36")	RXRN-AD80	213 [96.6]	115 [52.2]	No
Downflow Transition (Rect. to Rect., 18" x 36")	RXMC-CJ07	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. to Rect., 24" x 48")	RXMC-CK08	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. to Rect., 28" x 60")	RXMC-CL09	81 [36.7]	74 [33.6]	No
Low-Ambient Control Kit (1 Per Compressor)	RXRZ-C02	3 [1.4]	2 [0.9]	Yes
Unwired Convenience Outlet	RXXR-AN01	2 [0.9]	1.5 [.7]	Yes
Unfused Service Disconnect+	RXXR-AP01	10 [4.5]	9 [4.1]	Yes
Comfort Alert (1 per Compressor)	RXXR-AZ01	3 [1.4]	2 [0.9]	Yes
BACnet Communication Card	RXXR-AY01	1 [0.5]	1 [0.5]	No
LonWorks Communication Card	RXXR-AY02	1 [0.5]	1 [0.5]	No
Room Humidity Sensor	RHC-ZNS4	1 [0.5]+	1 [0.5]+	No*
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	1 [0.5]+	1 [0.5]+	No*
Hail Guard Louvers	AXRX-AAD01L	55 [24.8]	45 [20.3]	Yes
MERV 8 Filter	RXMF-M08A22520	2 [0.9]	1 [0.45]	No
MERV 13 Filter	RXMF-M13A22520	2 [0.9]	1 [0.45]	No

\*Motorized Kit and Manual Fresh Air Damper must be combined for a complete Motorized Outside Air Damper Selection.

[ ] Designates Metric Conversions

## FLUSH MOUNT ROOM TEMPERATURE SENSORS FOR NETWORKED DDC APPLICATIONS



### **ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON**

**RHC-ZNS1**

10k $\Omega$  room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



### **ROOM TEMPERATURE SENSOR with TIMED OVERRIDE BUTTON and STATUS INDICATOR**

**RHC-ZNS2**


10k $\Omega$  room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



### **ROOM TEMPERATURE SENSOR with SETPOINT ADJUSTMENT and TIMED OVERRIDE BUTTON**

**RHC-ZNS3**


10k $\Omega$  room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.

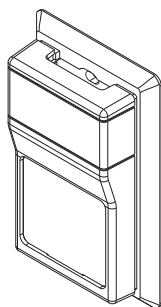

### **ROOM HUMIDITY SENSOR**

**RHC-ZNS4**

Transmits room relative humidity to DDC System.

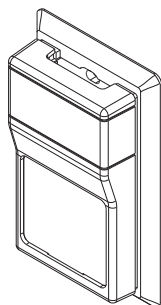

### **ROOM TEMPERATURE AND RELATIVE HUMIDITY SENSOR**

**RHC-ZNS5**

Transmits room temperature and relative humidity to DDC System.



## COMMUNICATION CARDS

### Field Installed



#### **BACnet® COMMUNICATION CARD    RXRX-AY01**

The field installed BACnet® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the BACnet Application Specific Controller device profile. The BACnet® Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network.



#### **LonWorks® COMMUNICATION CARD    RXRX-AY02**

The field installed LonWorks® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks Network.

## ECONOMIZERS—DOWNFLOW ONLY

### Field Installed

**AXRD-PMCM3—Single Enthalpy (Outdoor) with DDC**

**AXRD-SMCM3—Single Enthalpy (Outdoor) w/Smoke Detector and DDC**

**RXXR-AR02—Optional Wall-Mounted CO<sub>2</sub> Sensor**

**RXXR-AV03—Dual Enthalpy Upgrade Kit**

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin & 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer Application
- Economizer Ships Complete for Downflow Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS)

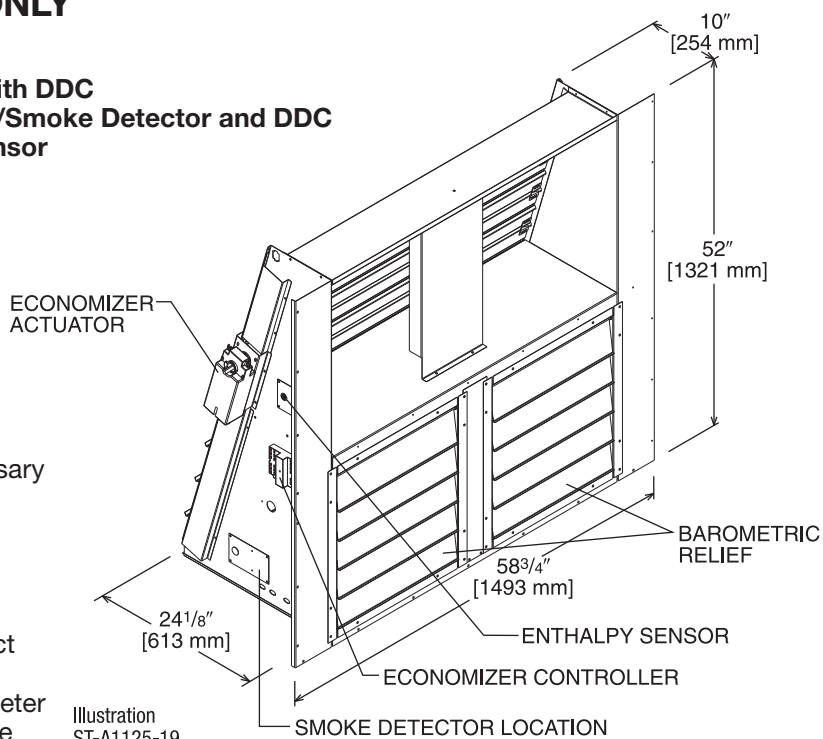


Illustration  
ST-A1125-19

TOLERANCE ± .125

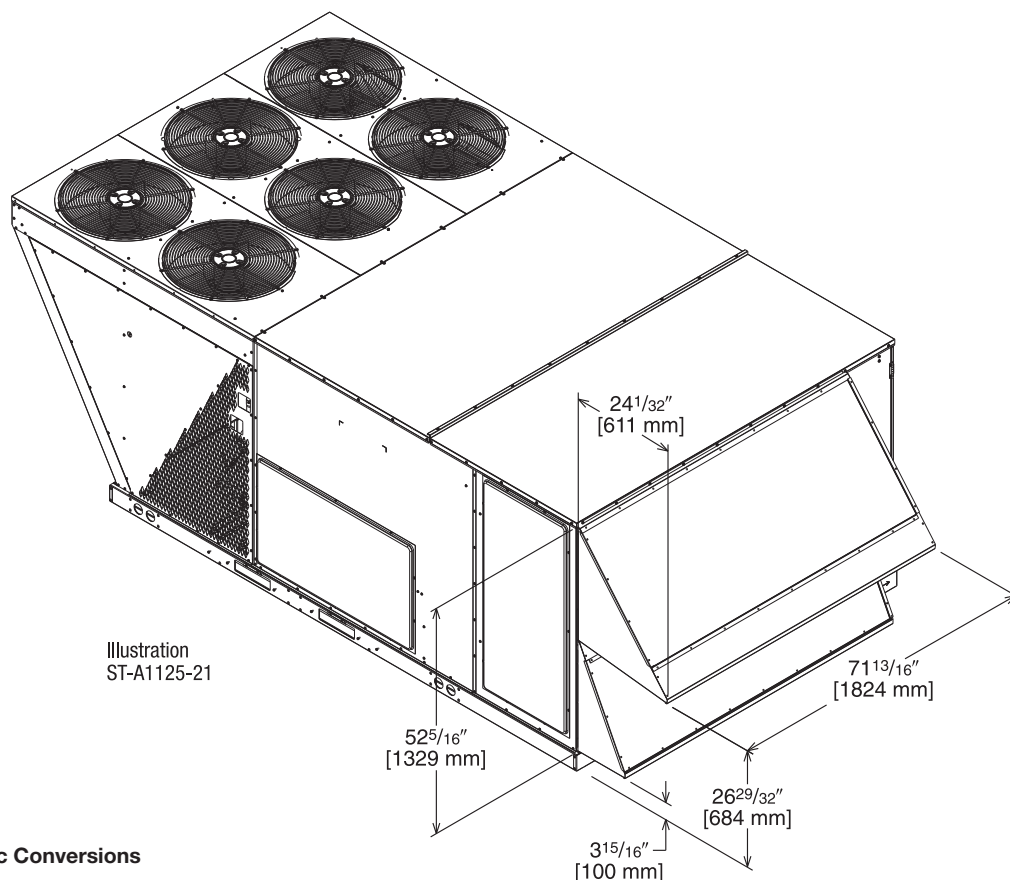


Illustration  
ST-A1125-21

[ ] Designates Metric Conversions

## ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION


### Field Installed Only

**AXRD-RMCM3—Single Enthalpy (Outdoor) with DDC**


**RXXR-AV03—Dual Enthalpy Upgrade Kit**

**RXXR-AR02—Optional Wall-Mounted CO<sub>2</sub> Sensor**

- Features **Honeywell** Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS) or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 character LCD screen

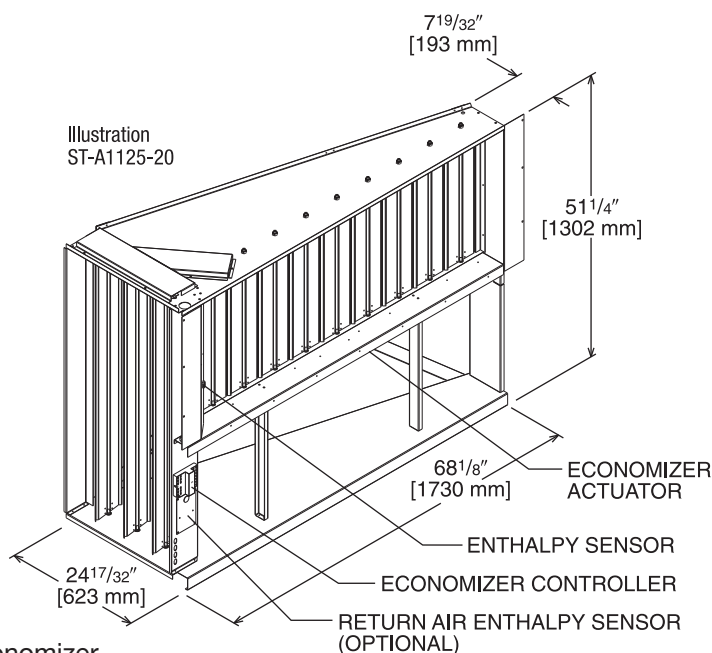

TOLERANCE  $\pm .125$

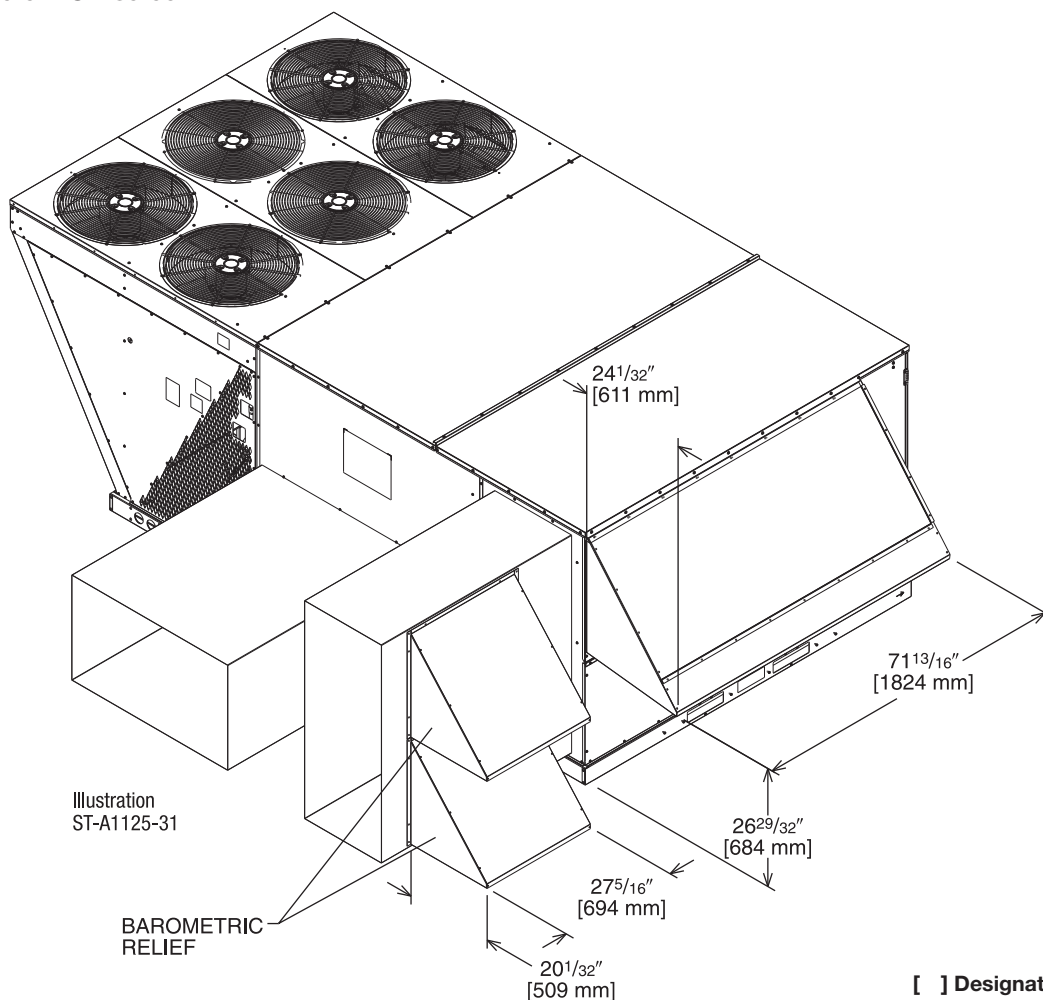


[ ] Designates Metric Conversions

INTEGRAL POWER EXHAUST KIT FOR AXRD-PMCM3  
OR SMCM3 ECONOMIZERS

RXRX-BGF05 (C or D)

\*Voltage Code

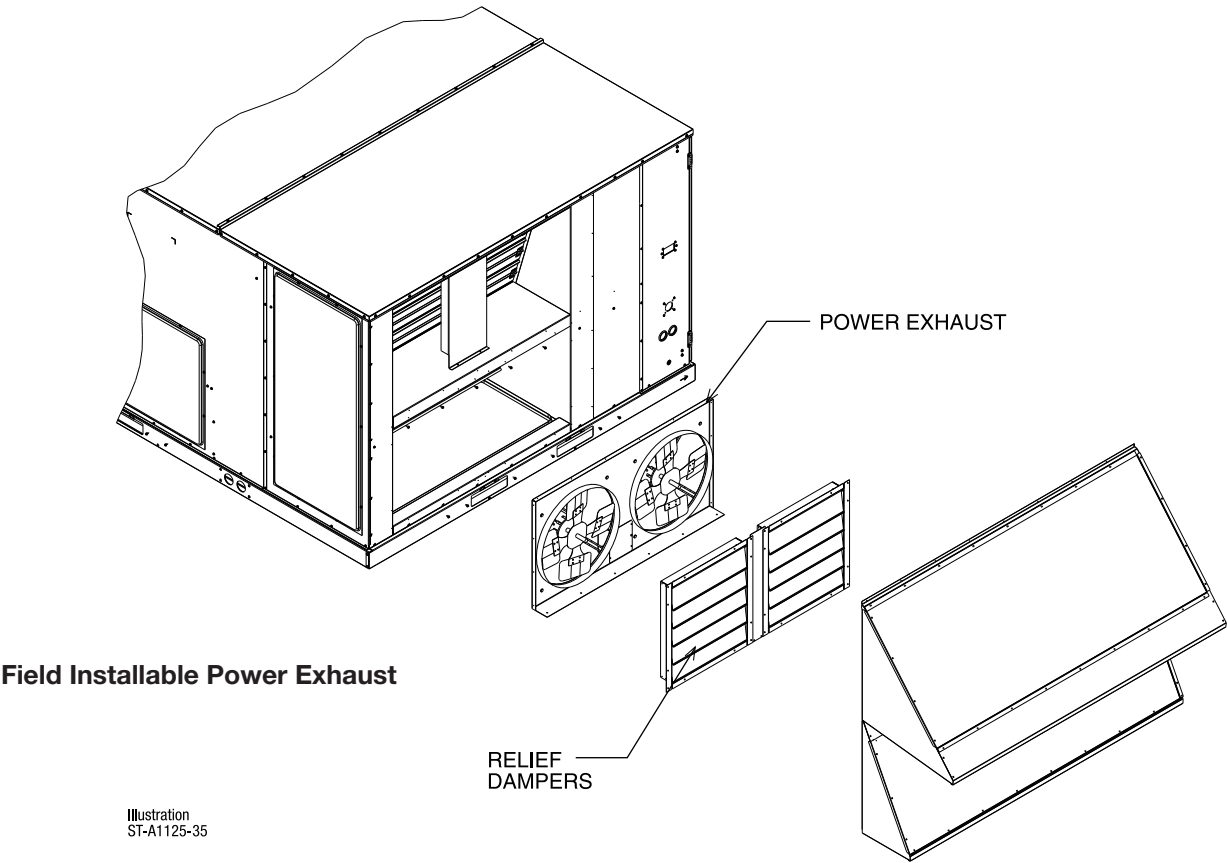

Field Installable Power Exhaust

Illustration  
ST-A1125-35

Model No.	No. of Fans	Volts	Phase	HP (ea.)	Low Speed		High Speed ①		FLA (ea.)	LRA (ea.)
					CFM [L/s] ②	RPM	CFM [L/s] ②	RPM		
RXRX-BGF05C	2	208-230	1	0.75	4100 [1935]	850	5200 [2454]	1050	5	4.97
RXRX-BGF05D	2	460	1	0.75	4100 [1935]	850	5200 [2454]	1050	2.2	3.4

NOTES: ① Power exhaust is factory set on high speed motor tap.  
② CFM is per fan at 0" w.c. external static pressure.

[ ] Designates Metric Conversions

## FRESH AIR DAMPER

### MOTORIZED DAMPER KIT

RXRX-AW03

(Motor Kit for AXRF-KFA1)

RXRX-AW05

(Modulating Motor Kit with position feedback for AXRF-KFA1)

- Features **Honeywell** Controls
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Addition of Dual Enthalpy Upgrade Kit allows limited economizer function
- CO<sub>2</sub> Sensor Input Available for Demand Control Ventilation (DCV)
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- All fresh air damper functions can be viewed at the RTU-C unit controller display
- If connected to a Building Automation System (BAS), all fresh air damper functions can be viewed on the (BAS), on 16 x 2 LCD screen
- If connected to thermostat, all fresh air damper functions can be viewed on 16 x 2 LCD screen

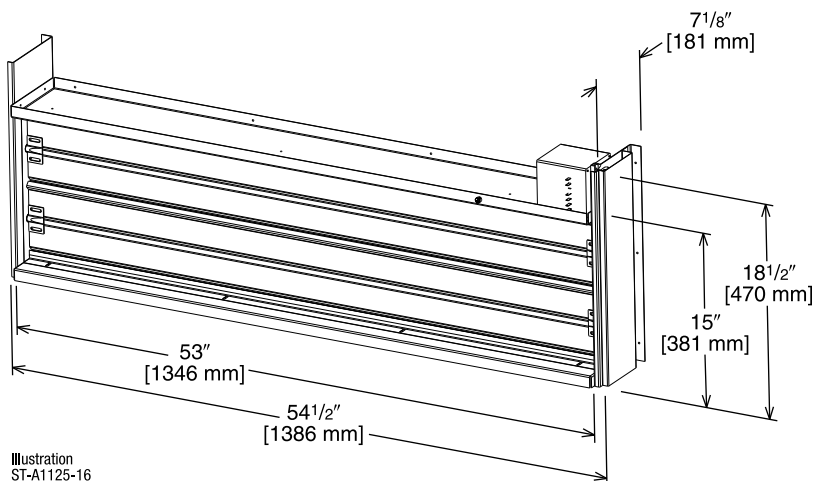


Illustration  
ST-A1125-16

AXRF-KFA1 (Manual)

RXRX-AW03 (Motorized damper kit for manual fresh air damper)

RXRX-AW05 (Modulating Motor Kit with position feedback for AXRF-KFA1)

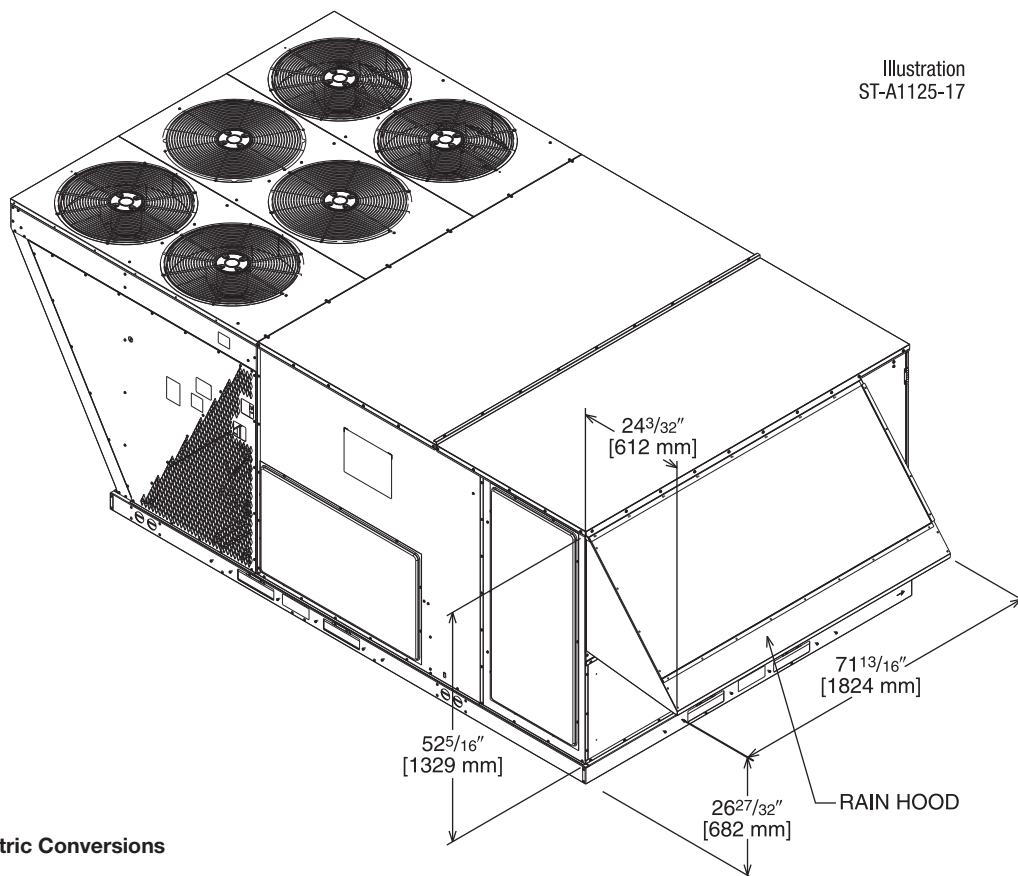


Illustration  
ST-A1125-17


[ ] Designates Metric Conversions




## ROOFCURBS (Full Perimeter)

- Ruud's roofcurb design can be utilized on 15, 20 and 25 ton [52.8, 70.3 and 87.9 kW] models.
- One available height (14" [356 mm]).
- Quick assembly corners for simple and fast assembly.
- 1" [25.4 mm] x 4" [102 mm] Nailers provided.
- Insulating panels not required because of insulated outdoor base pan.
- Sealing gasket (28" [711 mm]) provided with Roofcurb.
- Packaged for easy field assembly.

## TYPICAL INSTALLATION

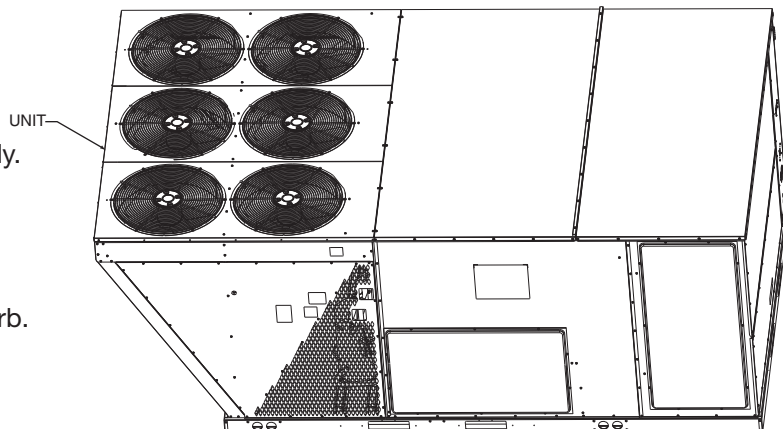

## ROOFCURB ASSEMBLY

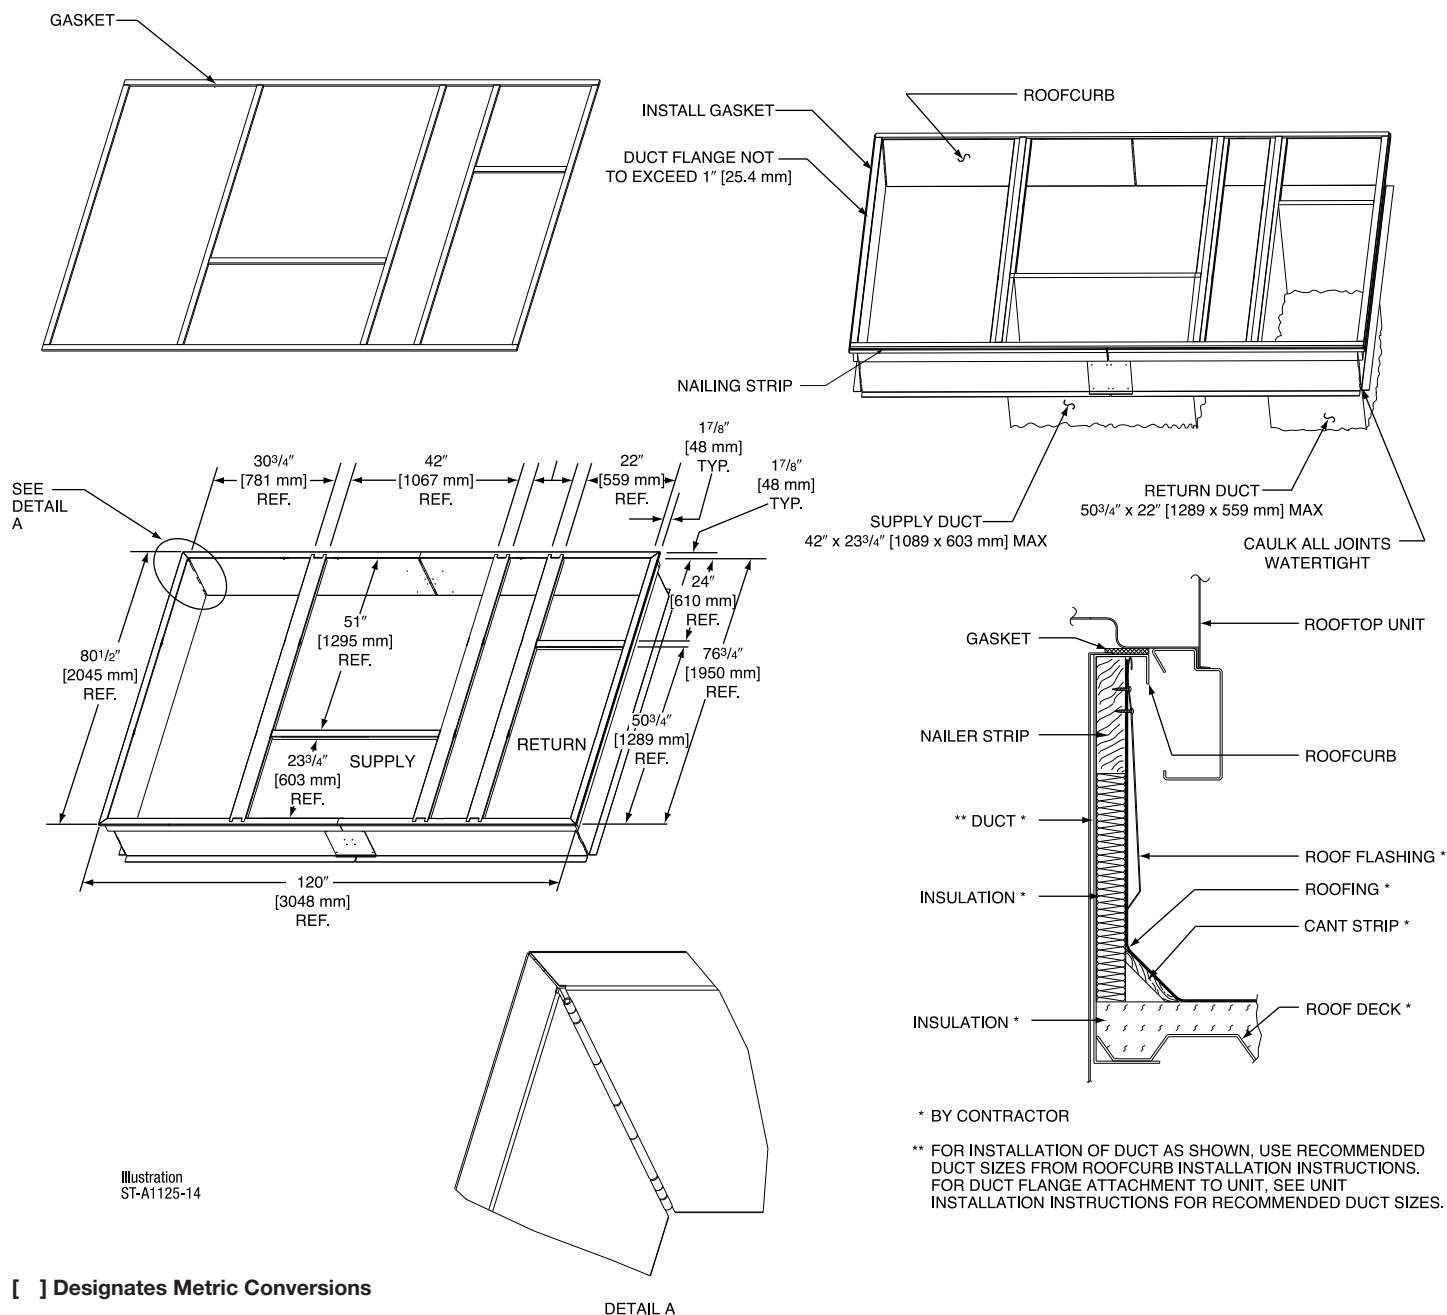

[ ] Designates Metric Conversions

**COMMERCIAL CABINET**  
**(12.5, 15 & 20 TON)**  
**([44, 52.8 & 70.3 kW])**  
 (-)RCF, (-)RGF, (-)REF

## RXRK-E56

## RXRX-CJCE56

RLNL-G  
(15, 20 & 25 TON)  
([52.8, 70.3 & 87.9 kW])



## RXKG-CAF14

## RXRX-CJCF14

RLNL-G  
(15, 20 & 25 TON)  
([52.8, 70.3 & 87.9 kW])



**[ ] Designates Metric Conversions**

## CONCENTRIC DIFFUSER APPLICATION

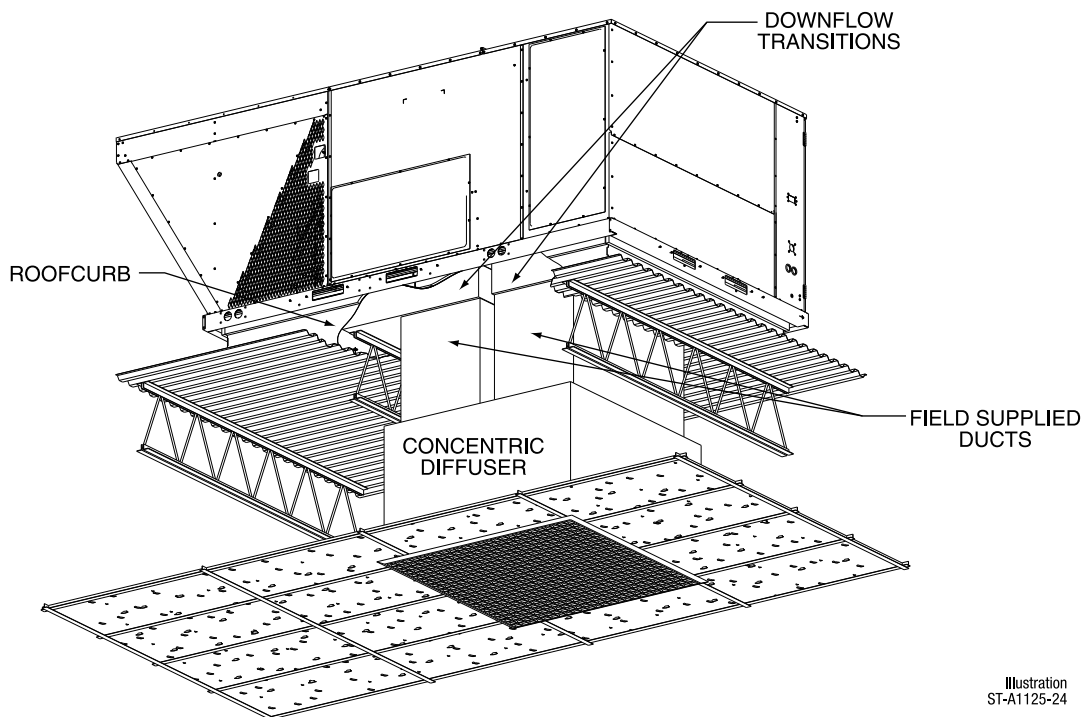


Illustration  
ST-A1125-24

## DOWNFLOW TRANSITION DRAWINGS

### RXMC-CJ07 (15 Ton) [52.8 kW]

- Used with RXRN-AD80 and RXRN-AD81 Concentric Diffusers

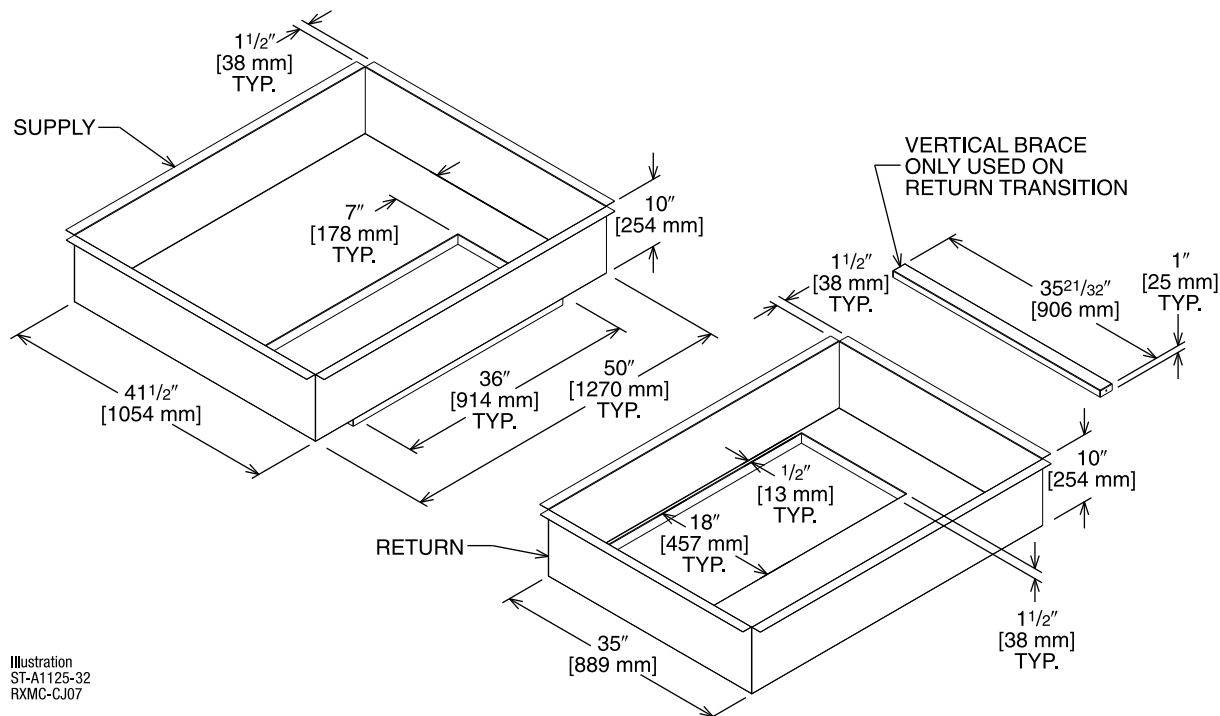



Illustration  
ST-A1125-32  
RXMC-CJ07

[ ] Designates Metric Conversions

## DOWNFLOW TRANSITION DRAWINGS (Cont.)


### RXMC-CK08 (20 Ton) [70.3 kW]

- Used with RXRN-AD86 Concentric Diffusers

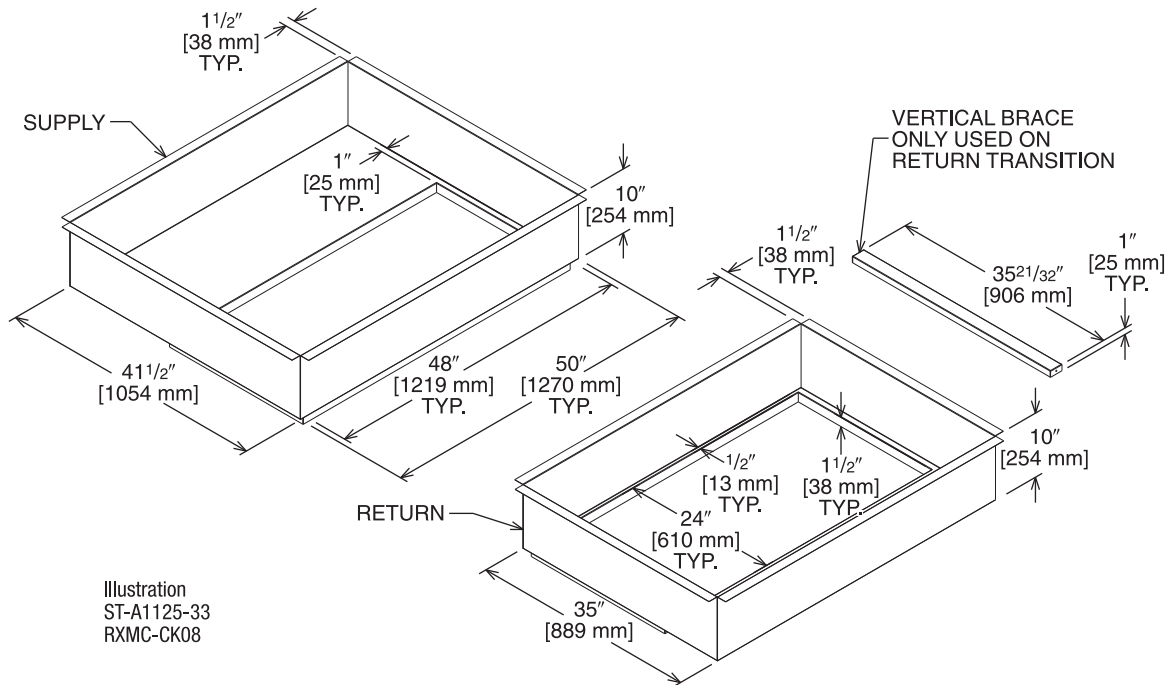

### RXMC-CL09 (25 Ton) [87.9 kW]



- Used with RXRN-AD88 Concentric Diffusers

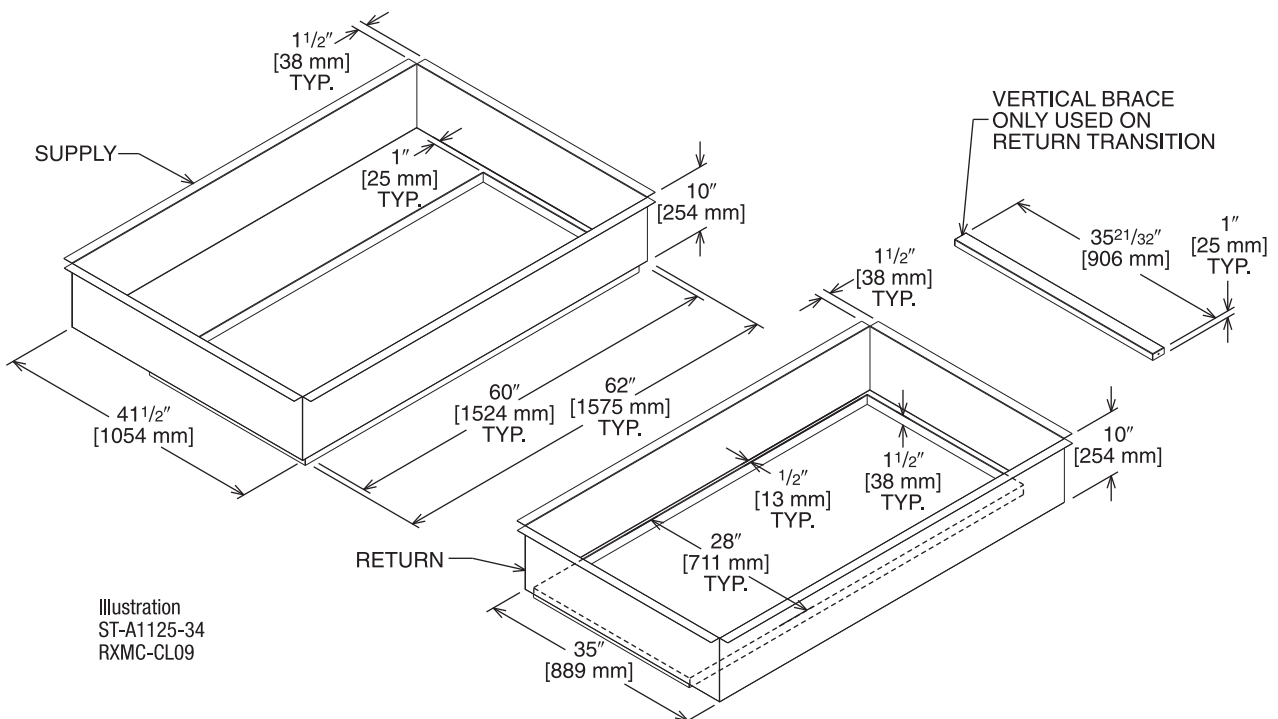

[ ] Designates Metric Conversions

CONCENTRIC DIFFUSER  
15 TON [52.8 kW] FLUSH

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

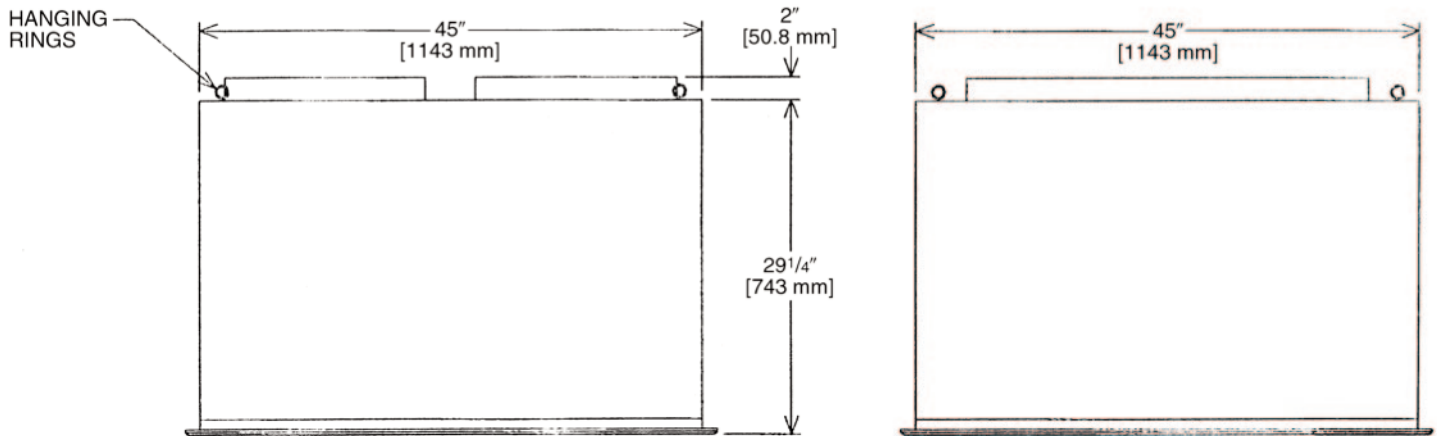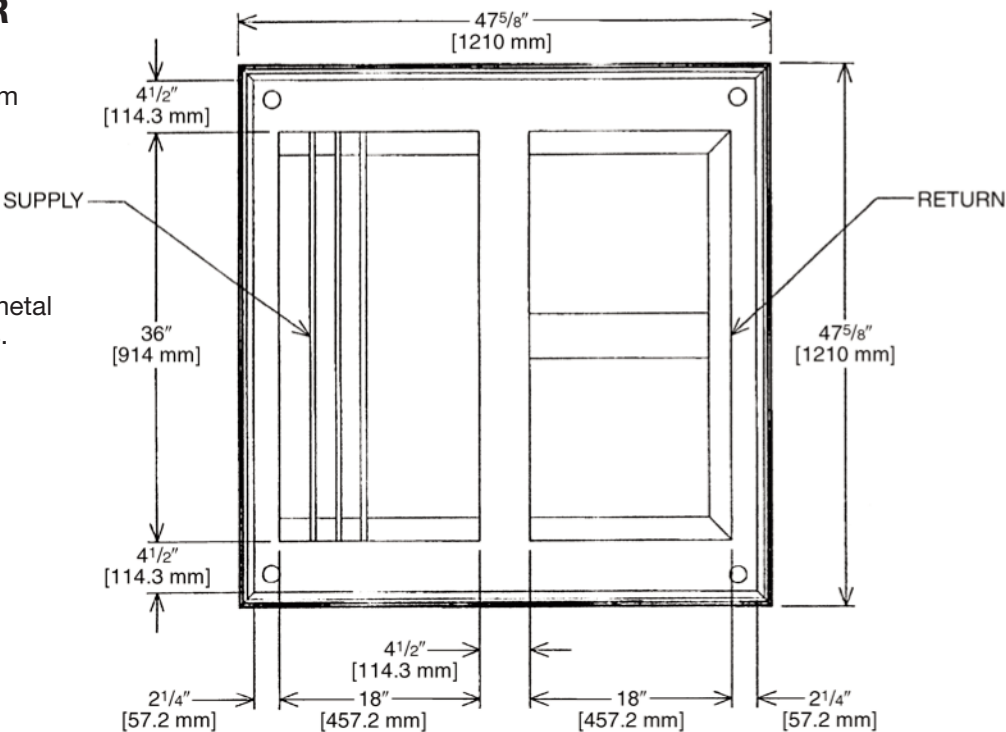

CONCENTRIC DIFFUSER SPECIFICATIONS



PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD80	5600 [2643]	0.36	28-37	1000	2082
	5800 [2737]	0.39	29-38	1036	2156
	6000 [2832]	0.42	40-50	1071	2230
	6200 [2926]	0.46	42-51	1107	2308
	6400 [3020]	0.50	43-52	1143	2379
	6600 [3115]	0.54	45-56	1179	2454

[ ] Designates Metric Conversions



## CONCENTRIC DIFFUSER 15 TON [52.8 kW] STEP DOWN

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

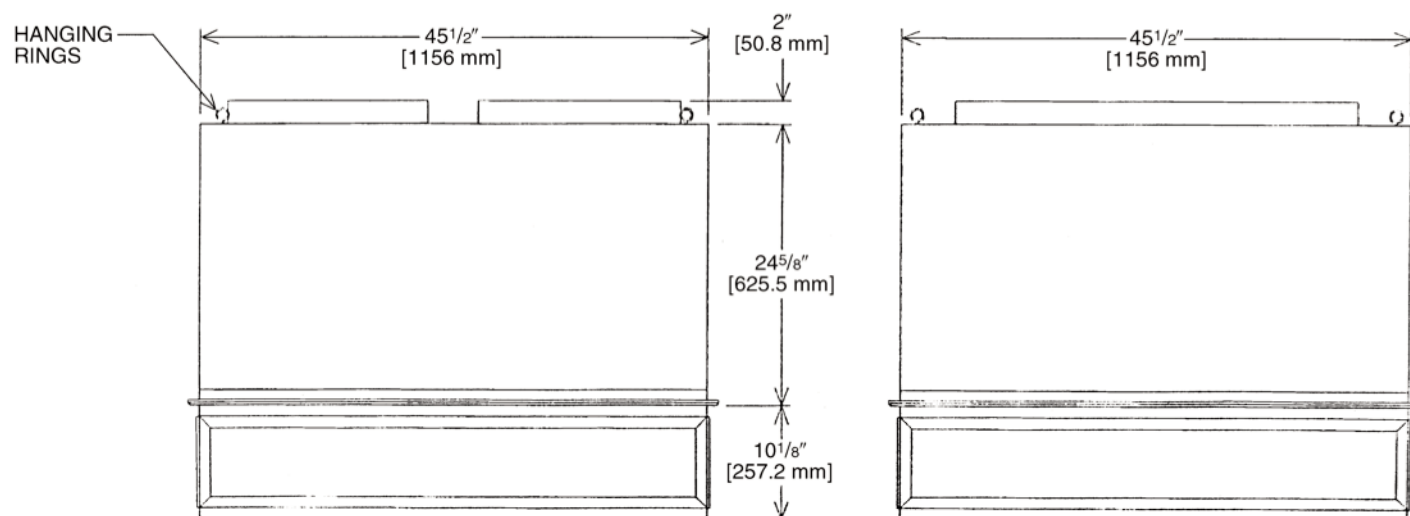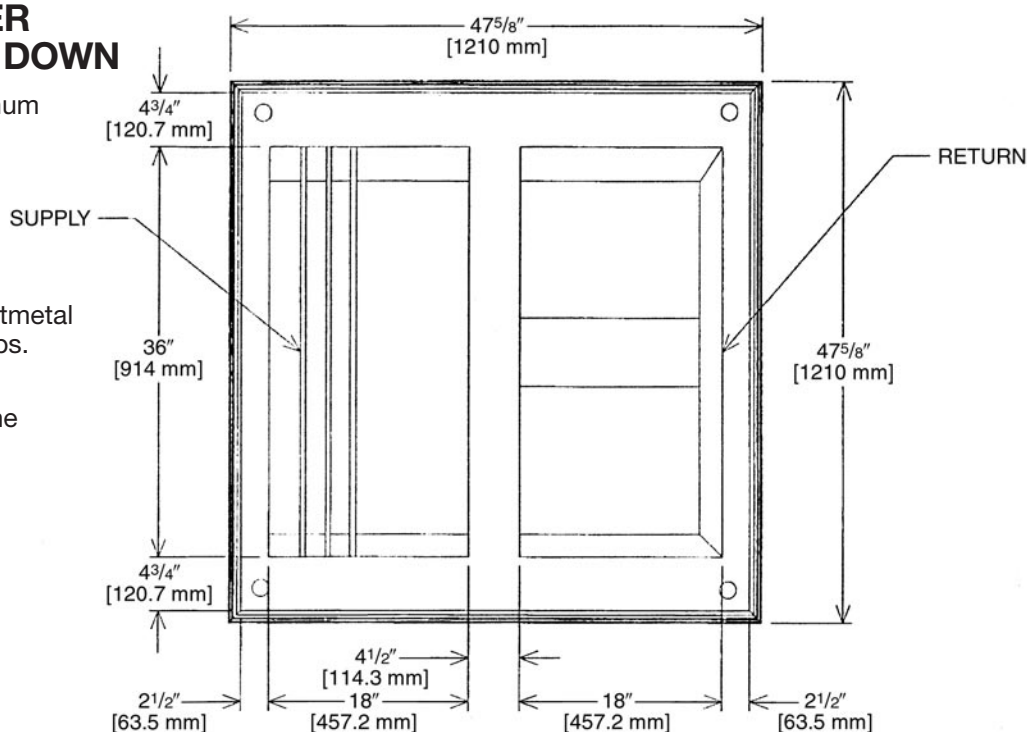




## CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD81	5600 [2643]	0.36	39-49	920	920
	5800 [2737]	0.39	42-51	954	954
	6000 [2832]	0.42	44-54	1022	1022
	6200 [2926]	0.46	45-55	1056	1056
	6400 [3020]	0.50	46-55	1090	1090
	6600 [3115]	0.54	47-56	1124	1124

[ ] Designates Metric Conversions

**CONCENTRIC DIFFUSER  
RXRN-AD86 SERIES  
20 TON [70.3 kW] STEP DOWN**

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

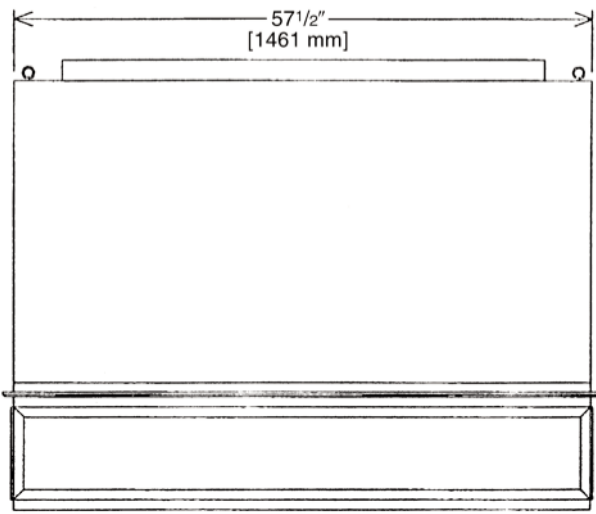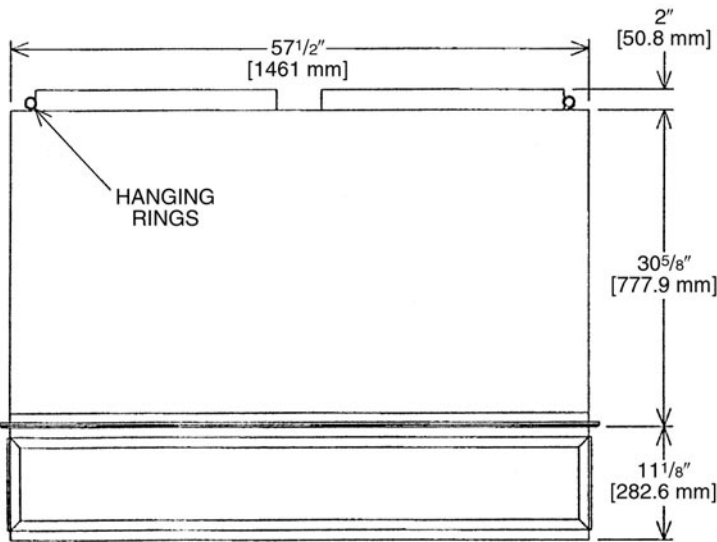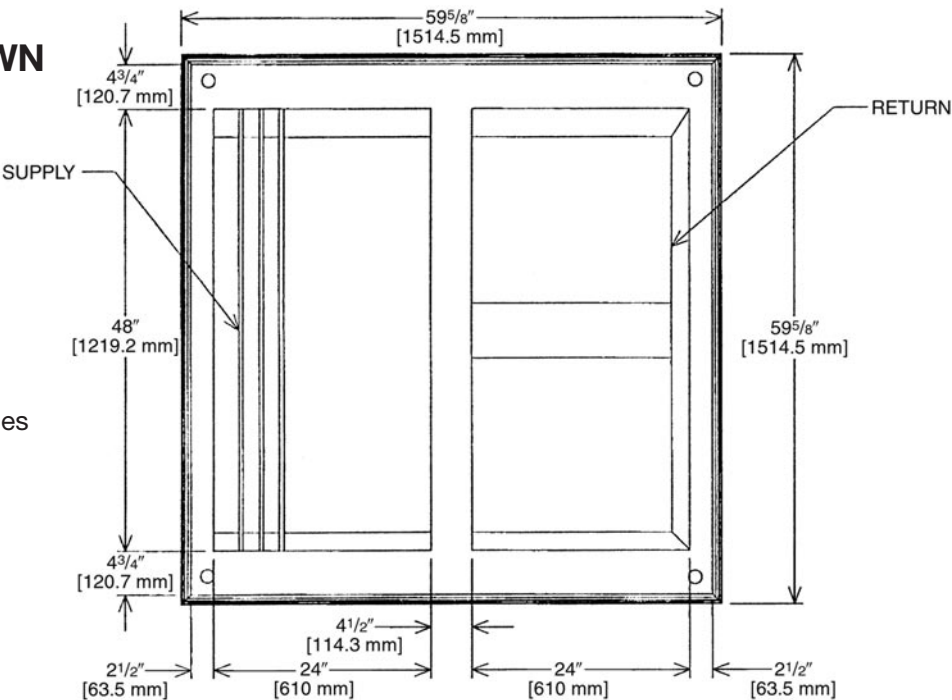




**CONCENTRIC DIFFUSER SPECIFICATIONS**

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD86	7200 [3398]	0.39	33-38	827	827
	7400 [3492]	0.41	35-40	850	850
	7600 [3587]	0.43	36-41	873	873
	7800 [3681]	0.47	38-43	896	896
	8000 [3776]	0.50	39-44	918	918
	8200 [3870]	0.53	41-46	941	941
	8400 [3964]	0.56	43-49	964	964
	8600 [4059]	0.59	44-50	987	987
	8800 [4153]	0.63	47-55	1010	1010

[ ] Designates Metric Conversions

## CONCENTRIC DIFFUSER RXRN-AD88 SERIES 25 TON [87.9 kW] STEP DOWN

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

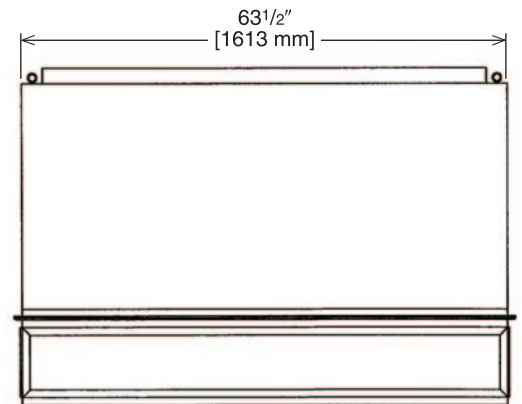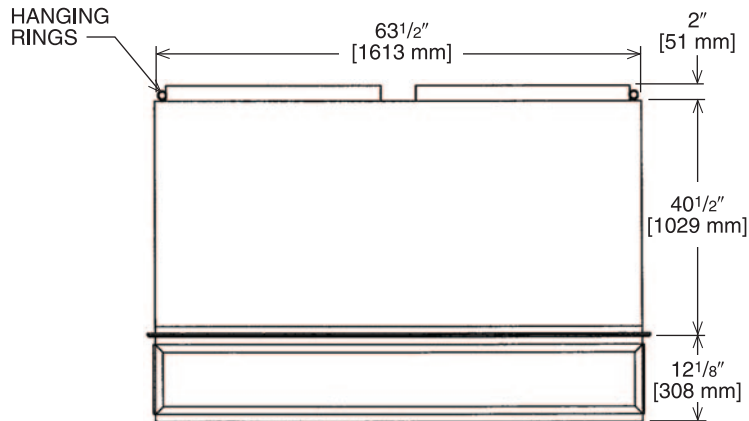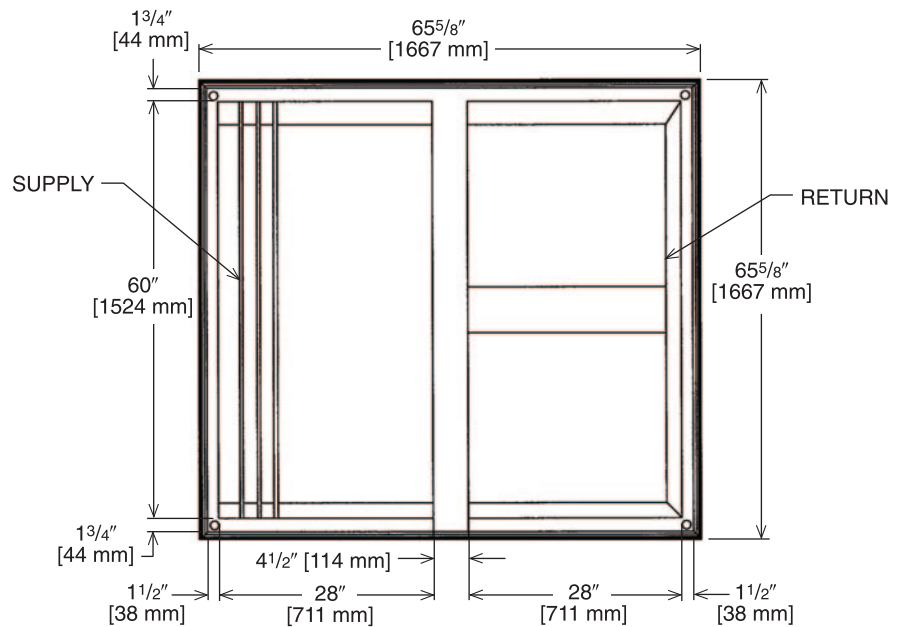

## CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD88	10000 [4719]	0.51	46-54	907	907
	10500 [4955]	0.58	50-58	953	953
	11000 [5191]	0.65	53-61	998	998
	11500 [5427]	0.73	55-64	1043	1043
	12000 [5663]	0.82	58-67	1089	1089
	12500 [5898]	0.91	61-71	1134	1134
	13000 [6134]	1.00	64-74	1179	1179

[ ] Designates Metric Conversions

## Guide Specifications – RLNL-G180 thru C/H300

You may copy this document directly into your building specification. This specification is written to comply with the 2004 version of the “master format” as published by the Construction Specification Institute. [www.csinet.org](http://www.csinet.org).

### ELECTRIC HEAT PACKAGED ROOFTOP

#### HVAC Guide Specifications

Size Range: 15 to 25 Nominal Tons

Section	Description
---------	-------------

<b>23 06 80</b>	<b>Schedules for Decentralized HVAC Equipment</b>
-----------------	---

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

<b>23 07 16</b>	<b>HVAC Equipment Insulation</b>
-----------------	----------------------------------

23 07 16.13	Decentralized, Rooftop Units:
-------------	-------------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 3/4-in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, with aluminum foil facing on the air side.

2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

<b>23 09 13</b>	<b>Instrumentation and Control Devices for HVAC</b>
-----------------	---

23 09 13.23	Sensors and Transmitters
-------------	--------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat must

- a. have capability to energize 2 different stages of cooling, and 2 different stages of heating.

- b. must include capability for occupancy scheduling.

<b>23 09 23</b>	<b>Direct-digital Control system for HVAC</b>
-----------------	---

23 09 23.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 09 23.13.A.	RTU-C controller
----------------	------------------

1. Shall be ASHRAE 62-2001 compliant.

2. Shall accept 18-32VAC input power.

3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% - 95% RH (non-condensing).

4. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, fire shutdown, return air enthalpy, fan status, remote time clock/door switch.

5. Shall accept a CO<sub>2</sub> sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.

6. Shall provide the following outputs: Economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, exhaust, occupied.

7. Unit shall provide surge protection for the controller through a circuit breaker.

8. Shall have a field installed communication card allowing the unit to be Internet capable, and communicate at a Baud rate of 19.2K or faster

9. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.

10. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.

11. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.

12. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.

13. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.

14. Shall support a bus length of 4000 ft max, 60 devices per 1000 ft section, and 1 RS-485 repeater per 1000 ft sections.

23 09 23.13.B.	Open protocol, direct digital controller:
----------------	---

1. Shall be ASHRAE 62-2001 compliant.

2. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.

3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).

4. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.

5. The BACnet® plug in communication card shall include built-in protocol for BACNET (MS/TP and PTP modes)

6. The LonWorks™ plug in communication card shall include the Echelon processor required for all Lon applications.

7. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers

8. Baud rate Controller shall be selectable through the EIA-485 protocol communication port.

9. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.

10. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/humidity/remote occupancy.

11. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, exhaust.

12. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

### **23 09 33 Electric and Electronic Control System for HVAC**

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 100VA capabilities.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, loss of charge, freeze sensor, high pressure switches.
4. Unit shall include a minimum of one 10-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Loss of charge switch.
  - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
  - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
  - c. Loss of charge switch shall have a different sized connector than the high pressure switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
3. High-pressure switch.
  - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
  - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.
  - c. High pressure switch shall have a different sized connector than the loss of charge switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
4. Freeze protection sensor, evaporator coil.
5. Automatic reset, motor thermal overload protector.

### **23 09 93 Sequence of Operations for HVAC Controls**

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

### **23 40 13 Panel Air Filters**

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section shall

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Filters shall be accessible through an access panel as described in the unit cabinet section of this specification (23 81 19.13.H).

### **23 81 19 Self-Contained Air Conditioners**

23 81 19.13 Small-Capacity Self-Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and heat pump for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally sound R-410a refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2004 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 210/240 and 340/360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
9. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
10. Roof curb shall be designed to conform to NRCA Standards.
11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.



23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at  $\pm 10\%$  voltage.
2. Compressor with standard controls shall be capable of operation from 40°F (4°C) , ambient outdoor temperatures. Accessory low ambient kit is necessary if mechanically cooling at ambient temperatures below 40°F (4°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standard 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 3/4-in. thick, 1 lb density, flexible fiberglass insulation, aluminum foil-faced on the air side.
4. Base of unit shall have locations for thru-the-base electrical connections (factory installed or field installed), standard.
5. Base Rail
  - a. Unit shall have base rails on all sides.
  - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
  - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
  - d. Base rail shall be a minimum of 14 gauge thickness.
6. Condensate pan and connections:
  - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 1" -11 1/2 NPT drain connection, through the side of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Electrical Connections
  - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
  - b. Thru-the-base capability
    - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
    - (2.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
8. Component access panels (standard)
  - a. Cabinet panels shall be easily removable for servicing.
  - b. Stainless steel metal hinges are standard on all doors.
  - c. Panels covering control box, indoor fan, indoor fan motor, and electric or gas heater components (where applicable), shall have 1/4 turn latches.

23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils: on all models.
  - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
  - b. Evaporator and Condenser coils shall be leak tested to 150 psig, pressure tested to 550 psig, and qualified to UL 1995 burst test at 2,200 psig.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
  - a. Thermal Expansion Valve (TXV) with orifice type distributor
  - b. Refrigerant filter drier.
  - c. External service gauge connections to unit suction and discharge lines.
  - d. Pressure gauge access through an access port in the front and rear panel of the unit.
2. Compressors
  - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
  - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
  - d. Compressors shall be internally protected from high discharge temperature conditions. Advanced Scroll Temperature Protection on 240-300 sizes.



- e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
- f. Compressor shall be factory mounted on rubber grommets.
- g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
- h. Crankcase heaters shall not be required for normal operating range.

23 81 19.13.L. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a sliding filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filters shall be standard, commercially available sizes.
- 5. Filter face velocity shall not exceed 365 fpm at nominal airflows.

23 81 19.13.M. Evaporator Fan and Motor

- 1. Evaporator fan motor:
  - a. Shall have permanently lubricated bearings.
  - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
  - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Belt-driven Evaporator Fan:
  - a. Belt drive shall include an adjustable-pitch motor pulley.
  - b. Shall use sealed, permanently lubricated ball-bearing type.
  - c. Blower fan shall be double-inlet type with forward-curved blades.
  - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

- 1. Condenser fan motors:
  - a. Shall be a totally enclosed motor.
  - b. Shall use permanently lubricated bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft-down design. Shaft-up designs including those with "rain-slinger devices" shall not be allowed.
- 2. Condenser Fans:
  - a. Shall be a direct-driven propeller type fan.
  - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features, Options and Accessories

- 1. Integrated Economizers:
  - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Shall be capable of introducing up to 100% outdoor air.
  - g. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
  - h. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - i. An outdoor single enthalpy sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from the enthalpy equivalent of 63°F @ 50% rh to 73°F @ 50% rh. Additional sensor options shall be available as accessories.
  - j. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
  - k. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
  - l. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - m. Economizer controller shall accept a 2-10Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
  - n. Compressor lockout sensor on the unit controller is factory set at 35°F and is adjustable from 30°F (-1°C) to 50°F (10°C) and resets the cooling lockout at 5°F (+2.7°C) above the set point.
  - o. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - p. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
  - q. Economizer wire harness will have provision for smoke detector.

2. Two-Position Motorized Damper
  - a. Damper shall be a Two-Position Motorized Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
  - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
  - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
  - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
  - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
  - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
  - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter
3. Manual damper
  - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.
4. Head Pressure Control Package
  - a. Controller shall control coil head pressure by condenser-fan cycling.
5. Condenser Coil Hail Guard Assembly
  - a. Shall protect against damage from hail.
  - b. Shall be louvered design.
6. Convenience Outlet:
  - a. Non-Powered convenience outlet.
    - (1.) Outlet shall be powered from a separate 115-120v power source.
    - (2.) A transformer shall not be included.
    - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
    - (4.) Outlet shall include 15 amp GFI receptacles.
    - (5.) Outlet shall be accessible from outside the unit.
7. Fan/Filter Status Switch:
  - a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
  - b. Status shall be displayed either over communication bus (when used with direct digital controls) or through the controller LCD display inside the unit control box.
8. Propeller Power Exhaust:
  - a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Independent modules for vertical or horizontal return configurations shall be available.
  - c. Horizontal power exhaust is shall be mounted in return ductwork.
  - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
9. Roof Curbs (Vertical):
  - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
10. High-Static Indoor Fan Motor(s) and Drive(s):
  - a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
11. Outdoor Air Enthalpy Sensor:
  - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
13. Return Air Enthalpy Sensor:
  - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
14. Indoor Air Quality (CO<sub>2</sub>) Sensor:
  - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in wall mount with LED display. The setpoint shall have adjustment capability.
15. Smoke detectors:
  - a. Shall be a Four-Wire Controller and Detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
  - c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have a recessed momentary switch for testing and resetting the detector.
  - e. Controller shall include:

- (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
  - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
  - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
  - (4.) Capable of direct connection to two individual detector modules.
  - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
16. Electric Heat:
- a. Heating Section
    - (1.) Heater element open coil resistance wire, nickel-chrome alloy, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
    - (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.

**26 29 23.12 Adjustable Frequency Drive**

1. Unit shall be supplied with an electronic variable frequency drive for the supply air fan.
2. Drive shall be factory installed in an enclosed cabinet.
3. Drive shall meet UL Standard 95-5V.
4. The completed unit assembly shall be UL listed.
5. Drives are to be accessible through a tooled access hinged door assembly.
6. The unit manufacturer shall install all power and control wiring.
7. The supply air fan drive output shall be controlled by the factory installed main unit control system and drive status and operating speed shall be monitored and displayed at the main unit control panel.
8. Drive shall be programmed and factory run tested in the unit.

BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.

**GENERAL TERMS OF LIMITED WARRANTY\***

Ruud will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.

**Compressor**

3 Phase, Commercial Applications .....Five (5) Years

**Parts**

3 Phase, Commercial Applications .....One (1) Year

**Factory Standard Heat Exchanger**

3 Phase, Commercial Applications .....Ten (10) Years

**Stainless Steel Heat Exchanger**

3 Phase, Commercial Applications .....Twenty (20) Years

\*For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.





*In keeping with its policy of continuous progress and product improvement, Ruud reserves the right to make changes without notice.*

Ruud Heating, Cooling & Water Heating • 5600 Old Greenwood Road  
Fort Smith, Arkansas 72908 • [www.ruud.com](http://www.ruud.com)

Ruud Canada • 125 Edgeware Road, Unit 1  
Brampton, Ontario • L6Y 0P5

**RELY ON RUUD.™**

PRINTED IN U.S.A 4/22 QG FORM NO. S22-962 REV. 6