



Packaged Air Conditioner
RACH Series

Ruud Commercial Resolute™ Line Packaged Air Conditioner



RACH Commercial Resolute™

Nominal Size: 27.5 Ton [96.7 kW]

Standard Variable Frequency Drive and Variable Air Volume

ASHRAE 90.1-2019 Compliant Models



RELY ON RUUD.™

FORM NO. S22-986 REV. 1

TABLE OF CONTENTS

Unit Features and Benefits3-9

Model Number Identification10

Options11

Selection Procedure12

General Data13-15

General Data Notes16

Gross Systems Performance Data17-19

Airflow Performance Data20-23

Electrical Data24-28

Electric Heater Kits.....29-32

Dimensional Data33-35

Field Installed Accessories.....36-48

Guide Specifications49-54

Limited Warranty55



RACH STANDARD FEATURES INCLUDE:

- Factory charged with R-410A HFC refrigerant
- Wired and run tested
- Scroll compressors with internal line break overload and high pressure protection
- One single-stage and one two-stage compressor to enable 5 stages of cooling
- Convertible airflow – vertical down flow or horizontal side flow
- Forkable base rails for easy handling and lifting
- Cooling operation up to 125°F ambient
- MicroChannel condenser coil and Tube and Fin evaporator coil
- ClearControl™ (DDC) and Phase Monitor
- Single and Multi-Zone Variable Air Volume (VAV) Capable
- Two-piece control door
- ¼ turn fasteners on filter access door
- Color-coded and labeled wiring
- TXV refrigerant metering system
- Solid-core liquid line filter drier
- High pressure and low pressure/loss of charge protection with built in Smart Logic
- Insulation encapsulated throughout entire unit
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system
- Variable Frequency Drive (VFD) blower is standard

FACTORY INSTALLED OPTIONS:

- Louvered panels
- Hinged access doors
- Low ambient/freeze stat
- Non-powered convenience outlet
- Economizer (Title 24 and ASHRAE 90.1 2019 Compliant)
- Supply and return smoke detector
- Return smoke detector
- ClearControl™ Direct Digital Control (DDC)
- Comfort Alert/Phase monitor
- Disconnect Switch

FIELD INSTALLED ACCESSORY EQUIPMENT:

Accessory	Model Number	Factory Installation Available?
Economizer w/Single Enthalpy (Downflow)	AXRD-01RMDCM3	Yes
Economizer w/Single Enthalpy (Horizontal)	AXRD-01RMHCM3	No
Dual Enthalpy Kit	RXXR-AV01	No
Carbon Dioxide Sensor (Wall Mount)	RXXR-AR02	No
Power Exhaust (230V)	RXXR-BGF05C	No
Power Exhaust (460V)	RXXR-BGF05D	No
Power Exhaust (575V)	RXXR-BGF05Y	No
Manual Fresh Air Damper	AXRF-KFA1	No
2-Position Motorized Kit for Fresh Air Damper	RXRF-AW03	No
Modulating Motor Kit for AXRF-KFA1	RXRF-AW05	No
Roofcurb, 14"	RXKG-CBH14	No
Concentric Diffuser (Step-Down, 18" x 36")	RXRN-AD81	No
Concentric Diffuser (Step-Down, 24" x 48")	RXRN-AD86	No
Concentric Diffuser (Step-Down, 28" x 60")	RXRN-AD88	No
Concentric Diffuser (Flush, 18" x 36")	RXRN-AD80	No
Downflow Transition (Rect. To Rect., 18" x 36")	RXMC-CJ07	No
Downflow Transition (Rect. To Rect., 24" x 48")	RXMC-CK08	No
Downflow Transition (Rect. To Rect., 28" x 60")	RXMC-CL09	No
BACnet Communication Card	RXXR-AY01	No

Accessory	Model Number	Factory Installation Available?
LonWorks Communication Card	RXXR-AY02	No
Room Humidity Sensor	RHC-ZNS4	No
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	No
Low-Ambient Control Kit DDC (1 Per Compressor)	RXRZ-C02	No
Freeze Stat Kit	RXXR-AM05	Yes
Unwired Convenience Outlet	RXXR-AN01	Yes
Hail Guard Louvers	AXRX-AAD01L	Yes
Return Smoke Detector (Downflow/Vertical)	RXXR-BSH1	Yes
Return Smoke Detector (Horizontal)	RXXR-BSH2	Yes
Return/Supply Smoke Detector (Downflow/Vertical)	RXXR-BSH3	Yes
Return/Supply Smoke Detector (Horizontal)	RXXR-BSH4	Yes
Electric Heater Kits C - 208 / 230-240- V D - 480 V Y - 600 V	RXJJ-CE20 (C,D,Y)	Yes
	RXJJ-CE40 (C,D,Y)	Yes
	RXJJ-CE60 (C,D,Y)	Yes
	RXJJ-CE75 (C,D,Y)	Yes
MERV 8 Filter	RXMF-M08A22520	Yes
MERV 13 Filter	RXMF-M13A22520	Yes



Cabinet and Foundation

Resolute™ Packaged equipment is designed from the ground up with the latest features and benefits required to compete in today's market. The clean design stands alone in the industry and is a testament to the quality, reliability, ease of installation and serviceability that goes into each unit. Outwardly, the Ruud label (1) identifies the brand to the customer.


The sheet metal cabinet (2) uses nothing less than 20-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a top with a 1/8" drip lip (3), gasket-protected panels and screw. The slanted outdoor coil protects the coil from hail damage (4). Every Ruud packaged unit uses the toughest finish in the industry, using electro deposition baked-on enamel tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.

Base Pan and Foundation

Anything built to last must start with the right foundation. In this case, the foundation is a 14-gauge, commercial-grade, full-perimeter base rails (5), which integrate fork slots and rigging holes to save set-up time on the job site. The basepan is stamped, which forms a 1-1/8" flange around the supply and return opening and has eliminated the worry of water entering the conditioned space (6).

Drain Pan

The drainpan (7) is made of plastic that resists the growth of harmful bacteria and is sloped for the latest IAQ benefits. Furthermore, the drainpan slides out for easy cleaning. The insulation

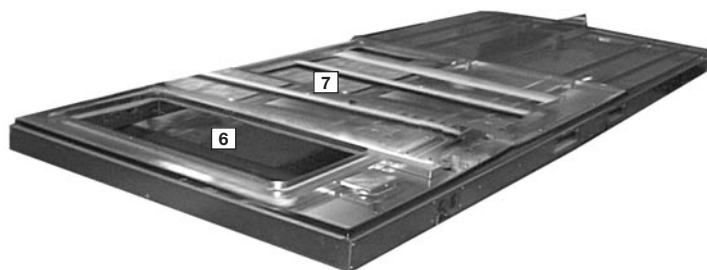

has been placed on the underside of the basepan, removing areas that would allow for potential moisture accumulation, which can facilitate growth of harmful bacteria. All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden.


Test Standards

During development, each unit was tested to U.L. 1995, ANSI 21.47, AHRI 340/360 and other Ruud-required reliability tests. Ruud adheres to stringent ISO 9001:2015 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate (8). Contractors can rest assured that when a Ruud packaged unit arrives at the job, it is ready to go with a factory charge and quality checks.

Easy Access

Access all major compartments from the front of the unit, including the filter and electrical compartment, blower compartment, heating section, and outdoor section. Each panel is permanently embossed with the compartment name (control/filter access, blower access, and furnace access).

Electrical and filter compartment access is through a large, hinged-access panel with 1/4 turn latches. On the outside of the panel is the unit nameplate, which contains the model and serial number, electrical data, and other important unit information.

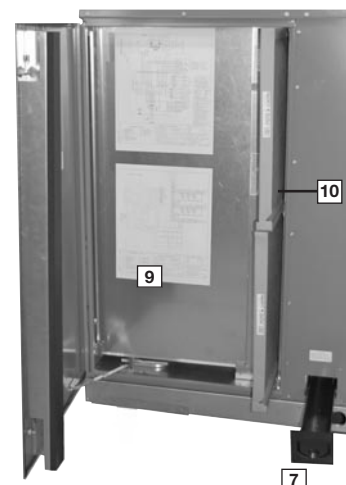

Charging Charts, Wiring Diagrams, & Labels

The unit charging chart is located on the inside of the electrical and filter compartment door. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. To the right of the control box, the model and serial number can be found. Having this information on the inside will assure model identification for the life of the product. The production line quality test assurance label is also placed in this location ([9]).

Filter Rack

The two-inch throwaway filters ([10]) are easily removed on a slide-out tracked system for easy replacement.



Blower Assembly

The blower compartment is to the right of the control box and can be accessed by 1/4 turn latches. To allow easy maintenance of the blower assembly, the entire assembly easily slides out by removing four #10 screws from the blower assembly. The adjustable motor pulley ([11]) can easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the belt is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 1 to 6 turns open.

Where the demands for the job require high static, Ruud has high-static drives available that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing ([12]) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing which firmly secures the pulley to the blower shaft for years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the shaft, as opposed to the use of a set screw, which can score the shaft, creating burrs that make blower-pulley removal difficult.



High and Low Pressure Switches & Freeze Stat

The low-pressure switches and high-pressure switches are mounted on the appropriate refrigerant lines in the condenser section. The high-pressure switch will shut off the compressors if pressures exceeding 610 PSIG are detected as may occur if the outdoor fan motor fails. The low-pressure switches shut off the compressors if low pressure is detected due to loss of refrigerant charge. Each factory-installed option is brazed into the appropriate high or low side and wired appropriately. Use of polarized plugs allow for easy field inspection and repair.

Thermostatic Expansion Valve (TXV)

Inside the blower compartment the interlaced evaporator can also be viewed. The evaporator uses fin technology for maximum heat transfer. The TXV ([13]) metering device assures even distribution of refrigerant throughout the evaporator.




Control Box

Inside the control box (14), each electrical component is clearly identified with a label that matches the component to the wiring diagram for ease of trouble shooting. Most of the wiring is numbered on each end of the termination and color-coded to match the wiring diagram. The integrated furnace control, used to control furnace operation, incorporates a flashing LED troubleshooting device. Flash codes are clearly outlined on the unit wiring diagram. The control transformer has a low voltage circuit breaker that trips if a low voltage electrical short occurs. There is also a compressor contactor for each compressor.



ClearControl™

As part of the ClearControl™ system (15) which allows real time monitoring and communication between rooftop units, the RACH Packaged AC Unit has a Rooftop Unit Controller (RTU-C) factory mounted and wired in the control panel. The RTU-C is a solid-state microprocessor-based control board that provides flexible control and extensive diagnostics for all unit functions. The RTU-C, through proportional/integral control algorithms, performs specific unit functions that govern unit operation in response to zone conditions, system temperatures, system pressures, ambient conditions, and electrical inputs. The RTU-C features a 16 x 2 character LCD display and a five-button keypad for local configuration and direct diagnosis of the system. Features include a clogged filter switch (CFS), fan proving switch (FPS), return air temperature sensor (RAT), discharge air temperature sensor (DAT), and outdoor air temperature sensor (OAT). Freeze sensors (FS) are used in place of freezestats to allow measurement of refrigerant suction line temperatures.

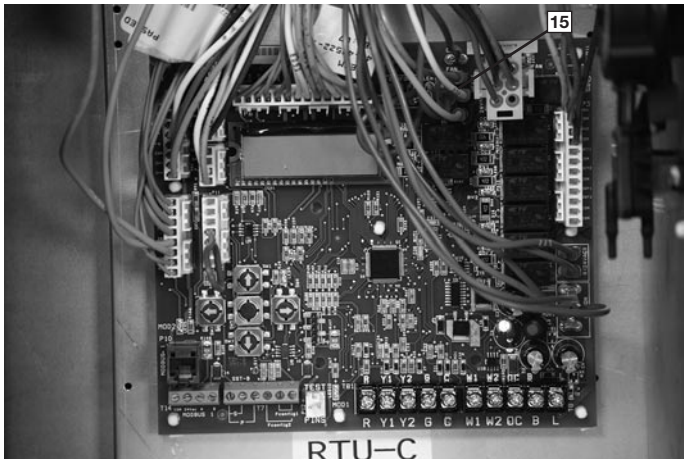

The RACH with the RTU-C is specifically designed to be applied in four distinct applications:


1. **BACnet Communication** — The RACH is compatible with a third party building management system that supports the BACnet Application Specific Controller device profile, with the use of a field installed BACnet Communication Module. The BACnet Communication Module plugs into the unit RTU-C controller and allows communication between ClearControl™ and the BACnet MSTP or IP network. A zone sensor, a BACnet network zone sensor, a BACnet thermostat or DDC controller may be used to send the zone thermostat or thermostat demands to the RTU-C. The BACnet Communication Module is compatible with MSTP EIA-485 daisy chain networks communicating at 38.4 bps. It is compatible with twisted pair, shielded cables.
2. **LonWorks Communication** — The RACH is compatible with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. This is accomplished with a field installed LonMark communication module. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between ClearControl™ and a LonWorks network. A zone sensor, a LonTalk network zone sensor, or a LonTalk thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The LonMark Communication Module utilizes an FTT-10A free topology transceiver communicating at 78.8 kbps. It is compatible with Echelon qualified, twisted pair cable, Belden 8471, or NEMA Level 4 cables. The module can communicate up to 1640 feet with no repeater. The LonWorks limit of 64 nodes per segment applies to this device.
3. **24V Thermostat Compatibility** — The RACH is compatible with a programmable 24 volt thermostat. Connections are made via conventional thermostat screw terminals. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.
4. **Zone Sensor Compatibility** — The RACH is compatible with a zone sensor and a mechanical or solid state time clock connected to the RTU-C. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

ComfortAlert®

A factory or field installed Comfort Alert® module is available for power phase-monitoring protection and additional compressor diagnostics. The alarms can be displayed on the RTU-C display, through the (BAS) network, or connected to the "L-Terminal" of a thermostat for notification.

Variable Frequency Drive

The supply fan Variable Frequency Drive (VFD) (16) optimizes energy usage year round by providing a lower speed for first stage cooling operation, improving IEER's over the conventional constant fan system. Operating in the constant fan mode at the reduced speed can use as little as $\frac{1}{5}$ of the energy of a conventional constant fan system. Also, by operating at a lower speed on first stage cooling, up to 51% more moisture is removed, improving comfort during low load operation. The VFD supply fan meets California Title 24 and ASHRAE 90.1-2016 requirements for multi blower speed control. VFD also ramps up to the desired speed, reducing stress on the supply fan components and noise from a sudden inrush of air. Because the airflow is cut in half during first stage cooling and constant fan operation, noise is much less during these modes of operation.



Convenience Outlet & Disconnect Switch

For added convenience in the field, a factory-installed disconnect switch and a field-installed convenience outlet (17) are available. Low and High voltage can enter either from the side or through the base. Low-voltage connections are made through the low-voltage terminal strip. For ease of access, the U.L.-required low voltage barrier can be temporarily removed for low-voltage termination and then reinstalled. The high-voltage connection is terminated at the high-voltage terminal block. The suggested mounting for the field-installed disconnect is on the exterior side of the electrical control box.



External Gauge Ports

The high (18) and low (19) external gauge ports are located in the outdoor section. With gauge ports mounted externally, an accurate diagnostic of system operation can be performed quickly and without removing exterior panels.



Variable Air Volume (VAV)

Single and Multi-Zone Variable Air Volume (VAV) allows for enhanced control of airflow and temperature in multiple building zones. Ruud VAV technology is compatible with industry standard zoning controls and zone systems. The controls vary the airflow and the cooling capacity to meet the demands of multiple zones. This increases the comfort and air quality of the environment.


Compressor

The compressor compartment houses the heartbeat of the unit. The scroll compressors (20) are known for their long life and for reliable, quiet, and efficient operation. Each compressor has four rubber grommets (21) on the bottom for sound and vibration dampening. The suction and discharge lines are designed with shock loops to absorb the strain and stress that the starting torque, steady state operation, and shut down cycle impose on the refrigerant tubing. Each compressor and circuit are independent for built-in redundancy, and each circuit is clearly marked throughout the system. Each unit has 5 stages of cooling for precise supply air control.




Condenser Fans

The condenser fan motors (22) can easily be accessed and maintained through the top of the unit. A down-mount fan provides corrosion protection and easy removal. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit.

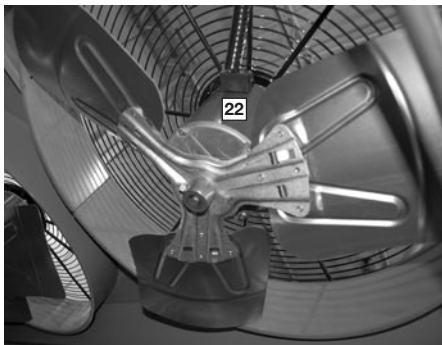

MicroChannel Condenser Technology

The outdoor coil uses the latest microchannel technology (23) for the most effective method of heat transfer. The outdoor coil is protected by optional louvered panels, which allow unobstructed airflow while protecting the unit from both the environment and vandalism.

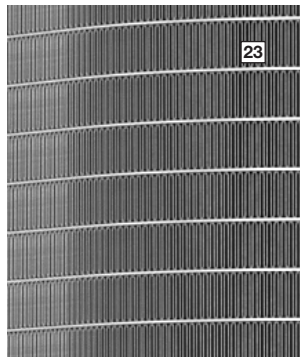

Economizer and Dampers


Each unit is designed for both downflow or horizontal applications for job configuration flexibility. The return air compartment can also contain an economizer. Two economizer models exist: one for downflow applications, and one for horizontal applications. Each unit is pre-wired for the economizer to allow quick plug-in installation. The downflow economizer is also available as a factory-installed option. Power Exhaust is easily field-installed.

The economizer, which provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements, come standard with single enthalpy controls. The controls can be upgraded to dual enthalpy easily in the field. The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field. The economizer control has a minimum position set-point, an outdoor-air set-point, a mix-air set-point, and a CO₂ set-point.

Barometric relief is standard on all economizers. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plug-in assembly.

Roofcurb

The Ruud roofcurb (24) is made for toolless assembly at the jobsite by inserting a pin into the hinged corners (25), which makes the assembly process quick and easy.

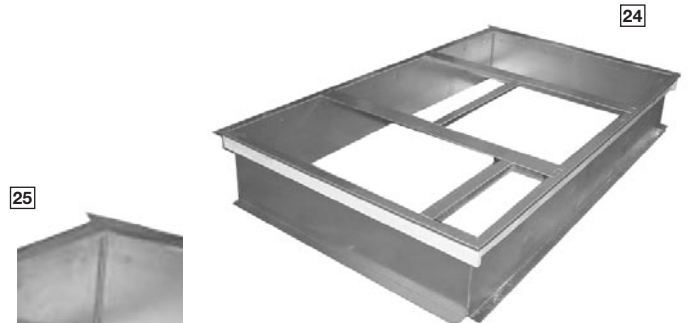

R	AC	H	5	U	360	A	C	G	40	B	C	A	****
1	23	4	5	6	789	10	11	12	13 14	15	16	17	18 19 20 21

1—Brand

R = Ruud

2, 3—Unit Type

AC = Packaged AC

4—Cabinet Type

H = Large Commercial
Extended

5—Series

5 = 5 stages of cooling

6—Efficiency Tier

U = High Efficiency

7,8,9—Capacity

360 = 27.5 ton

10—Major Series

A = 410A

11—Voltage

C = 3 phase 208-230/60

D = 3 phase 460/60

Y = 3 phase 575/60

12—Drive

F = Belt Drive - VFD Low

G = Belt Drive - VFD Medium

H = Belt Drive - VFD High

13, 14—Heat Capacity

00 = No Heat

40 = 40 kW

60 = 60 kW

75 = 75 kW

15—Heat Configuration

0 = No Heat

1 = Single-Stage

2 = Two-Stage

16—Control

C = ClearControl™ & Phase Monitor

D = ClearControl™ & Comfort Alert

17—Minor series

A = 1st design

18, 19, 20, 21—Option Code

AA0A

FACTORY INSTALLED OPTION CODES FOR RACH (27.5 TONS)

18				19			20			21	
LV = Louver protection				DC = Disconnect			EC = Economizer			M8 = MERV 8 Filter	
HA = Hinged Access				NP = Non-Powered Convenience Outlet			SS = Supply & Return Smoke			M13 = MERV 13 Filter	
CC¹= Codenser Coil Coating				LF = Low Ambient & Freeze Stat			RS = Return Smoke				
OPTION CODE CHARACTER HIGHLIGHTED											
Opt.				Opt.			Opt.			Opt.	
A	None			A	None		0	None		A	None
B	LV			B	LF		1	EC		D	M8
C	HA			C	NP		2	RS		G	M13
D	LV	HA		D	LF	NP	3	EC	RS		
E	LV	CC					4	SS			
F	LV	HA	CC				5	EC	SS		

¹CC-requires LV (louver protection)

Instructions for Factory Installed Option(s) Selection

Note: Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, "AAO" follows the model number.

- **Step 1:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 18. For example, the option code character "E" has Louver protection and Coil Coating.
- **Step 2:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 19. For example, the option code character "D" has Low Ambient / Freeze Stat and Non-powered convenience outlet.
- **Step 3:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 20. For example, the option code character "3" has Economizer and Return Smoke.
- **Step 4:** In the table above, based on the desired features, choose option code character from highlighted options on the left side under the number 21. For example, the option code character "D" has MERV8 Filters.
- The resulting option code from examples above is: "ED3D"
- **Step 5:** Add your option code selection to the end of the model number.

○ Example: RACH5U360ACG302CA ED3D = RACH5U360ACG302CAED3D

Base model Option code = Model number with option code

To select an RACH Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.

Example:

Voltage—	460V – 3 Phase – 60 Hz
Total Cooling Capacity—	340,000 BTUH [99.6 kW]
Sensible Cooling Capacity—	230,000 BTUH [67.4 kW]
Heating Capacity—	136,486 BTUH [40 kW]
*Condenser Entering Air—	95°F [35.0°C] DB
*Evaporator Mixed Air Entering—	67°F [19.4°C] WB
	78°F [25.6°C] DB
*Indoor Air Flow—	11000 CFM [5191 L/s]
*External Static Pressure—	1.2 in. WG [0.30 kPa]

2. SELECT UNIT TO MEET COOLING REQUIREMENTS.

Since total cooling is within range of a nominal 30 ton unit, use the cooling performance table at 95°F DB condenser inlet air. Interpolate between 9400 CFM [4436 L/s] and 13200 CFM [6230 L/s] to determine total and sensible capacity and Depression Ratio for inlet air at 11000 CFM [5191 L/s] indoor airflow (table basis):

Interpolation Formula:

$$\left[\frac{(CFM - CFM_1) \times (MBH_2 - MBH_1)}{CFM_2 - CFM_1} \right] = MBH$$

Total Cooling Capacity:

$$364.4 + \left[\frac{(11,000 - 9,400) \times (339.5 - 364.4)}{13,200 - 9,400} \right] = 350,000 \text{ BTUH}$$

Total Cooling Capacity = 350,000 BTUH [102.6 kW]
Sensible Cooling Capacity = 259,600 BTUH [76.1 kW]
DR = 0.105

When the entering dry bulb temperature (dbE) is not 80°F [26.7°C], the sensible capacity needs to be adjusted.

Note: total capacity is unaffected

Sensible Capacity Depression Formula:

$$Cap_{sensible} + [1.10 \times CFM \times (1 - DR) \times (dbE - 80)]$$

$$259,600 + [1.10 \times 11,000 \times (1 - 0.105) \times (78 - 80)]$$

$$\text{Sensible Cooling Capacity} = 237,941 \text{ BTUH}$$

4. DETERMINE BLOWER SPEED AND BHP TO MEET SYSTEM DESIGN.

Total ESP (external static pressure) per the spec of 1.2 in WG [0.30 kPa] includes the system duct and grilles. Add from the table "Component Air Resistance," 0.19 in. WG [0.05 kPa] for wet coil and 0.35 in. WG [0.09 kPa] for downflow to get an ESP of 1.74 in. WG [0.43 kPa]. Using the "Airflow Performance Table", at the specified 11,000 CFM and 1.74 in. WG [0.43 kPa] ESP, determine blower BHP.

RPM = 1189
BHP = 12.98
DRIVE = H

4. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR BHP IN STEP 3.

Assuming an average of 85% motor efficiency, determine the amount of heat generated by the blower motor at the specified CFM and ESP by dividing the BHP by the motor efficiency and solving for the difference. Convert this value from BTU to BTUH, multiplying by 2542.8 BTUH/BHP

$$BHP = 12.98$$

$$AVG \text{ MOTOR EFFICIENCY} = 85\%$$

$$INDOOR \text{ BLOWER MOTOR HEAT} =$$

$$\left[\left(\frac{BHP}{0.85} - BHP \right) \right] \times 2542.8$$

$$= [(12.98/0.85) - 12.98] \times 2542.8 = 5825 \text{ BTUH [1.71 kW]}$$

5. CALCULATE NET COOLING CAPACITIES

Net cooling capacities can be calculated by subtracting the motor heat from the gross cooling capacities.

$$\text{Net Total Capacity} = \text{Gross Total Capacity} - \text{Indoor Blower Motor Heat}$$

$$= 350,000 - 5,825 = 344,175 \text{ BTUH [100.9 kW]}$$

$$\text{Net Sensible Capacity} = \text{Gross Sensible Capacity} - \text{Indoor Blower Motor Heat}$$

$$= 237,941 - 5,825 = 226,116 \text{ BTUH [66.3 kW]}$$

6. SELECT UNIT HEATING CAPACITY.

From "Heater Kit" Table, select kW to meet heating capacity requirement; multiply kW by 3412 to convert to BTUH.

Use 40 kW Heater Kit

Heater Kit Model:	Heater Kit Capacity:
RXJJCE40D+	131,021 BTUH [38.4 kW]

Add indoor blower heat effect (step 4) to Heater Kit Capacity to get total heating capacity:

$$131,021 + 5825 = 136,846 \text{ BTUH [40.1 kW]}$$

7. CHOOSE MODEL RACH5U360ADH

[] Designates Metric Conversions

NOM. SIZES 27.5 TONS [96.7 kW] MODELS

Model RACH5U Series	360ACF	360ACG	360ACH
Cooling Performance^A			CONTINUED →
Gross Cooling Capacity Btu [kW]	340,000 [99.62]	340,000 [99.62]	340,000 [99.62]
EER ^B	10.5	10.5	10.5
IEER ^C	14.6	14.6	14.6
Nominal CFM/AHRI Rated CFM [L/s]	11000/9400 [5191/4436]	11000/9400 [5191/4436]	11000/9400 [5191/4436]
AHRI Net Cooling Capacity Btu [kW]	330,000 [96.69]	330,000 [96.69]	330,000 [96.69]
Net Sensible Capacity Btu [kW]	231,000 [67.68]	231,000 [67.68]	231,000 [67.68]
Net Latent Capacity Btu [kW]	99,000 [29.01]	99,000 [29.01]	99,000 [29.01]
Net System Power kW	33.6	33.6	33.6
Compressor			
No./Type	2/Scroll	2/Scroll	2/Scroll
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	50.8 [4.72]	50.8 [4.72]	50.8 [4.72]
Rows/FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows/FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 3/4 HP	6 at 3/4 HP	6 at 3/4 HP
Motor RPM	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple
No. Motors	1	1	1
Motor HP	7 1/2	10	15
Motor RPM	1725	1725	3515
Motor Frame Size	213	215	215
Filter - Type	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	273/245 [7740/6946]	273/245 [7740/6946]	273/245 [7740/6946]
Weights			
Net Weight lbs. [kg]	2250 [1021]	2250 [1021]	2250 [1021]
Ship Weight lbs. [kg]	2350 [1066]	2350 [1066]	2350 [1066]

See Page 16 for Notes.

[] Designates Metric Conversions

NOM. SIZES 27.5 TONS [96.7 kW] MODELS (Con't.)

Model RACH5U Series	360ADF	360ADG	360ADH	360AYF
Cooling Performance ^A				CONTINUED →
Gross Cooling Capacity Btu [kW]	340,000 [99.62]	340,000 [99.62]	340,000 [99.62]	340,000 [99.62]
EER ^B	10.5	10.5	10.5	10.5
IEER ^C	14.6	14.6	14.6	14.6
Nominal CFM/AHRI Rated CFM [L/s]	11000/9400 [5191/4436]	11000/9400 [5191/4436]	11000/9400 [5191/4436]	11000/9400 [5191/4436]
AHRI Net Cooling Capacity Btu [kW]	330,000 [96.69]	330,000 [96.69]	330,000 [96.69]	330,000 [96.69]
Net Sensible Capacity Btu [kW]	231,000 [67.68]	231,000 [67.68]	231,000 [67.68]	231,000 [67.68]
Net Latent Capacity Btu [kW]	99,000 [29.01]	99,000 [29.01]	99,000 [29.01]	99,000 [29.01]
Net System Power kW	33.6	33.6	33.6	33.6
Compressor				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
Outdoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	50.8 [4.72]	50.8 [4.72]	50.8 [4.72]	50.8 [4.72]
Rows/FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm] OD	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]	26.67 [2.48]
Rows/FPI [FPcm]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]	6/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	19800 [9344]	19800 [9344]	19800 [9344]	19800 [9344]
No. Motors/HP	6 at 3/4 HP	6 at 3/4 HP	6 at 3/4 HP	6 at 3/4 HP
Motor RPM	1075	1075	1075	1075
Indoor Fan - Type	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]	2/18x9 [457x229]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds	Multiple	Multiple	Multiple	Multiple
No. Motors	1	1	1	1
Motor HP	7 1/2	10	15	7 1/2
Motor RPM	1725	1725	3515	1725
Motor Frame Size	213	215	215	213
Filter - Type	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]	273/245 [7740/6946]	273/245 [7740/6946]	273/245 [7740/6946]	273/245 [7740/6946]
Weights				
Net Weight lbs. [kg]	2250 [1021]	2250 [1021]	2250 [1021]	2250 [1021]
Ship Weight lbs. [kg]	2350 [1066]	2350 [1066]	2350 [1066]	2350 [1066]

See Page 16 for Notes.

[] Designates Metric Conversions

NOM. SIZES 27.5 TONS [96.7 kW] MODELS (Con't.)

Model RACH5U Series	360AYG	360AYH
Cooling Performance^A		
Gross Cooling Capacity Btu [kW]	340,000 [99.62]	340,000 [99.62]
EER ^B	10.5	10.5
IEER ^C	14.6	14.6
Nominal CFM/AHRI Rated CFM [L/s]	11000/9400 [5191/4436]	11000/9400 [5191/4436]
AHRI Net Cooling Capacity Btu [kW]	330,000 [96.69]	330,000 [96.69]
Net Sensible Capacity Btu [kW]	231,000 [67.68]	231,000 [67.68]
Net Latent Capacity Btu [kW]	99,000 [29.01]	99,000 [29.01]
Net System Power kW	33.6	33.6
Compressor		
No./Type	2/Scroll	2/Scroll
Outdoor Coil - Fin Type		
Tube Type	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1 [25.4]
Rows/FPI [FPcm]	50.8 [4.72]	50.8 [4.72]
	1 / 23 [9]	1 / 23 [9]
Indoor Coil - Fin Type		
Tube Type	Louvered	Louvered
Tube Size in. [mm] OD	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]
Rows/FPI [FPcm]	26.67 [2.48]	26.67 [2.48]
Refrigerant Control	4 / 15 [6]	4 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves
	1/1 [25.4]	1/1 [25.4]
Outdoor Fan - Type		
No. Used/Diameter in. [mm]	Propeller	Propeller
Drive Type/No. Speeds	6/24 [609.6]	6/24 [609.6]
CFM [L/s]	Direct/1	Direct/1
No. Motors/HP	19800 [9344]	19800 [9344]
Motor RPM	6 at 3/4 HP	6 at 3/4 HP
	1075	1075
Indoor Fan - Type		
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal
Drive Type	2/18x9 [457x229]	2/18x9 [457x229]
No. Speeds	Belt (Adjustable)	Belt (Adjustable)
No. Motors	Multiple	Multiple
Motor HP	1	1
Motor RPM	10	15
Motor Frame Size	1725	3515
	215	215
Filter - Type		
Furnished	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes
	(8)2x25x20 [51x635x508]	(8)2x25x20 [51x635x508]
Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]		
	273/245 [7740/6946]	273/245 [7740/6946]
Weights		
Net Weight lbs. [kg]	2250 [1021]	2250 [1021]
Ship Weight lbs. [kg]	2350 [1066]	2350 [1066]

See Page 16 for Notes.

[] Designates Metric Conversions

NOTES:

- A. Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to $\pm 20\%$ of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
- B. EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- C. Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RACH5U360ACF

		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①															
w/E		71°F [21.7°C]				67°F [19.4°C]				63°F [17.2°C]				61°F [16.1°C]			
CFM [L/s]		13200 [6230]				9400 [4436]				8800 [4153]				8000 [4153]			
DR ①		0.14				0.08				0.07				0.07			
75 [23.9]	Total BTUH [kW]	405.9	[118.9]	378.1	[110.8]	373.7	[109.5]	388.1	[113.7]	350.2	[102.6]	357.4	[104.7]	375.9	[110.4]	346.1	[101.4]
	Sens BTUH [kW]	258.3	[75.7]	217.3	[63.7]	210.9	[61.8]	296.5	[86.9]	249.4	[73.1]	242.0	[70.9]	271.0	[81.9]	271.0	[81.9]
80 [26.7]	Total BTUH [kW]	400.7	[117.4]	373.3	[109.4]	368.9	[108.1]	382.9	[112.2]	356.7	[104.5]	352.6	[103.3]	370.7	[108.6]	345.4	[101.2]
	Sens BTUH [kW]	256.1	[75.0]	215.4	[63.1]	209.0	[61.2]	294.2	[86.2]	247.5	[72.5]	240.1	[70.4]	269.2	[78.9]	269.2	[78.9]
85 [29.4]	Total BTUH [kW]	395.0	[115.8]	368.0	[107.8]	363.7	[106.6]	377.3	[110.6]	351.4	[103.0]	347.3	[101.8]	365.1	[107.0]	336.1	[98.5]
	Sens BTUH [kW]	253.5	[74.3]	213.3	[62.5]	207.0	[60.6]	291.7	[85.5]	245.4	[71.9]	238.1	[69.8]	267.1	[78.3]	267.1	[78.3]
90 [32.2]	Total BTUH [kW]	388.9	[114.0]	362.2	[106.2]	358.0	[104.9]	371.1	[108.7]	345.7	[101.3]	341.7	[100.1]	358.9	[105.2]	334.3	[98.0]
	Sens BTUH [kW]	250.8	[73.5]	211.0	[61.8]	204.7	[60.0]	288.9	[84.7]	243.0	[71.2]	235.8	[69.1]	264.8	[77.6]	264.8	[77.6]
95 [35]	Total BTUH [kW]	382.2	[112.0]	356.0	[104.3]	351.9	[103.1]	364.4	[106.8]	339.5	[99.5]	335.5	[98.3]	352.2	[103.2]	328.1	[96.2]
	Sens BTUH [kW]	247.7	[72.6]	208.4	[61.1]	202.2	[59.3]	285.9	[83.8]	240.5	[70.5]	233.3	[68.4]	262.3	[76.9]	262.3	[76.9]
100 [37.8]	Total BTUH [kW]	375.1	[109.9]	349.4	[102.4]	345.3	[101.2]	357.3	[104.7]	332.8	[97.5]	329.0	[96.4]	345.1	[101.1]	321.5	[94.2]
	Sens BTUH [kW]	244.4	[71.6]	205.6	[60.3]	199.5	[58.5]	282.6	[82.8]	237.7	[69.7]	230.6	[67.6]	261.6	[76.5]	256.7	[75.2]
105 [40.6]	Total BTUH [kW]	367.5	[107.7]	342.3	[100.3]	338.3	[99.1]	349.7	[102.5]	325.7	[95.5]	322.0	[94.3]	337.5	[98.9]	314.4	[92.1]
	Sens BTUH [kW]	240.8	[70.6]	202.6	[59.4]	196.6	[57.6]	279.0	[81.8]	234.7	[68.8]	227.7	[66.7]	264.6	[77.5]	256.7	[75.2]
110 [43.3]	Total BTUH [kW]	359.4	[105.3]	334.8	[98.1]	330.9	[97.0]	341.6	[100.1]	318.2	[93.2]	314.5	[92.2]	329.4	[96.5]	306.8	[89.9]
	Sens BTUH [kW]	237.0	[69.5]	199.4	[58.4]	193.5	[56.7]	275.2	[80.6]	231.5	[67.8]	224.6	[65.8]	261.4	[76.6]	253.6	[74.3]
115 [46.1]	Total BTUH [kW]	350.8	[102.8]	326.8	[95.8]	323.0	[94.6]	333.0	[97.6]	310.2	[90.9]	306.6	[89.8]	320.8	[94.0]	298.8	[87.6]
	Sens BTUH [kW]	232.9	[68.3]	196.0	[57.4]	190.1	[55.7]	271.1	[79.4]	228.0	[66.8]	221.3	[64.8]	260.6	[75.6]	250.3	[73.3]
120 [48.9]	Total BTUH [kW]	341.7	[100.1]	318.3	[93.3]	314.6	[92.2]	323.9	[94.9]	301.7	[88.4]	298.2	[87.4]	311.7	[91.3]	290.4	[85.1]
	Sens BTUH [kW]	228.6	[66.7]	192.3	[56.4]	186.6	[54.7]	266.7	[78.2]	224.4	[65.8]	217.7	[63.8]	262.3	[76.5]	246.7	[72.3]
125 [51.7]	Total BTUH [kW]	332.1	[97.3]	309.4	[90.7]	305.8	[89.6]	314.4	[92.1]	292.8	[85.8]	289.4	[84.8]	302.2	[88.5]	281.5	[82.5]
	Sens BTUH [kW]	224.0	[65.6]	188.4	[55.2]	182.8	[53.6]	262.1	[76.8]	220.5	[64.6]	213.9	[62.7]	297.7	[87.2]	250.4	[73.4]
Power		38.3		37.0		36.8		38.2		36.8		36.6		37.9		36.6	

DR —Depression ratio
dbE —Entering air dry bulb
w/E —Entering air wet bulb

Total —Total capacity x 1000 BTUH
Sens —Sensible capacity x 1000 BTUH
Power —KW Input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$.

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RACH5U360ACG

wB E		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①												61°F [16.1°C]												59°F [15.0°C]																	
		71°F [21.7°C]				67°F [19.4°C]				63°F [17.2°C]				61°F [16.1°C]				59°F [15.0°C]				57°F [13.9°C]				55°F [12.8°C]				53°F [11.7°C]				51°F [10.6°C]				49°F [9.4°C]					
CFM [L/s]		13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]	13200	[6230]	9400	[4436]	8800	[4153]
75 [23.9]	Total BTUH [kW]	405.9	[118.9]	378.1	[110.8]	373.7	[109.5]	388.1	[113.7]	361.6	[106.0]	357.4	[104.7]	375.9	[110.2]	350.2	[102.6]	346.1	[101.4]	372.8	[109.2]	347.3	[101.8]	343.2	[100.6]	372.2	[109.1]	346.7	[101.6]	342.7	[100.4]	362.9	[106.3]	305.3	[89.5]	296.2	[86.8]	27.6					
	Sens BTUH [kW]	258.3	[75.7]	217.3	[63.7]	210.9	[61.8]	296.5	[86.9]	249.4	[73.1]	242.0	[70.9]	332.0	[97.3]	279.3	[81.9]	271.0	[79.4]	348.2	[102.0]	292.9	[85.8]	284.2	[83.3]	362.9	[106.3]	305.3	[89.5]	296.2	[86.8]	27.6											
80 [26.7]	Total BTUH [kW]	400.7	[117.4]	373.3	[109.4]	368.9	[108.1]	382.9	[112.2]	356.7	[104.5]	352.6	[103.3]	370.7	[108.6]	345.4	[101.2]	341.4	[100.0]	367.6	[107.7]	342.4	[100.3]	338.4	[99.2]	367.0	[107.5]	341.8	[100.2]	337.9	[99.0]	360.6	[105.7]	303.4	[88.9]	294.3	[86.2]	28.2					
	Sens BTUH [kW]	256.1	[75.0]	215.4	[63.1]	209.0	[61.2]	294.2	[86.2]	247.5	[72.5]	240.1	[70.4]	329.8	[96.6]	277.4	[81.3]	269.2	[78.9]	345.9	[101.4]	291.0	[85.3]	282.4	[82.7]	360.6	[105.7]	303.4	[88.9]	294.3	[86.2]	28.2											
85 [29.4]	Total BTUH [kW]	395.0	[115.8]	368.0	[107.8]	363.7	[106.6]	377.3	[110.6]	351.4	[103.0]	347.3	[101.8]	365.1	[107.0]	340.1	[99.7]	336.1	[98.5]	361.9	[106.1]	337.1	[98.8]	333.2	[97.6]	361.3	[105.9]	336.6	[98.6]	332.6	[97.5]	358.1	[104.9]	301.2	[88.3]	292.3	[85.6]	28.9					
	Sens BTUH [kW]	253.5	[74.3]	213.3	[62.5]	207.0	[60.6]	291.7	[85.5]	245.4	[71.9]	238.1	[69.8]	327.2	[95.9]	275.3	[80.7]	267.1	[78.3]	343.4	[100.6]	288.9	[84.7]	280.3	[82.1]	358.1	[104.9]	301.2	[88.3]	292.3	[85.6]	28.9											
90 [32.2]	Total BTUH [kW]	388.9	[114.0]	362.2	[106.2]	358.0	[104.9]	371.1	[108.7]	345.7	[101.3]	341.7	[100.1]	358.9	[105.2]	334.3	[98.0]	330.4	[96.8]	355.7	[104.2]	331.4	[97.1]	327.5	[96.0]	355.1	[104.1]	330.8	[96.9]	327.0	[95.8]	355.1	[104.1]	298.9	[87.6]	290.0	[80.5]	29.6					
	Sens BTUH [kW]	250.8	[73.5]	211.0	[61.8]	204.7	[60.0]	288.9	[84.7]	243.0	[71.2]	235.8	[69.1]	324.5	[95.1]	273.0	[80.0]	264.8	[77.6]	340.6	[99.8]	286.6	[84.0]	278.0	[81.5]	355.1	[104.1]	298.9	[87.6]	290.0	[80.5]	29.6											
95 [35]	Total BTUH [kW]	382.2	[112.0]	356.0	[104.3]	351.9	[103.1]	364.4	[106.8]	339.5	[99.5]	335.5	[98.3]	352.2	[103.2]	328.1	[96.2]	324.3	[95.0]	349.1	[102.3]	325.2	[95.3]	321.4	[94.2]	348.5	[102.1]	324.6	[95.1]	320.8	[94.0]	348.5	[102.1]	296.3	[86.8]	287.5	[84.2]	30.3					
	Sens BTUH [kW]	247.7	[72.6]	208.4	[61.1]	202.2	[59.3]	285.9	[83.8]	240.5	[70.5]	233.3	[68.4]	321.4	[94.2]	270.4	[79.2]	262.3	[76.9]	337.6	[99.9]	284.0	[83.2]	275.5	[80.7]	348.5	[102.1]	296.3	[86.8]	287.5	[84.2]	30.3											
100 [37.8]	Total BTUH [kW]	375.1	[109.9]	349.4	[102.4]	345.3	[101.2]	357.3	[104.7]	332.8	[97.5]	329.0	[96.4]	345.1	[101.1]	321.5	[94.2]	317.8	[93.1]	341.9	[100.2]	318.5	[93.3]	314.8	[92.3]	341.3	[100.0]	318.0	[93.2]	314.3	[92.1]	341.3	[100.0]	293.5	[86.0]	284.8	[83.5]	31.2					
	Sens BTUH [kW]	244.4	[71.6]	205.6	[60.3]	199.5	[58.5]	282.6	[82.8]	237.7	[69.7]	230.6	[67.6]	318.1	[93.2]	267.6	[78.4]	259.6	[76.1]	334.3	[98.0]	281.2	[82.4]	272.8	[80.0]	341.3	[100.0]	293.5	[86.0]	284.8	[83.5]	31.2											
105 [40.6]	Total BTUH [kW]	367.5	[107.7]	342.3	[100.3]	338.3	[99.1]	349.7	[102.5]	325.7	[95.5]	322.0	[94.3]	337.5	[98.9]	314.4	[92.1]	310.7	[91.1]	334.3	[98.0]	311.4	[91.3]	307.8	[90.2]	333.7	[97.8]	310.9	[91.1]	307.3	[90.0]	333.7	[97.8]	290.5	[85.1]	281.9	[82.6]	32.1					
	Sens BTUH [kW]	240.8	[70.6]	202.6	[59.4]	196.6	[57.6]	279.0	[81.8]	234.7	[68.8]	227.7	[66.7]	314.5	[92.2]	264.6	[77.5]	256.7	[75.2]	330.7	[96.9]	278.2	[81.5]	269.9	[79.1]	333.7	[97.8]	290.5	[85.1]	281.9	[82.6]	32.1											
110 [43.3]	Total BTUH [kW]	359.4	[105.3]	334.8	[98.1]	330.9	[97.0]	341.6	[100.1]	318.2	[93.2]	314.5	[92.2]	329.4	[96.5]	306.8	[89.9]	303.3	[88.9]	326.2	[95.6]	303.9	[89.1]	300.4	[88.0]	325.6	[95.4]	303.3	[88.9]	299.8	[87.9]	325.6	[95.4]	287.3	[84.2]	278.8	[81.7]	33.1					
	Sens BTUH [kW]	237.0	[69.5]	199.4	[58.4]	193.5	[56.7]	275.2	[80.6]	231.5	[67.8]	224.6	[65.8]	310.7	[91.1]	261.4	[76.6]	253.6	[74.3]	326.2	[95.6]	275.0	[80.6]	266.8	[78.2]	325.6	[95.4]	287.3	[84.2]	278.8	[81.7]	33.1											
115 [46.1]	Total BTUH [kW]	350.8	[102.8]	326.8	[95.8]	323.0	[94.6]	333.0	[97.6]	310.2	[90.9]	306.6	[89.8]	320.8	[94.0]	298.8	[87.6]	295.4	[86.6]	317.6	[93.1]	295.9	[86.7]	292.5	[85.7]	317.0	[92.9]	295.3	[86.5]	291.9	[85.5]	317.0	[92.9]	283.9	[83.2]	275.4	[80.7]	34.1					
	Sens BTUH [kW]	232.9	[68.3]	196.0	[57.4]	190.1	[55.7]	271.1	[79.4]	228.0	[66.8]	221.3	[64.8]	306.6	[89.9]	258.0	[75.6]	250.3	[73.3]	317.6	[93.1]	271.6	[79.6]	263.5	[77.2]	317.0	[92.9]	283.9	[83.2]	275.4	[80.7]	34.1											
120 [48.9]	Total BTUH [kW]	341.7	[100.1]	318.3	[93.3]	314.6	[92.2]	323.9	[94.9]	301.7	[88.4]	298.2	[87.4]	311.7	[91.3]	290.4	[85.1]	287.0	[84.1]	308.6	[90.4]	287.4	[84.2]	284.1	[83.3]	308.0	[90.2]	286.9	[84.1]	283.5	[83.1]	308.0	[90.2]	280.2	[82.1]	271.9	[79.7]	35.2					
	Sens BTUH [kW]	228.6	[67.0]	192.3	[56.4]	186.6	[54.7]	266.7	[78.2]	224.4	[65.8]	217.7	[63.8]	302.3	[88.6]	254.3	[74.5]	246.7	[72.3]	308.6	[90.4]	267.9	[78.5]	259.9	[76.2]	308.0	[90.2]	280.2	[82.1]	271.9	[79.7]	35.2											
125 [51.7]	Total BTUH [kW]	332.1	[97.3]	309.4	[90.7]	305.8	[89.6]	314.4	[92.1]	292.8	[85.8]	289.4	[84.8]	302.2	[88.5]	281.5	[82.5]	278.2	[81.5]	299.0	[87.6]	278.5	[81.6]	275.3	[80.7]	298.4	[87.4]	278.0	[81.5]	274.7	[80.5]	298.4	[87.4]	276.4	[81.0]	268.1	[78.6]	36.3					
	Sens BTUH [kW]	224.0	[65.6]	188.4	[55.2]	182.8	[53.6]	262.1	[76.8]	220.5	[64.6]	213.9	[62.7]	297.7	[87.2]	250.4	[73.4]	243.0	[71.2]	299.0	[87.6]	264.0	[77.4]	256.2	[75.1]	298.4	[87.4]	276.4	[81.0]	268.1	[78.6]	36.3											

DR —Depression ratio
dbE —Entering air dry bulb
wbE —Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[] Designates Metric Conversions

COOLING PERFORMANCE DATA — RACH5U360ACH

wB/E		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①												61°F [16.1°C]				59°F [15.0°C]													
		71°F [21.7°C]				67°F [19.4°C]				63°F [17.2°C]																					
		CFM [L/s]		13200 [6230]		9400 [4436]		8800 [4153]		13200 [6230]		9400 [4436]		8800 [4153]		13200 [6230]		9400 [4436]		8800 [4153]		13200 [6230]		9400 [4436]		8800 [4153]					
DR ①		0.14		0.08		0.07		0.08		0.14		0.08		0.07		0.14		0.08		0.07		0.14		0.08		0.07					
75 [23.9]	Total BTUH [kW]	405.9	[118.9]	378.1	[110.8]	373.7	[109.5]	388.1	[113.7]	361.6	[106.0]	357.4	[104.7]	375.9	[110.2]	350.2	[102.6]	346.1	[101.4]	372.8	[109.2]	347.3	[101.8]	343.2	[100.6]	372.2	[109.1]	346.7	[101.6]	342.7	[100.4]
	Sens BTUH [kW]	258.3	[75.7]	217.3	[63.7]	210.9	[61.8]	296.5	[86.9]	249.4	[73.1]	242.0	[70.9]	332.0	[97.3]	279.3	[81.9]	271.0	[79.4]	348.2	[102.0]	292.9	[85.8]	284.2	[83.3]	362.9	[106.3]	305.3	[89.5]	296.2	[86.8]
	Power	29.3		28.3		28.1		29.1		28.1		29.1		27.9		29.0		27.8		28.9		28.9		27.7		28.8		27.8		27.8	
80 [26.7]	Total BTUH [kW]	400.7	[117.4]	373.3	[109.4]	368.9	[108.1]	382.9	[112.2]	356.7	[104.5]	352.6	[103.3]	370.7	[108.6]	345.4	[101.2]	341.4	[100.0]	367.6	[107.7]	342.4	[100.3]	338.4	[99.2]	367.0	[107.5]	341.8	[100.2]	337.9	[99.0]
	Sens BTUH [kW]	256.1	[75.0]	215.4	[63.1]	209.0	[61.2]	294.2	[86.2]	247.5	[72.5]	240.1	[70.4]	329.8	[96.6]	277.4	[81.3]	269.2	[78.9]	345.9	[101.4]	291.0	[85.3]	282.4	[82.7]	360.6	[105.7]	303.4	[88.9]	294.3	[86.2]
	Power	29.9		28.8		28.7		29.7		28.7		29.7		28.5		29.6		28.5		29.5		28.5		28.3		29.4		28.4		28.4	
85 [29.4]	Total BTUH [kW]	395.0	[115.8]	368.0	[107.8]	363.7	[106.6]	377.3	[110.6]	351.4	[103.0]	347.3	[101.8]	365.1	[107.0]	340.1	[99.7]	336.1	[98.5]	361.9	[106.1]	337.1	[98.8]	333.2	[97.6]	361.3	[105.9]	336.6	[98.6]	332.6	[97.5]
	Sens BTUH [kW]	253.5	[74.3]	213.3	[62.5]	207.0	[60.6]	291.7	[85.5]	245.4	[71.9]	238.1	[69.8]	327.2	[95.9]	275.3	[80.7]	267.1	[78.3]	343.4	[100.6]	288.9	[84.7]	280.3	[82.1]	358.1	[104.9]	301.2	[88.3]	292.3	[85.6]
	Power	30.5		29.5		29.3		30.4		29.3		30.4		29.2		30.2		29.2		29.0		30.1		28.9		30.1		29.0		29.0	
90 [32.2]	Total BTUH [kW]	388.9	[114.0]	362.2	[106.2]	358.0	[104.9]	371.1	[108.7]	345.7	[101.3]	341.7	[100.1]	358.9	[105.2]	334.3	[98.0]	330.4	[96.8]	355.7	[104.2]	331.4	[97.1]	327.5	[96.0]	355.1	[104.1]	330.8	[96.9]	327.0	[95.8]
	Sens BTUH [kW]	250.8	[73.5]	211.0	[61.8]	204.7	[60.0]	288.9	[84.7]	243.0	[71.2]	235.8	[69.1]	324.5	[95.1]	273.0	[80.0]	264.8	[77.6]	340.6	[99.8]	286.6	[84.0]	278.0	[81.5]	355.1	[104.1]	298.9	[87.6]	290.0	[85.0]
	Power	31.3		30.2		30.0		31.1		30.0		31.1		29.9		31.0		29.9		29.7		30.9		29.6		30.8		29.7		29.7	
95 [35]	Total BTUH [kW]	382.2	[112.0]	356.0	[104.3]	351.9	[103.1]	364.4	[106.8]	339.5	[99.5]	335.5	[98.3]	352.2	[103.2]	328.1	[96.2]	324.3	[95.0]	349.1	[102.3]	325.2	[95.3]	321.4	[94.2]	348.5	[102.1]	324.6	[95.1]	320.8	[94.0]
	Sens BTUH [kW]	247.7	[72.6]	208.4	[61.1]	202.2	[59.3]	285.9	[83.8]	240.5	[70.5]	233.3	[68.4]	321.4	[94.2]	270.4	[79.2]	262.3	[76.9]	337.6	[98.9]	284.0	[83.2]	275.5	[80.7]	348.5	[102.1]	296.3	[86.8]	287.5	[84.2]
	Power	32.1		31.0		30.8		31.9		30.8		31.9		30.6		31.8		30.7		30.5		31.7		30.6		30.4		31.6		30.5	
100 [37.8]	Total BTUH [kW]	375.1	[109.9]	349.4	[102.4]	345.3	[101.2]	357.3	[104.7]	332.8	[97.5]	329.0	[96.4]	345.1	[101.1]	321.5	[94.2]	317.8	[93.1]	341.9	[100.2]	318.5	[93.3]	314.8	[92.3]	341.3	[100.0]	318.0	[93.2]	314.3	[92.1]
	Sens BTUH [kW]	244.4	[71.6]	205.6	[60.3]	199.5	[58.5]	282.6	[82.8]	237.7	[69.7]	230.6	[67.6]	318.1	[93.2]	267.6	[78.4]	259.6	[76.1]	334.3	[98.0]	281.2	[82.4]	272.8	[80.0]	341.3	[100.0]	293.5	[86.0]	284.8	[83.5]
	Power	32.9		31.8		31.6		32.8		31.7		32.8		31.5		32.6		31.5		31.3		32.6		31.4		31.3		32.5		31.4	
105 [40.6]	Total BTUH [kW]	367.5	[107.7]	342.3	[100.3]	338.3	[99.1]	349.7	[102.5]	325.7	[95.5]	322.0	[94.3]	337.5	[98.9]	314.4	[92.1]	310.7	[91.1]	334.3	[98.0]	311.4	[91.3]	307.8	[90.2]	333.7	[97.8]	310.9	[91.1]	307.3	[90.0]
	Sens BTUH [kW]	240.8	[70.6]	202.6	[59.4]	196.6	[57.6]	279.0	[81.8]	234.7	[68.8]	227.7	[66.7]	314.5	[92.2]	264.6	[77.5]	256.7	[75.2]	330.7	[96.9]	278.2	[81.5]	269.9	[79.1]	333.7	[97.8]	290.5	[85.1]	281.9	[82.6]
	Power	33.9		32.7		32.5		33.7		32.6		33.7		32.4		33.6		32.4		32.2		33.5		32.3		32.2		33.4		32.3	
110 [43.3]	Total BTUH [kW]	359.4	[105.3]	334.8	[98.1]	330.9	[97.0]	341.6	[100.1]	318.2	[93.2]	314.5	[92.2]	329.4	[96.5]	306.8	[89.9]	303.3	[88.9]	326.2	[95.6]	303.9	[89.1]	300.4	[88.0]	325.6	[95.4]	303.3	[88.9]	299.8	[87.9]
	Sens BTUH [kW]	237.0	[69.5]	199.4	[58.4]	193.5	[56.7]	275.2	[80.6]	231.5	[67.8]	224.6	[65.8]	310.7	[91.1]	261.4	[76.6]	253.6	[74.3]	326.2	[95.6]	275.0	[80.6]	266.8	[78.2]	325.6	[95.4]	287.3	[84.2]	278.8	[81.7]
	Power	34.9		33.7		33.5		34.7		33.5		34.7		33.4		34.6		33.4		33.2		34.5		33.3		33.1		34.4		33.2	
115 [46.1]	Total BTUH [kW]	350.8	[102.8]	326.8	[95.8]	323.0	[94.6]	333.0	[97.6]	310.2	[90.9]	306.6	[89.8]	320.8	[94.0]	298.8	[87.6]	295.4	[86.6]	317.6	[93.1]	295.9	[86.7]	292.5	[85.7]	317.0	[92.9]	295.3	[86.5]	291.9	[85.5]
	Sens BTUH [kW]	232.9	[68.3]	196.0	[57.4]	190.1	[55.7]	271.1	[79.4]	228.0	[66.8]	221.3	[64.8]	306.6	[89.9]	258.0	[75.6]	250.3	[73.3]	317.6	[93.1]	271.6	[79.6]	263.5	[77.2]	317.0	[92.9]	283.9	[83.2]	275.4	[80.7]
	Power	36.0		34.7		34.5		35.8		34.6		35.8		34.4		35.7		34.4		34.2		35.6		34.4		35.5		35.5		34.3	
120 [48.9]	Total BTUH [kW]	341.7	[100.1]	318.3	[93.3]	314.6	[92.2]	323.9	[94.9]	301.7	[88.4]	298.2	[87.4]	311.7	[91.3]	290.4	[85.1]	287.0	[84.1]	308.6	[90.4]	287.4	[84.2]	284.1	[83.3]	308.0	[90.2]	286.9	[84.1]	283.5	[83.1]
	Sens BTUH [kW]	228.6	[67.0]	192.3	[56.4]	186.6	[54.7]	266.7	[78.2]	224.4	[65.8]	217.7	[63.8]	302.3	[88.6]	254.3	[74.5]	246.7	[72.3]	308.6	[90.4]	267.9	[78.5]	259.9	[76.2]	308.0	[90.2]	280.2	[82.1]	271.9	[79.7]
	Power	37.1		35.8		35.6		37.0		35.7		35.7		35.5		36.8		35.5		35.3		36.7		35.5		35.3		36.6		35.4	
125 [51.7]	Total BTUH [kW]	332.1	[97.3]	309.4	[90.7]	305.8	[89.6]	314.4	[92.1]	292.8	[85.8]	289.4	[84.8]	302.2	[88.5]	281.5	[82.5]	278.2	[81.5]	299.0	[87.6]	278.5	[81.6]	275.3	[80.7]	298.4	[87.4]	278.0	[81.5]	274.7	[80.5]
	Sens BTUH [kW]	224.0	[65.6]	188.4	[55.2]	182.8	[53.6]	262.1	[76.8]	220.5	[64.6]	213.9	[62.7]	297.7	[87.2]	250.4	[73.4]	243.0	[71.2]	299.0	[87.6]	264.0	[77.4]	256.2	[75.1]	298.4	[87.4]	276.4	[81.0]	268.1	[78.6]
	Power	38.3		37.0		36.8		38.2		36.8		36.8		36.6		38.0		36.7		36.5		37.9		36.6		36.4		37.8		36.3	

DR — Depression ratio
dbE — Entering air dry bulb
wbE — Entering air wet bulb

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 – DR) x (dbE – 80)].

[] Designates Metric Conversions

Total — Total capacity x 1000 BTUH
Sens — Sensible capacity x 1000 BTUH
Power — KW input

AIRFLOW PERFORMANCE— 27.5 TON [94.9 kW] — DOWNFLOW

Air Flow CFM [L/s]		Model RACHS360A		Voltage 208/230, 460, 575 — 3 phase 60 Hz		External Static Pressure—Inches of Water [kPa]																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																												
		0.1 [.02]	0.2 [.05]	0.3 [.07]	0.4 [.10]	0.5 [.12]	0.6 [.15]	0.7 [.17]	0.8 [.20]	0.9 [.22]	1.0 [.25]	1.1 [.27]	1.2 [.30]	1.3 [.32]	1.4 [.35]	1.5 [.37]	1.6 [.40]	1.7 [.42]	1.8 [.45]	1.9 [.47]	2.0 [.50]																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																													
RPM BHP		RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP	RPM BHP

NOTE: F-Drive left of the bold line, G-Drive right of bold lines.

Drive Package	F					G					H				
Motor H.P. [W]	7.5 [5592.7]					10 [7457.0]					15 [11185.5]				
Blower Sheave	BK130H					BK120H					BK190H				
Motor Sheave	1VP-71					1VP-75					1VP71				
Turns Open	0	1	2	3	4	5	6	0	1	2	3	4	5	6	
RPM	—	932	—	—	—	852	—	798	—	1066	—	984	—	1151	
										1246				1083	

AIRFLOW PERFORMANCE—27.5 TON [94.9 kW] — DOWNFLOW

CFM [L/s]	8000	8400	8800	9200	9600	10000	10400	10800	11200	11600	12000	12400	12800	13200	13600
	[3775]	[3964]	[4153]	[4341]	[4530]	[4719]	[4908]	[5096]	[5285]	[5474]	[5663]	[5851]	[6040]	[6229]	[6418]
	Resistance — Inches of Water [kPa]														
Wet Coil	0.07 [.02]	0.09 [.02]	0.10 [.02]	0.12 [.03]	0.13 [.03]	0.15 [.04]	0.16 [.04]	0.18 [.04]	0.19 [.05]	0.21 [.05]	0.22 [.05]	0.24 [.06]	0.25 [.06]	0.27 [.07]	0.28 [.07]
Downflow	0.12 [.03]	0.14 [.03]	0.16 [.04]	0.19 [.05]	0.22 [.05]	0.25 [.06]	0.29 [.07]	0.33 [.08]	0.37 [.09]	0.42 [.10]	0.46 [.11]	0.51 [.13]	0.57 [.14]	0.62 [.15]	0.68 [.17]
Downflow Economizer RA Damper Open	0.22 [.05]	0.24 [.06]	0.26 [.06]	0.28 [.07]	0.30 [.07]	0.32 [.08]	0.34 [.08]	0.37 [.09]	0.39 [.10]	0.41 [.10]	0.44 [.11]	0.46 [.11]	0.49 [.12]	0.52 [.13]	0.54 [.13]
Horizontal Economizer RA Damper Open	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]	0.20 [.05]	0.21 [.05]	0.22 [.05]	0.23 [.06]
Concentric Grill RXRN-AD88 & Transition RXMC-CL09	0.17 [.04]	0.23 [.06]	0.30 [.07]	0.36 [.09]	0.43 [.11]	0.50 [.12]	0.56 [.14]	0.63 [.16]	0.69 [.17]	0.76 [.19]	0.82 [.20]	0.89 [.22]	0.96 [.24]	1.02 [.25]	1.09 [.27]

AIRFLOW CORRECTION FACTORS—27.5 TON [94.9 kW] — DOWNFLOW

CFM	8000	8400	8800	9200	9600	10000	10400	10800	11200	11600	12000	12400	12800	13200	13600
[L/s]	[3775]	[3964]	[4153]	[4341]	[4530]	[4719]	[4908]	[5096]	[5285]	[5474]	[5663]	[5851]	[6040]	[6229]	[6418]
Total MBH	0.97	0.98	0.99	1.00	1.00	1.01	1.02	1.03	1.03	1.04	1.05	1.06	1.07	1.07	1.08
Sensible MBH	0.93	0.95	0.97	0.99	1.01	1.03	1.05	1.07	1.09	1.11	1.13	1.15	1.17	1.19	1.21
Power kW	0.99	0.99	0.99	1.00	1.00	1.01	1.01	1.01	1.02	1.02	1.02	1.03	1.03	1.04	1.04

NOTE: Multiply correction factor times gross performance data — resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE— 27.5 TON [94.9 kW] — 60 Hz — SIDEFLOW

Model RACH5U360A		Voltage 208/230, 460, 575 — 3 phase 60 Hz																			
Air Flow CFM [L/s]	RPM	External Static Pressure—Inches of Water [kPa]																			
		0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM
8000 [3775]	—	—	—	—	—	—	—	—	794	4.46	813	4.69	832	4.93	851	5.16	870	5.40	889	5.63	908
8200 [3869]	—	—	—	—	—	—	—	—	805	4.71	824	4.95	843	5.18	862	5.42	881	5.66	900	5.90	918
8400 [3964]	—	—	—	—	—	—	—	798	4.73	817	4.97	836	5.21	855	5.45	873	5.70	892	5.94	911	6.18
8600 [4058]	—	—	—	—	—	—	792	4.76	811	5.00	829	5.25	848	5.49	866	5.74	885	5.98	903	6.23	922
8800 [4153]	—	—	—	—	—	—	804	5.02	829	5.29	841	5.54	860	5.79	878	6.04	897	6.29	915	6.54	933
9000 [4247]	—	—	—	—	—	—	817	5.34	835	5.59	854	5.85	872	6.10	890	6.35	908	6.60	927	6.86	945
9200 [4341]	—	—	—	—	794	5.15	812	5.40	830	5.65	848	5.91	866	6.16	884	6.42	903	6.68	921	6.93	939
9400 [4436]	—	—	—	789	5.21	807	5.46	825	5.72	843	5.98	861	6.24	879	6.50	897	6.76	915	7.02	933	7.28
9600 [4530]	—	—	—	803	5.54	821	5.80	838	6.06	856	6.32	874	6.58	892	6.85	910	7.11	928	7.37	946	7.64
9800 [4624]	—	—	799	5.62	817	5.88	834	6.15	852	6.41	870	6.68	888	6.94	905	7.21	923	7.47	941	7.74	958
10000 [4719]	795	5.70	813	5.97	831	6.24	848	6.51	866	6.78	884	7.05	901	7.31	919	7.58	936	7.85	954	8.12	971
10200 [4813]	810	6.07	828	6.34	845	6.61	863	6.88	880	7.16	898	7.43	915	7.70	932	7.97	950	8.25	967	8.52	985
10400 [4908]	825	6.45	842	6.72	860	7.00	877	7.27	894	7.55	912	7.83	929	8.10	946	8.38	964	8.66	981	8.93	998
10600 [5002]	840	6.84	857	7.12	875	7.40	892	7.68	909	7.96	926	8.24	943	8.52	960	8.80	977	9.08	995	9.36	1012
10800 [5096]	855	7.25	873	7.53	890	7.81	907	8.10	924	8.38	941	8.66	958	8.95	975	9.23	992	9.51	1009	9.80	1025
11000 [5191]	871	7.67	888	7.96	905	8.24	922	8.53	939	8.82	956	9.10	972	9.39	989	9.68	1006	9.96	1023	10.25	1040
11200 [5285]	887	8.11	904	8.40	920	8.69	937	8.98	954	9.27	971	9.56	987	9.85	1004	10.14	1021	10.43	1037	10.72	1054
11400 [5379]	903	8.56	919	8.85	936	9.14	953	9.44	969	9.73	996	10.02	1002	10.32	1019	10.61	1035	10.91	1062	11.20	1068
11600 [5474]	919	9.02	935	9.32	952	9.61	968	9.91	985	10.21	1001	10.51	1018	10.80	1034	11.10	1050	11.40	1067	11.70	1083
11800 [5568]	935	9.50	952	9.80	968	10.10	984	10.40	1001	10.70	1017	11.00	1033	11.30	1049	11.60	1066	11.91	1082	12.21	1098
12000 [5663]	952	9.99	968	10.30	984	10.60	1000	10.90	1017	11.21	1033	11.51	1049	11.82	1065	12.12	1081	12.43	1097	12.73	1113
12200 [5757]	969	10.50	985	10.81	1001	11.11	1017	11.42	1033	11.73	1049	12.04	1065	12.34	1081	12.65	1097	12.96	1112	13.27	1128
12400 [5851]	986	11.02	1002	11.33	1017	11.64	1033	11.95	1049	12.26	1065	12.57	1081	12.89	1097	13.20	1112	13.51	1128	13.82	1144
12600 [5946]	1003	11.55	1019	11.87	1034	12.18	1050	12.50	1066	12.81	1082	13.13	1097	13.44	1113	13.76	1128	14.07	1144	14.39	1160
12800 [6040]	1020	12.10	1036	12.42	1062	12.74	1067	13.06	1083	13.37	1098	13.69	1114	14.01	1129	14.33	1145	14.65	1160	14.97	1176
13000 [6134]	1038	12.67	1053	12.99	1069	13.31	1084	13.63	1100	13.95	1115	14.27	1131	14.60	1146	14.92	1161	15.24	1177	15.57	1192
13200 [6229]	1056	13.24	1071	13.57	1086	13.89	1102	14.22	1117	14.54	1132	14.87	1148	15.20	1163	15.52	1178	15.85	1193	16.18	1208
13400 [6323]	1074	13.83	1089	14.16	1104	14.49	1119	14.82	1135	15.15	1150	15.48	1165	15.81	1180	16.14	1195	16.47	1210	16.80	1225

NOTE: F-Drive left of the bold line, G-Drive right of bold lines.

Drive Package	F					G					H				
Motor H.P. [W]	7.5 [5592.7]					10 [7457.0]					15 [11185.5]				
Blower Sheave	BK130H					BK120H					BK190H				
Motor Sheave	1VP-71					1VP-75					1VP71				
Turns Open	0	1	2	3	4	5	6	0	1	2	3	4	5	6	
RPM	—	919	894	689	844	817	790	—	1067	1039	1012	982	953	925	1098

- NOTES: 1. Factory sheave settings are shown in bold type.
2. Do not set motor sheave below minimum or maximum turns open shown.
3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.
4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

[] Designates Metric Conversions

AIRFLOW PERFORMANCE—27.5 TON [94.9 kW] — 60 Hz — SIDEFLOW (Con't.)

CFM [L/s]	8000	8400	8800	9200	9600	10000	10400	10800	11200	11600	12000	12400	12800	13200	13600
	[3775]	[3964]	[4153]	[4341]	[4530]	[4719]	[4908]	[5096]	[5285]	[5474]	[5663]	[5851]	[6040]	[6229]	[6418]
	Resistance — Inches of Water [kPa]														
Wet Coil	0.07 [.02]	0.09 [.02]	0.10 [.02]	0.12 [.03]	0.13 [.03]	0.15 [.04]	0.16 [.04]	0.18 [.04]	0.19 [.05]	0.21 [.05]	0.22 [.05]	0.24 [.06]	0.25 [.06]	0.27 [.07]	0.28 [.07]
Downflow	0.12 [.03]	0.14 [.03]	0.16 [.04]	0.19 [.05]	0.22 [.05]	0.25 [.06]	0.29 [.07]	0.33 [.08]	0.37 [.09]	0.42 [.10]	0.46 [.11]	0.51 [.13]	0.57 [.14]	0.62 [.15]	0.68 [.17]
Downflow Economizer RA Damper Open	0.22 [.05]	0.24 [.06]	0.26 [.06]	0.28 [.07]	0.30 [.07]	0.32 [.08]	0.34 [.08]	0.37 [.09]	0.39 [.10]	0.41 [.10]	0.44 [.11]	0.46 [.11]	0.49 [.12]	0.52 [.13]	0.54 [.13]
Horizontal Economizer RA Damper Open	0.09 [.02]	0.10 [.02]	0.11 [.03]	0.12 [.03]	0.13 [.03]	0.14 [.03]	0.15 [.04]	0.16 [.04]	0.17 [.04]	0.18 [.04]	0.19 [.05]	0.20 [.05]	0.21 [.05]	0.22 [.05]	0.23 [.06]
Concentric Grill RXRN-AD88 & Transition RXMC-CL09	0.17 [.04]	0.23 [.06]	0.30 [.07]	0.36 [.09]	0.43 [.11]	0.50 [.12]	0.56 [.14]	0.63 [.16]	0.69 [.17]	0.76 [.19]	0.82 [.20]	0.89 [.22]	0.96 [.24]	1.02 [.25]	1.09 [.27]

AIRFLOW CORRECTION FACTORS—27.5 TON [94.9 kW] — SIDEFLOW

CFM	8000	8400	8800	9200	9600	10000	10400	10800	11200	11600	12000	12400	12800	13200	13600
[L/s]	[3775]	[3964]	[4153]	[4341]	[4530]	[4719]	[4908]	[5096]	[5285]	[5474]	[5663]	[5851]	[6040]	[6229]	[6418]
Total MBH	0.97	0.98	0.99	1.00	1.00	1.01	1.02	1.03	1.03	1.04	1.05	1.06	1.07	1.07	1.08
Sensible MBH	0.93	0.95	0.97	0.99	1.01	1.03	1.05	1.07	1.09	1.11	1.13	1.15	1.17	1.19	1.21
Power kW	0.99	0.99	0.99	1.00	1.00	1.01	1.01	1.01	1.02	1.02	1.02	1.03	1.03	1.04	1.04

NOTE: Multiply correction factor times gross performance data — resulting sensible capacity cannot exceed total capacity.

[] Designates Metric Conversions

ELECTRICAL DATA - WITHOUT POWERED EXHAUST - RACH5U SERIES

		360ACF	360ACG	360ACH	360ADF	360ADG
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	208/230	460	460
	Phase	3	3	3	3	3
	Hz	60	60	60	60	60
	Minimum Circuit Ampacity	163/163	169/169	181/181	72	75
	Minimum Overcurrent Protection Device Size	200/200	200/200	200/200	80	90
	Maximum Overcurrent Protection Device Size	200/200	225/225	225/225	90	100
Compressor Motor	No.	2	2	2	2	2
	Volts	200/230	200/230	200/230	460	460
	Phase	3	3	3	3	3
	RPM	3500	3500	3500	3500	3500
	HP, Compressor 1	15	15	15	15	15
	Amps (RLA), Comp. 1	57.8	57.8	57.8	25	25
	Amps (LRA), Comp. 1	386.3	386.3	386.3	182	182
	HP, Compressor 2	10	10	10	10	10
	Amps (RLA), Comp. 2	43.7	43.7	43.7	16.5	16.5
	Amps (LRA), Comp. 2	240	240	240	140	140
Condenser Motor	No.	6	6	6	6	6
	Volts	208/230	208/230	208/230	460	460
	Phase	1	1	1	1	1
	HP	3/4	3/4	3/4	3/4	3/4
	Amps (FLA, each)	4.2	4.2	4.2	2.3	2.3
	Amps (LRA, each)	10.1	10.1	10.1	4.9	4.9
Evaporator Fan	No.	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460
	Phase	3	3	3	3	3
	HP	7 1/2	10	15	7 1/2	10
	Amps (FLA, each)	21	27	39.5	9.6	12.5
	Amps (LRA, each)	127	152	210	63.5	76

ELECTRICAL DATA - WITHOUT POWERED EXHAUST - RACH5U SERIES

		360ADH	360AYF	360AYG	360AYH
Unit Information	Unit Operating Voltage Range	414-506	517-633	517-633	517-633
	Volts	460	575	575	575
	Phase	3	3	3	3
	Hz	60	60	60	60
	Minimum Circuit Ampacity	80	50	52	56
	Minimum Overcurrent Protection Device Size	90	60	60	70
Compressor Motor	Maximum Overcurrent Protection Device Size	100	60	70	70
	No.	2	2	2	2
	Volts	460	575	575	575
	Phase	3	3	3	3
	RPM	3500	3500	3500	3500
	HP, Compressor 1	15	15	15	15
	Amps (RLA), Comp. 1	25	18.8	18.8	18.8
	Amps (LRA), Comp. 1	182	131	131	131
	HP, Compressor 2	10	10	10	10
Condenser Motor	Amps (RLA), Comp. 2	16.5	12.9	12.9	12.9
	Amps (LRA), Comp. 2	140	107.6	107.6	107.6
	No.	6	6	6	6
	Volts	460	575	575	575
	Phase	1	1	1	1
	HP	3/4	3/4	3/4	3/4
Evaporator Fan	Amps (FLA, each)	2.3	1.2	1.2	1.2
	Amps (LRA, each)	4.9	3.4	3.4	3.4
	No.	1	1	1	1
	Volts	460	575	575	575
	Phase	3	3	3	3
	HP	15	7 1/2	10	15
	Amps (FLA, each)	18	7.7	10	13.8
	Amps (LRA, each)	105	50.8	60.8	93.6

ELECTRICAL DATA - WITH POWERED EXHAUST - RACH5U SERIES

		360ACF	360ACG	360ACH	360ADF	360ADG
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506
	Volts	208/230	208/230	208/230	460	460
	Phase	3	3	3	3	3
	Hz	60	60	60	60	60
	Minimum Circuit Ampacity	173/173	179/179	191/191	76	79
	Minimum Overcurrent Protection Device Size	200/200	200/200	225/225	90	90
	Maximum Overcurrent Protection Device Size	225/225	225/225	225/225	100	100
Compressor Motor	No.	2	2	2	2	2
	Volts	200/230	200/230	200/230	460	460
	Phase	3	3	3	3	3
	RPM	3500	3500	3500	3500	3500
	HP, Compressor 1	15	15	15	15	15
	Amps (RLA), Comp. 1	57.8	57.8	57.8	25	25
	Amps (LRA), Comp. 1	386.3	386.3	386.3	182	182
	HP, Compressor 2	10	10	10	10	10
	Amps (RLA), Comp. 2	43.7	43.7	43.7	16.5	16.5
	Amps (LRA), Comp. 2	240	240	240	140	140
Condenser Motor	No.	6	6	6	6	6
	Volts	208/230	208/230	208/230	460	460
	Phase	1	1	1	1	1
	HP	3/4	3/4	3/4	3/4	3/4
	Amps (FLA, each)	4.2	4.2	4.2	2.3	2.3
	Amps (LRA, each)	10.1	10.1	10.1	4.9	4.9
Evaporator Fan	No.	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460
	Phase	3	3	3	3	3
	HP	7 1/2	10	15	7 1/2	10
	Amps (FLA, each)	21	27	39.5	9.6	12.5
	Amps (LRA, each)	127	152	210	63.5	76

ELECTRICAL DATA - WITH POWERED EXHAUST - RACH5U SERIES

		360ADH	360AYF	360AYG	360AYH
Unit Information	Unit Operating Voltage Range	414-506	517-633	517-633	517-633
	Volts	460	575	575	575
	Phase	3	3	3	3
	Hz	60	60	60	60
	Minimum Circuit Ampacity	84	53	55	59
	Minimum Overcurrent Protection Device Size	100	60	60	70
Compressor Motor	Maximum Overcurrent Protection Device Size	100	70	70	70
	No.	2	2	2	2
	Volts	460	575	575	575
	Phase	3	3	3	3
	RPM	3500	3500	3500	3500
	HP, Compressor 1	15	15	15	15
	Amps (RLA), Comp. 1	25	18.8	18.8	18.8
	Amps (LRA), Comp. 1	182	131	131	131
	HP, Compressor 2	10	10	10	10
Condenser Motor	Amps (RLA), Comp. 2	16.5	12.9	12.9	12.9
	Amps (LRA), Comp. 2	140	107.6	107.6	107.6
	No.	6	6	6	6
	Volts	460	575	575	575
	Phase	1	1	1	1
	HP	3/4	3/4	3/4	3/4
Evaporator Fan	Amps (FLA, each)	2.3	1.2	1.2	1.2
	Amps (LRA, each)	4.9	3.4	3.4	3.4
	No.	1	1	1	1
	Volts	460	575	575	575
	Phase	3	3	3	3
	HP	15	7 1/2	10	15
	Amps (FLA, each)	18	7.7	10	13.8
	Amps (LRA, each)	105	50.8	60.8	93.6

MANUAL MOTOR STARTER AMP SETPOINT

	Motor Part No.	51-102826-10	51-102826-11	51-107478-01	51-107478-02
	Motor HP	10	10	15	15
Motor Nameplate Amps	208V	27.0	—	39.5	—
	230V	25.0	—	36.0	—
	460V	12.5	—	18.0	—
	575V	—	10.0	—	14.4
Motor SF amps	208V	31.1	—	45.4	—
	230V	28.8	—	41.4	—
	460V	14.4	—	20.7	—
	575V	—	11.5	—	16.6
Manual Motor Starter Amp Range	208/230V	25.0-32.0	—	40.0-54.0	—
	460V	10.0-16.0	—	20.0-25.0	—
	575V	—	8.0-12.0	—	16.0-20.0
Ruud Part No.	208/230V	42-107877-05	—	42-107877-06	—
	460V	42-107877-02	—	42-107877-04	—
	575V	—	42-107877-01	—	42-107877-03
Manual Motor Starter Amp Setpoint	208V	32.0*	—	47.0*	—
	230V	30.0	—	43.0	—
	460V	15.0	—	22.0	—
	575V	—	12.0	—	17.0
Ruud Model No.	208/230V	RGEH5U360ACG RACH5U360ACG	—	RGEH5U360ACH RACH5U360ACH	—
	460V	RGEH5U360ADG RACH5U360ADG	—	RGEH5U360ADH RACH5U360ADH	—
	575V	—	RGEH5U360AYG RACH5U360AYG	—	RGEH5U360AYH RACH5U360AYH

*NOTE: Units ship from factory set for 230 volt operation. Setpoint must be adjusted for 208 volt operation.

HEATER KIT DATA—WITHOUT POWERED EXHUAUST

208/230V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit						Separate Power Supply For Both Unit and Heater Kit			
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ-	Rated Heater kW @ 208/230	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360ACF	NONE*	—/—	—/—	152/152	200/200	—	—	152/152	200/200
	CE40C+	28.8/38.3	79.9/92.2	152/152	200/200	100/116	100/125	152/152	200/200
	CE60C+	43.2/57.5	119.9/138.3	181/204	200/225	150/173	150/175	152/152	200/200
	CE75C+	54.0/71.9	149.8/172.8	218/247	225/250	188/216	200/225	152/152	200/200
(-)ACH5U360ACG	NONE*	—/—	—/—	159/159	200/200	—	—	159/159	200/200
	CE40C+	28.8/38.3	79.9/92.2	159/159	200/200	100/116	100/125	159/159	200/200
	CE60C+	43.2/57.5	119.9/138.3	189/212	200/225	150/173	150/175	159/159	200/200
	CE75C+	54.0/71.9	149.8/172.8	226/255	250/300	188/216	200/225	159/159	200/200
(-)ACH5U360ACH	NONE*	—/—	—/—	174/174	225/225	—	—	174/174	225/225
	CE40C+	28.8/38.3	79.9/92.2	174/174	225/225	100/116	100/125	174/174	225/225
	CE60C+	43.2/57.5	119.9/138.3	208/231	225/250	150/173	150/175	174/174	225/225
	CE75C+	54.0/71.9	149.8/172.8	245/274	250/300	188/216	200/225	174/174	225/225

460V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit						Separate Power Supply For Both Unit and Heater Kit			
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ-	Rated Heater kW @ 460	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360ADF	NONE*	—	—	73	90	—	—	73	90
	CE40D+	38.4	46.2	73	90	58	60	73	90
	CE60D+	57.6	69.3	101	110	87	90	73	90
	CE75D+	72	86.6	122	125	109	110	73	90
(-)ACH5U360ADG	NONE*	—	—	76	100	—	—	76	100
	CE40D+	38.4	46.2	76	100	58	60	76	100
	CE60D+	57.6	69.3	105	110	87	90	76	100
	CE75D+	72	86.6	126	150	109	110	76	100
(-)ACH5U360ADH	NONE*	—	—	83	100	—	—	83	100
	CE40D+	38.4	46.2	84	100	58	60	83	100
	CE60D+	57.6	69.3	113	125	87	90	83	100
	CE75D+	72	86.6	135	150	109	110	83	100

HEATER KIT DATA—WITHOUT POWERED EXHAUST (Con't.)

575V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit						Separate Power Supply For Both Unit and Heater Kit			
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ-	Rated Heater kW @ 575	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360AYF	NONE*	—	—	53	70	—	—	53	70
	CE40Y+	38.4	37	58	70	47	50	53	70
	CE60Y+	57.6	55.4	81	90	70	70	53	70
	CE75Y+	72	69.3	98	100	87	90	53	70
(-)ACH5U360AYG	NONE*	—	—	55	70	—	—	55	70
	CE40Y+	38.4	37	60	70	47	50	55	70
	CE60Y+	57.6	55.4	83	90	70	70	55	70
	CE75Y+	72	69.3	101	110	87	90	55	70
(-)ACH5U360AYH	NONE*	—	—	61	70	—	—	61	70
	CE40Y+	38.4	37	68	70	47	50	61	70
	CE60Y+	57.6	55.4	91	100	70	70	61	70
	CE75Y+	72	69.3	108	110	87	90	61	70

HEATER KIT DATA—WITH POWERED EXHAUST

208/230V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit						Separate Power Supply For Both Unit and Heater Kit			
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ—	Rated Heater kW @ 208/230	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360ACF	NONE*	—/—	—/—	162/162	200/200	—	—	162/162	200/200
	CE40C+	28.8/38.3	79.9/92.2	162/162	200/200	100/116	100/125	162/162	200/200
	CE60C+	43.2/57.5	119.9/138.3	191/216	200/225	150/173	150/175	162/162	200/200
	CE75C+	54.0/71.9	149.8/172.8	228/259	250/300	188/216	200/225	162/162	200/200
(-)ACH5U360ACG	NONE*	—/—	—/—	169/169	200/200	—	—	169/169	200/200
	CE40C+	28.8/38.3	79.9/92.2	169/169	200/200	100/116	100/125	169/169	200/200
	CE60C+	43.2/57.5	119.9/138.3	199/224	225/225	150/173	150/175	169/169	200/200
	CE75C+	54.0/71.9	149.8/172.8	236/267	250/300	188/216	200/225	169/169	200/200
(-)ACH5U360ACH	NONE*	—/—	—/—	184/184	225/225	—	—	184/184	225/225
	CE40C+	28.8/38.3	79.9/92.2	184/186	225/225	100/116	100/125	184/184	225/225
	CE60C+	43.2/57.5	119.9/138.3	218/244	225/250	150/173	150/175	184/184	225/225
	CE75C+	54.0/71.9	149.8/172.8	255/287	300/300	188/216	200/225	184/184	225/225

460V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit						Separate Power Supply For Both Unit and Heater Kit			
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ-	Rated Heater kW @ 460	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360ADF	NONE*	—	—	77	100	—	—	77	100
	CE40D+	38.4	46.2	77	100	58	60	77	100
	CE60D+	57.6	69.3	105	110	87	90	77	100
	CE75D+	72	86.6	127	150	109	110	77	100
(-)ACH5U360ADG	NONE*	—	—	80	100	—	—	80	100
	CE40D+	38.4	46.2	80	100	58	60	80	100
	CE60D+	57.6	69.3	109	110	87	90	80	100
	CE75D+	72	86.6	131	150	109	110	80	100
(-)ACH5U360ADH	NONE*	—	—	87	110	—	—	87	110
	CE40D+	38.4	46.2	89	110	58	60	87	110
	CE60D+	57.6	69.3	118	125	87	90	87	110
	CE75D+	72	86.6	139	150	109	110	87	110

HEATER KIT DATA—WITH POWERED EXHAUST (Con't.)

575V, THREE PHASE, 60 Hz, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION									
Single Power Supply For Both Unit and Heater Kit					Separate Power Supply For Both Unit and Heater Kit				
Unit Model No.	Heater Kit			Air Conditioner (Including Heater Kits)		Heater Kit		Air Conditioner	
	Model No. RXJJ-	Rated Heater kW @ 575	FLA	Unit Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)	Min. Ckt. Ampacity	Max. Fuse Or Ckt. Bkr. Size (Ckt. Bkr. Must Be HACR Type For USA)
(-)ACH5U360AYF	NONE*	—	—	56	70	—	—	56	70
	CE40Y+	38.4	37	61	70	47	50	56	70
	CE60Y+	57.6	55.4	84	90	70	70	56	70
	CE75Y+	72	69.3	101	110	87	90	56	70
(-)ACH5U360AYG	NONE*	—	—	58	70	—	—	58	70
	CE40Y+	38.4	37	63	70	47	50	58	70
	CE60Y+	57.6	55.4	86	90	70	70	58	70
	CE75Y+	72	69.3	104	110	87	90	58	70
(-)ACH5U360AYH	NONE*	—	—	64	80	—	—	64	80
	CE40Y+	38.4	37	71	80	47	50	64	80
	CE60Y+	57.6	55.4	94	100	70	70	64	80
	CE75Y+	72	69.3	111	125	87	90	64	80

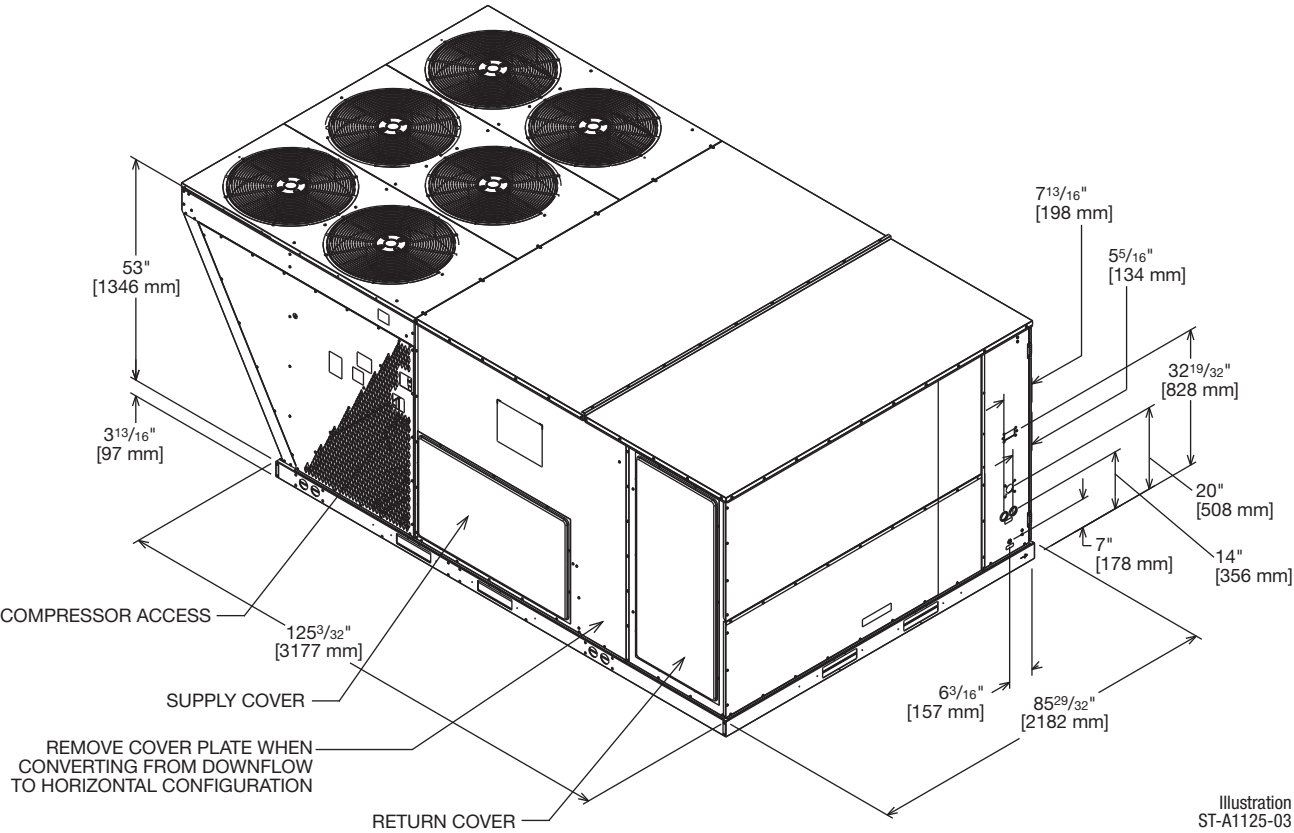


Illustration
ST-A1125-03



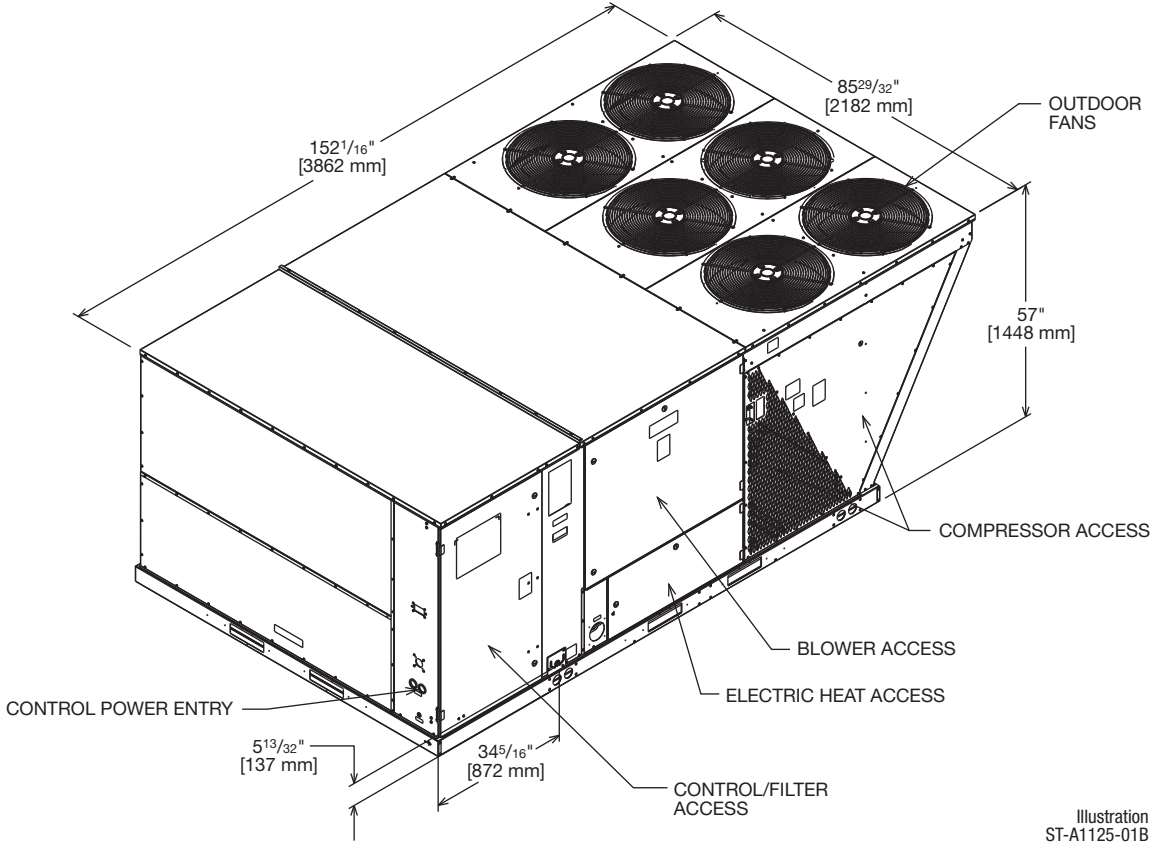


Illustration
ST-A1125-01B

[] Designates Metric Conversions

WEIGHTS

CORNER WEIGHTS BY PERCENTAGE			
A	B	C	D
32%	27%	16%	24%

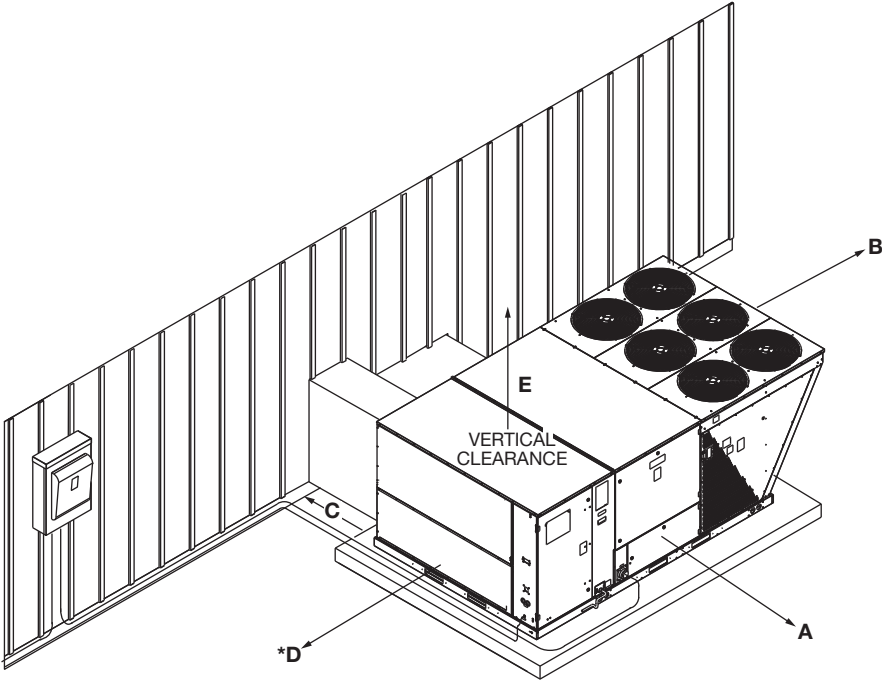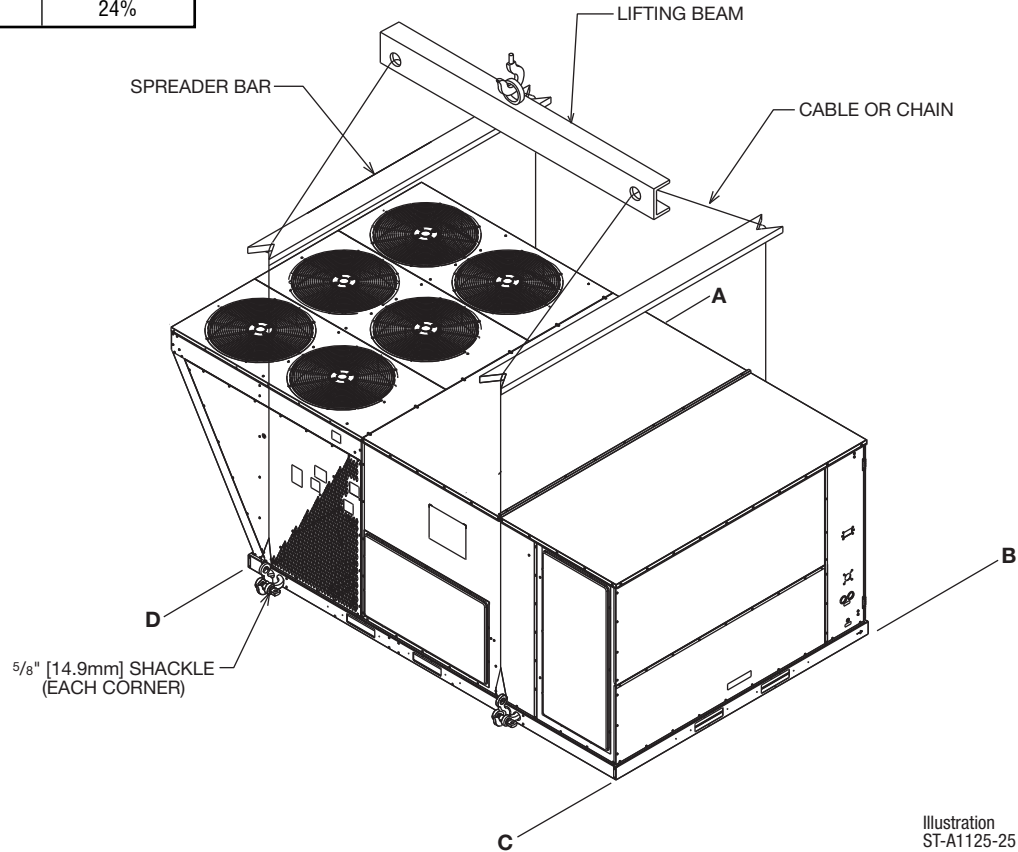

CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.

RECOMMENDED CLEARANCE	LOCATION
80"	A – FRONT
18"	B – CONDENSER COIL
18/42"	+C – DUCT SIDE
18/48"	*D – EVAPORATOR END
60"	E – ABOVE

*Without Economizer/48" With Economizer

FIELD INSTALLED ACCESSORY EQUIPMENT

Accessory	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Economizer w/Single Enthalpy (Downflow)	AXRD-01RGDAM3	324 [149.6]	184 [83.4]	Yes
Economizer w/Single Enthalpy (Horizontal)	AXRD-01RGHAM3	367 [166.4]	258 [117.0]	No
Dual Enthalpy Kit	RXXR-AV02	1 [0.5]	0.5 [0.2]	No
Carbon Dioxide Sensor (Wall Mount)	RXXR-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust (230V)	RXXR-BGF05C	119 [53.9]	59 [26.7]	No
Power Exhaust (460V)	RXXR-BGF05D	119 [53.9]	59 [26.7]	No
Power Exhaust (575V)	RXXR-BGF05Y	119 [53.9]	59 [26.7]	No
Manual Fresh Air Damper	AXRF-KFA1	61 [27.7]	52 [23.6]	No
2-Position Motorized Kit for Fresh Air Damper	RXRF-AW03	42 [19.1]	35 [15.9]	No
Modulating Motor Kit for AXRF-KFA1	RXRF-AW05	45 [20.4]	38 [17.2]	No
Roofcurb, 14"	RXKG-CBH14	184 [83.5]	176 [79.8]	No
Concentric Diffuser (Step-Down, 18" x 36")	RXRN-AD81	310 [140.6]	157 [71.2]	No
Concentric Diffuser (Step-Down, 24" x 48")	RXRN-AD86	367 [166.4]	212 [96.1]	No
Concentric Diffuser (Step-Down, 28" x 60")	RXRN-AD88	410 [186.0]	370 [67.8]	No
Concentric Diffuser (Flush, 18" x 36")	RXRN-AD80	213 [96.6]	115 [52.2]	No
Downflow Transition (Rect. To Rect., 18" x 36")	RXMC-CJ07	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. To Rect., 24" x 48")	RXMC-CK08	81 [36.7]	74 [33.6]	No
Downflow Transition (Rect. To Rect., 28" x 60")	RXMC-CL09	81 [36.7]	74 [33.6]	No
BACnet Communication Card	RXXR-AY01	1 [0.5]	1 [0.5]	No
LonWorks Communication Card	RXXR-AY02	1 [0.5]	1 [0.5]	No
Room Humidity Sensor	RHC-ZNS4	1 [0.5]	1 [0.5]	No
Room Temperature and Relative Humidity Sensor	RHC-ZNS5	1 [0.5]	1 [0.5]	No
Low-Ambient Control Kit DDC (1 Per Compressor)	RXRZ-C02	3 [1.4]	2 [1.0]	No
Freeze Stat Kit	RXXR-AM05	3 [1.4]	2 [1.0]	Yes
Unwired Convenience Outlet	RXXR-AN01	2 [1.0]	1.5 [0.7]	Yes
Hail Guard Louvers	AXRX-AAD01L	55 [24.8]	45 [20.3]	Yes
Return Smoke Detector (Downflow/Vertical)	RXXR-BSH1	7 [3.2]	6 [2.7]	Yes
Return Smoke Detector (Horizontal)	RXXR-BSH2	7 [3.2]	6 [2.7]	Yes
Return/Supply Smoke Detector (Downflow/Vertical)	RXXR-BSH3	10 [4.5]	9 [4.1]	Yes
Return/Supply Smoke Detector (Horizontal)	RXXR-BSH4	10 [4.5]	9 [4.1]	Yes
Electric Heater Kits C - 208 / 230-240- V D - 480 V Y - 600 V	RXJJ-CE20 (C,D,Y)	41 [18.6]	31 [14.1]	Yes
	RXJJ-CE40 (C,D,Y)	44 [20.0]	34 [15.4]	Yes
	RXJJ-CE60 (C,D,Y)	45 [20.4]	35 [15.9]	Yes
	RXJJ-CE75 (C,D,Y)	46 [20.8]	36 [16.3]	Yes
MERV 8 Filter	RXMF-M08A22520	2 [0.9]	1 [0.45]	Yes
MERV 13 Filter	RXMF-M13A22520	2 [0.9]	1 [0.45]	Yes

[] Designates Metric Conversions

FLUSH MOUNT ROOM TEMPERATURE SENSORS FOR NETWORKED DDC APPLICATIONS



ROOM TEMPERATURE SENSOR ZNS-101 **with TIMED OVERRIDE BUTTON**

10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



ROOM TEMPERATURE SENSOR ZNS-102 **with TIMED OVERRIDE BUTTON and STATUS INDICATOR**

10k Ω room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



ROOM TEMPERATURE SENSOR ZNS-103 **with SETPOINT ADJUSTMENT and TIMED OVERRIDE BUTTON**

10k Ω room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.

COMMUNICATION CARDS

Field Installed



BACnet® COMMUNICATION CARD RXRX-AY01

The field installed BACnet® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the BACnet Application Specific Controller device profile. The BACnet® Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network.



LonWorks® COMMUNICATION CARD RXRX-AY02


The field installed LonWorks® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks Network.

NON-DDC ECONOMIZER FOR DOWNFLOW DUCT INSTALLATION


Use to Select Factory Installed Options Only

AXRD-01RMDCM3—Single Enthalpy (Outdoor)
RXXR-AV04—Dual Enthalpy Upgrade Kit
RXXR-AR02—Optional Wall-Mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Downflow Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock
- Field Installed Power Exhaust Available

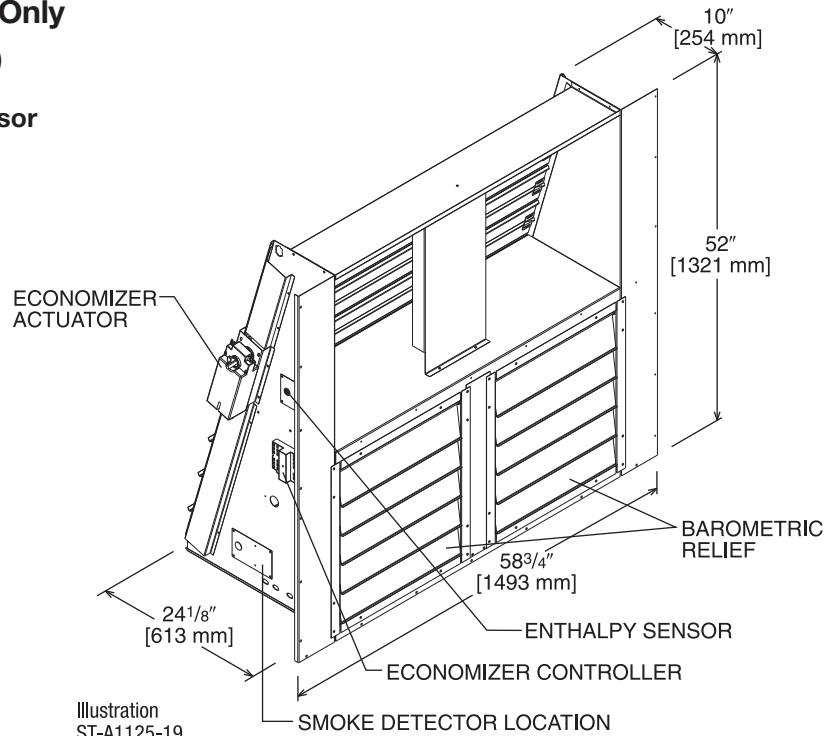

TOLERANCE ± .125

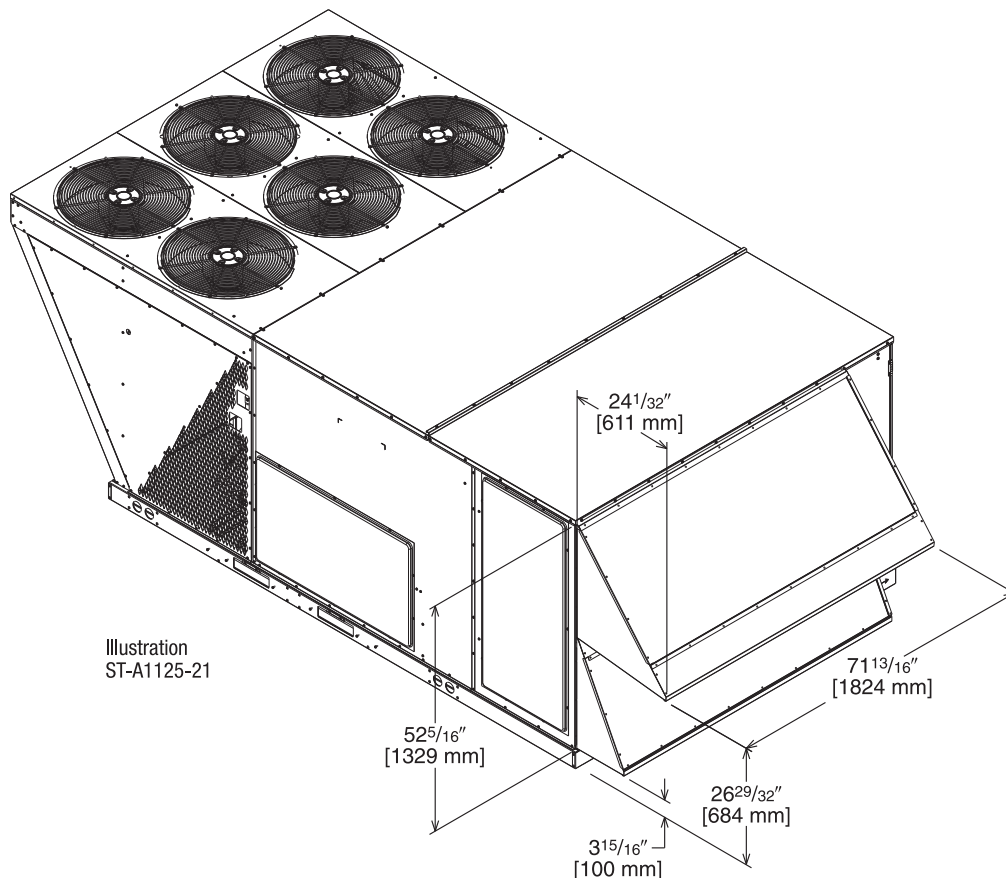

[] Designates Metric Conversions

NON-DDC ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION


Field Installed Only

AXRD-01RMHCM3—Single Enthalpy (Outdoor) with DDC


RXXR-AV04—Dual Enthalpy Upgrade Kit

RXXR-AR02—Wall-mounted CO₂ Sensor

- Features **Honeywell** Controls
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO₂ Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- Field Installed Power Exhaust Available

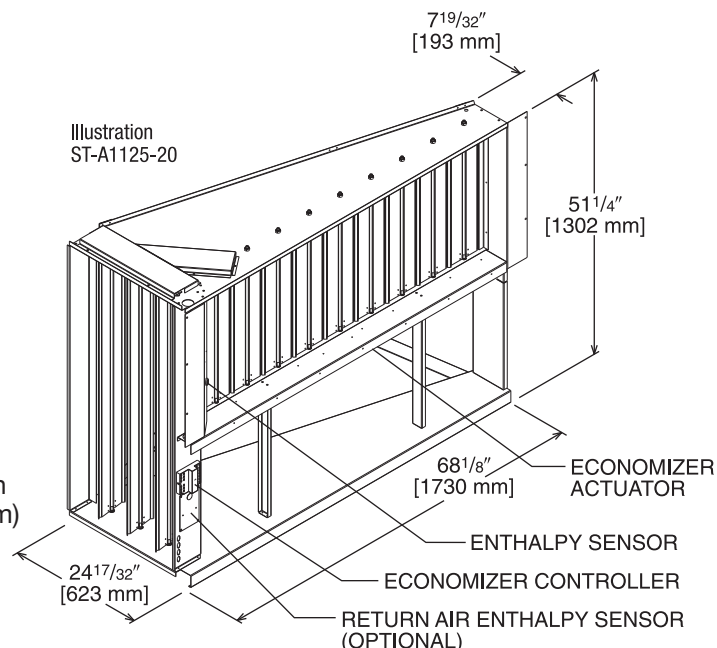

TOLERANCE $\pm .125$

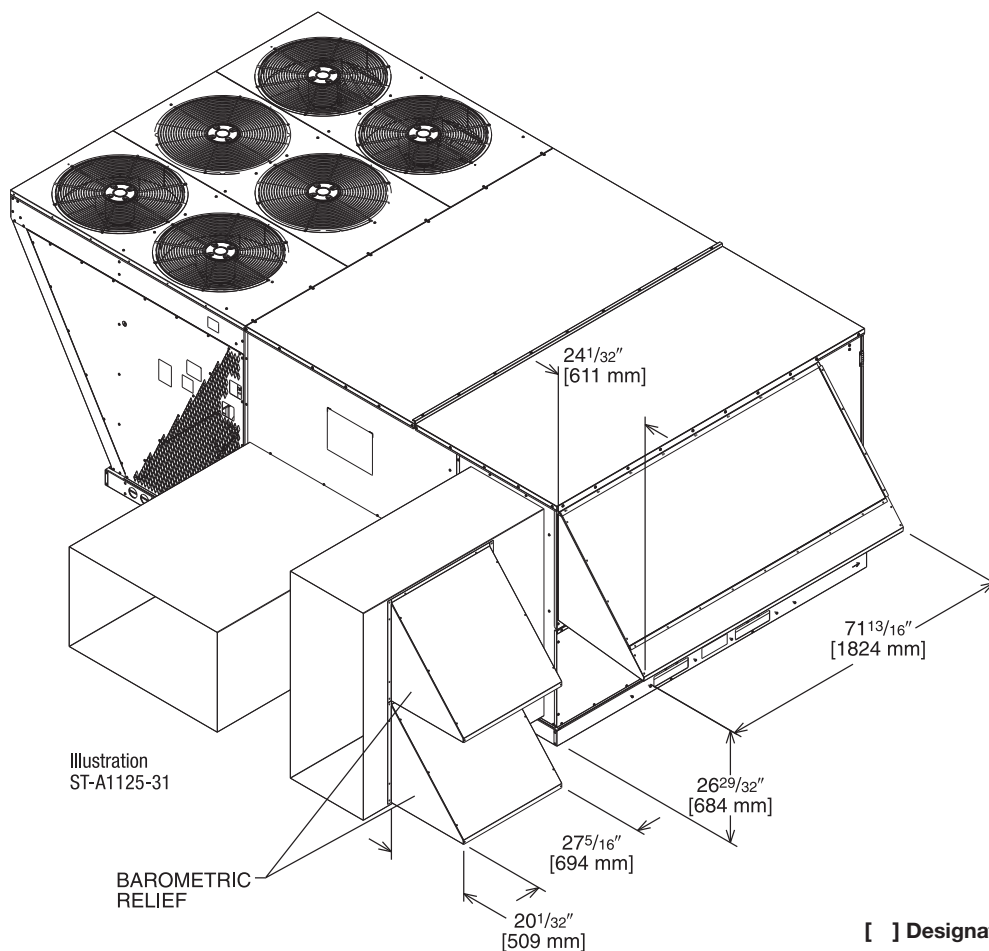


[] Designates Metric Conversions

INTEGRAL POWER EXHAUST KIT

RXRX-BGF05 (C, D, or Y*)

*Voltage Code

VERTICAL AIRFLOW

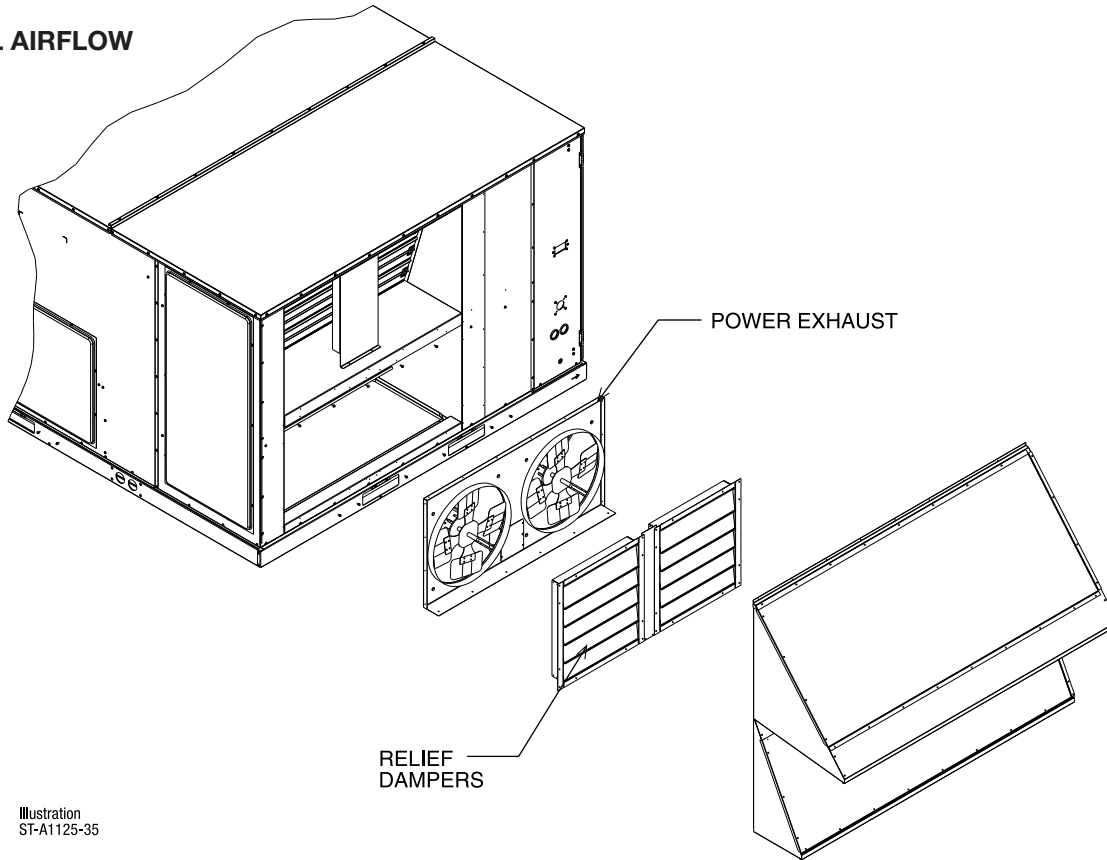

Model No.	No. of Fans	Volts	Phase	HP (ea.)	Low Speed		High Speed ①		FLA (ea.)	LRA (ea.)
					CFM [L/s] ②	RPM	CFM [L/s] ②	RPM		
RXRX-BGF05C	2	208-230	1	0.75	4100 [1935]	850	5200 [2454]	1050	5	4.97
RXRX-BGF05D	2	460	1	0.75	4100 [1935]	850	5200 [2454]	1050	2.2	3.4
RXRX-BGF05Y	2	575	1	0.75	4100 [1935]	850	5200 [2454]	1050	1.5	2.84

NOTES: ① Power exhaust is factory set on high speed motor tap.

② CFM is per fan at 0" w.c. external static pressure.

FRESH AIR DAMPER

MOTORIZED DAMPER KIT


RXRX-AW03

(Motor Kit for AXRF-KFA1)

RXRX-AW05

(Modulating Motor Kit with
position feedback for AXRF-KFA1)

- Features **Honeywell** Controls
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Addition of Dual Enthalpy Upgrade Kit allows limited economizer function
- CO₂ Sensor Input Available for Demand Control Ventilation (DCV)
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- All fresh air damper functions can be viewed at the RTU-C unit controller display

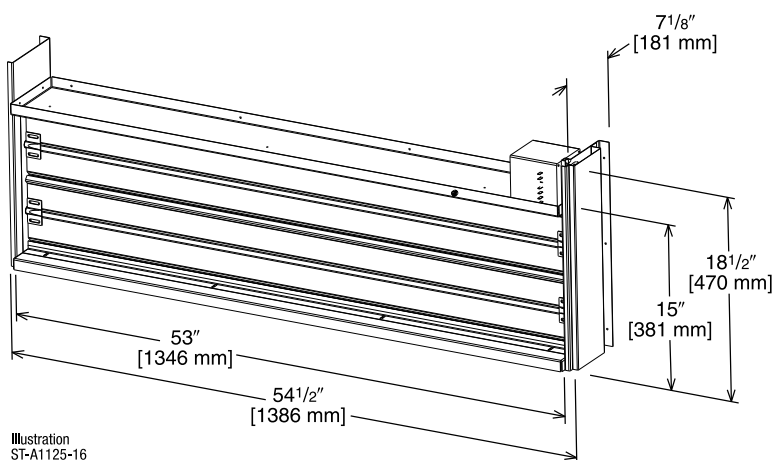

AXRF-KFA1 (Manual)

AXRX-AW03 (Motorized damper kit for manual fresh air damper)

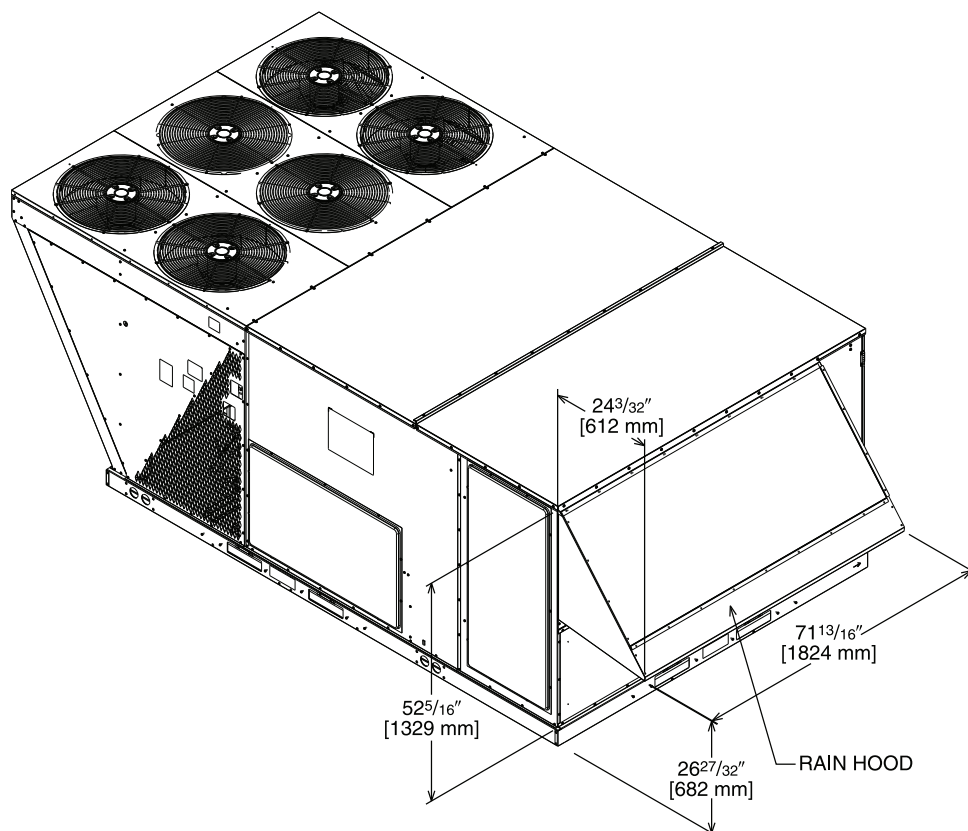



Illustration
ST-A1125-17

[] Designates Metric Conversions

ROOFCURBS (Full Perimeter)

- One available height (14" [356 mm])
- Quick assembly corners for simple and fast assembly
- 1" [25.4 mm] x 4" [102 mm] Nailer provided
- Insulating panels not required because of insulated outdoor base pan
- Sealing gasket (28" [711 mm]) provided with Roofcurb
- Packaged for easy field assembly

ROOFCURB INSTALLATION

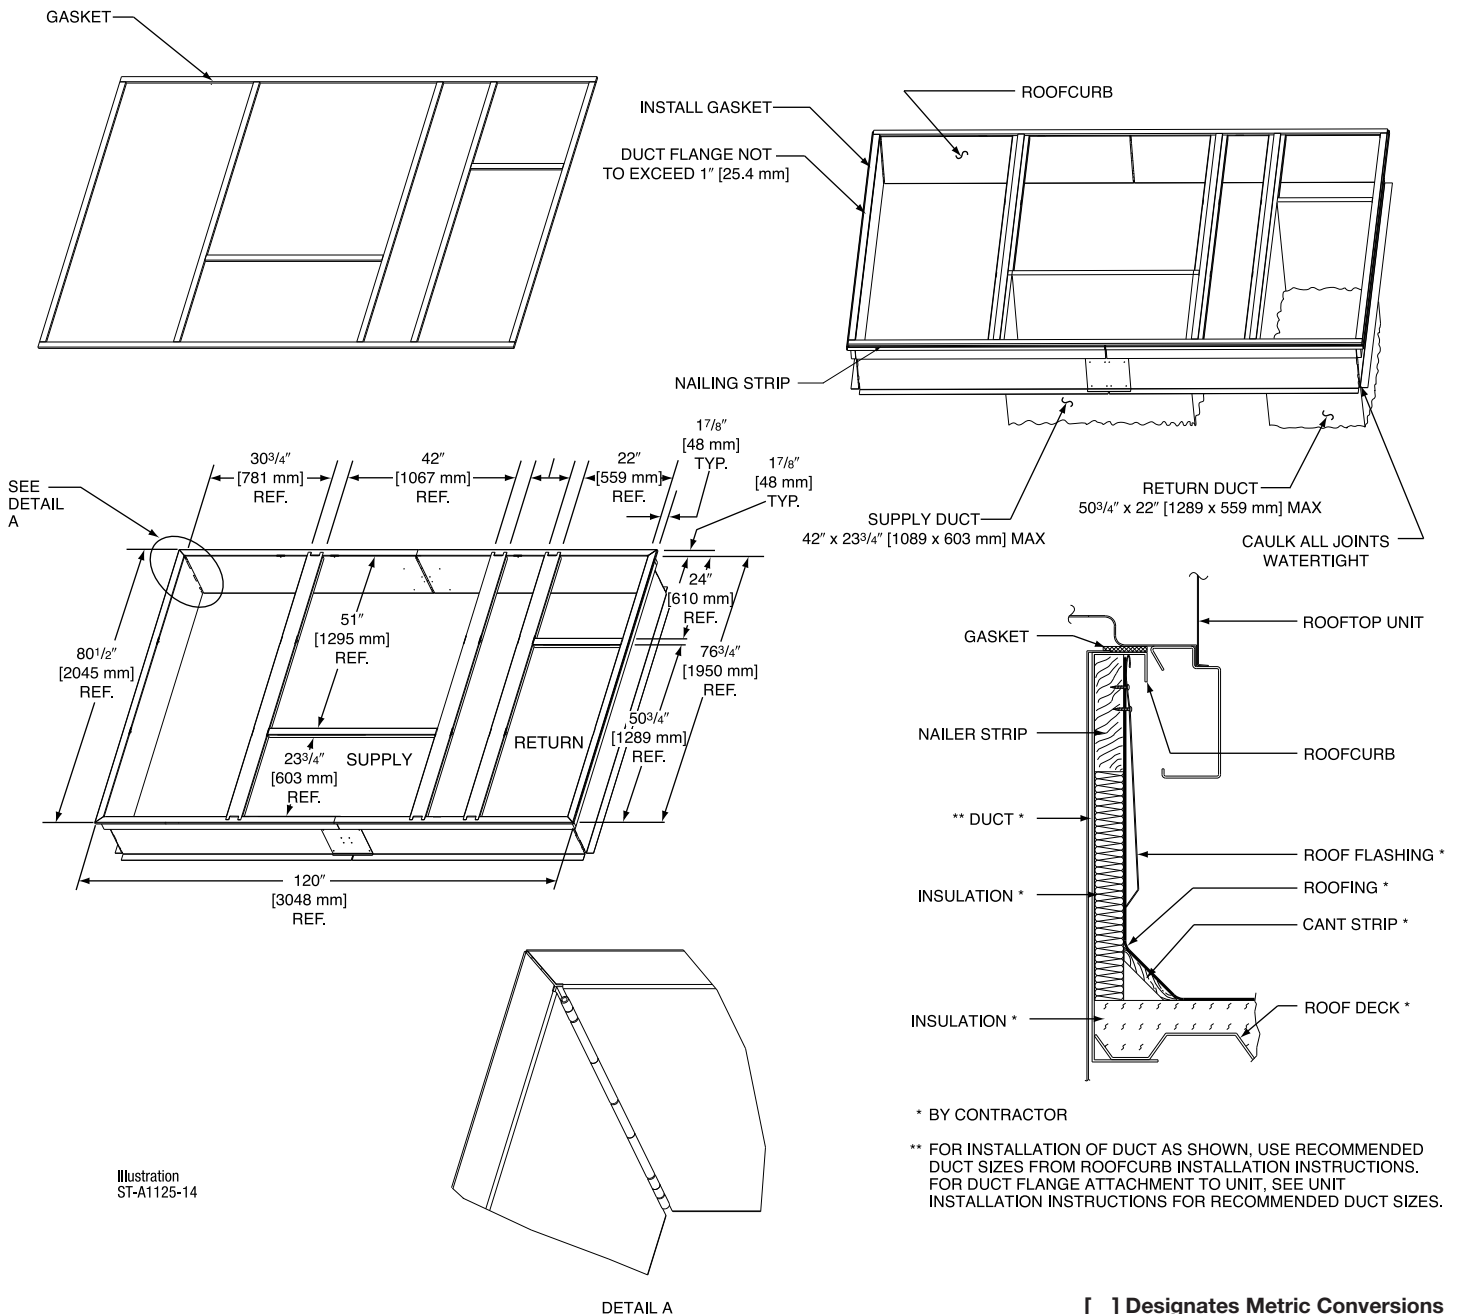

[] Designates Metric Conversions

ROOFCURB ADAPTERS

COMMERCIAL CABINET
(12.5, 15 & 20 TON)
([44, 52.8 & 70.3 kW])
(-)RCF, (-)RGF, (-)REF


RXRK-E56

ROOFCURB ADAPTER

RXRX-CJCE56

NEW MODEL

(-)ACH
30 TON
96.7 kW

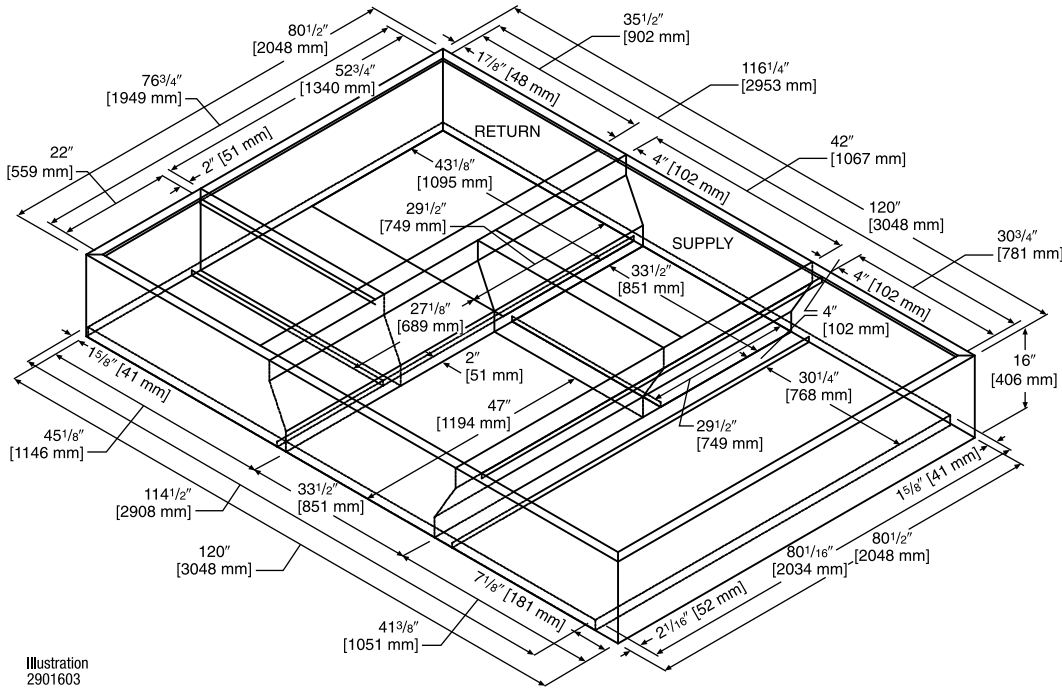


COMMERCIAL CABINET
(15, 20 & 25 TON)
([52.8, 70.3 & 87.9 kW])
(-)LKB, LMB, LNB (COOLING ONLY)
(-)KKB, KMB, KNB (GAS/ELECTRIC)

RXKG-CAF14

RXRX-CJCF14

(-)ACH
30 TON
96.7 kW

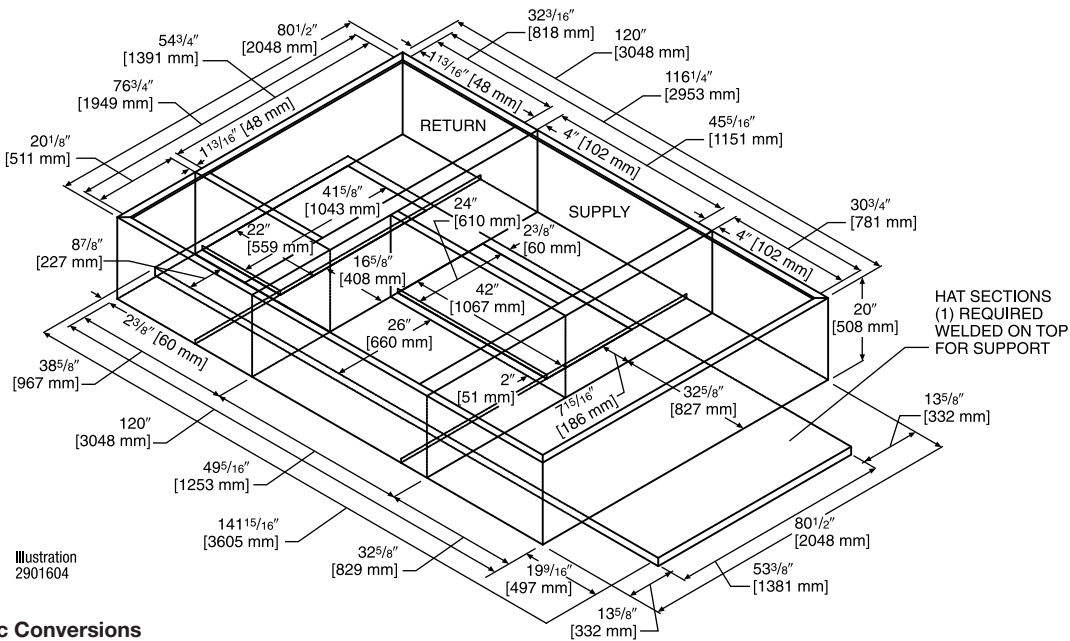

[] Designates Metric Conversions

CONCENTRIC DIFFUSER APPLICATION

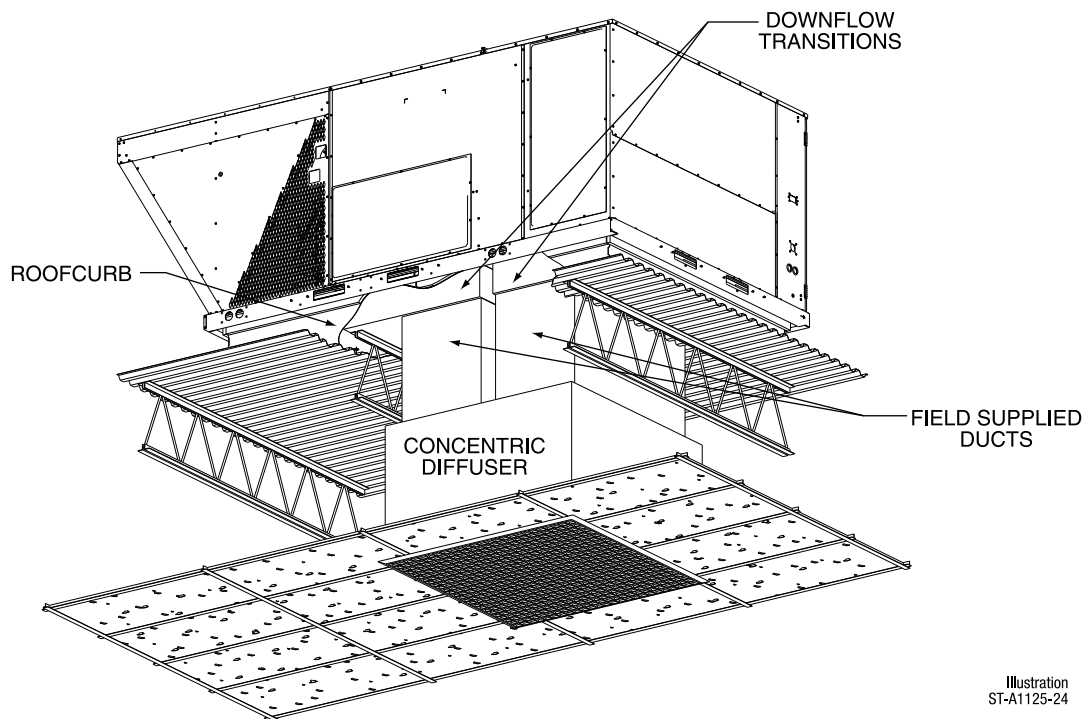


Illustration
ST-A1125-24

DOWNFLOW TRANSITION DRAWINGS

RXMC-DD02

- Used with RXRN-AEF3415
or RXRN-AED3415
Concentric Diffusers



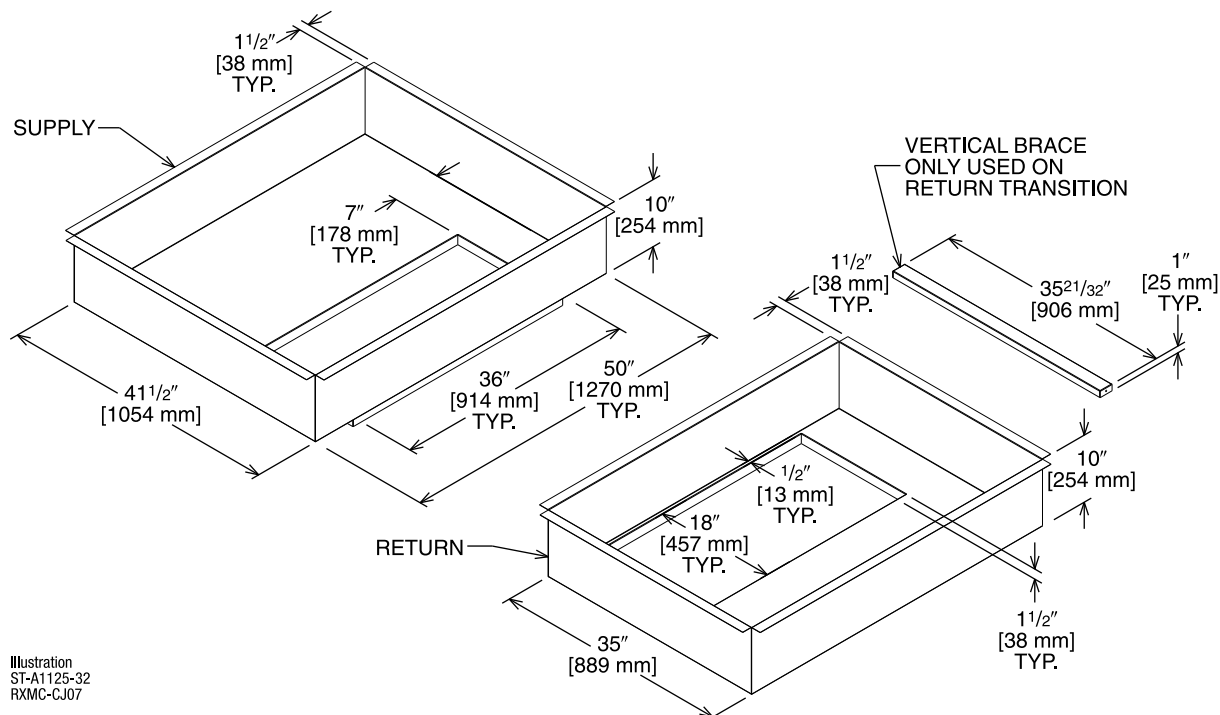


Illustration
ST-A1125-32
RXMC-CJ07

[] Designates Metric Conversions

CONCENTRIC DIFFUSER
30 TON [52.8 kW] FLUSH

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

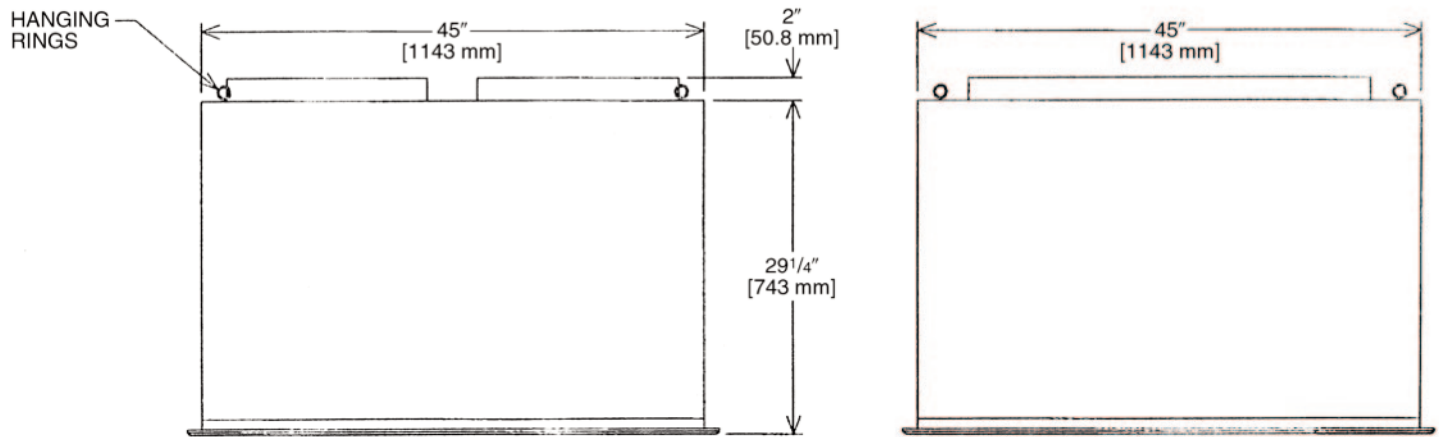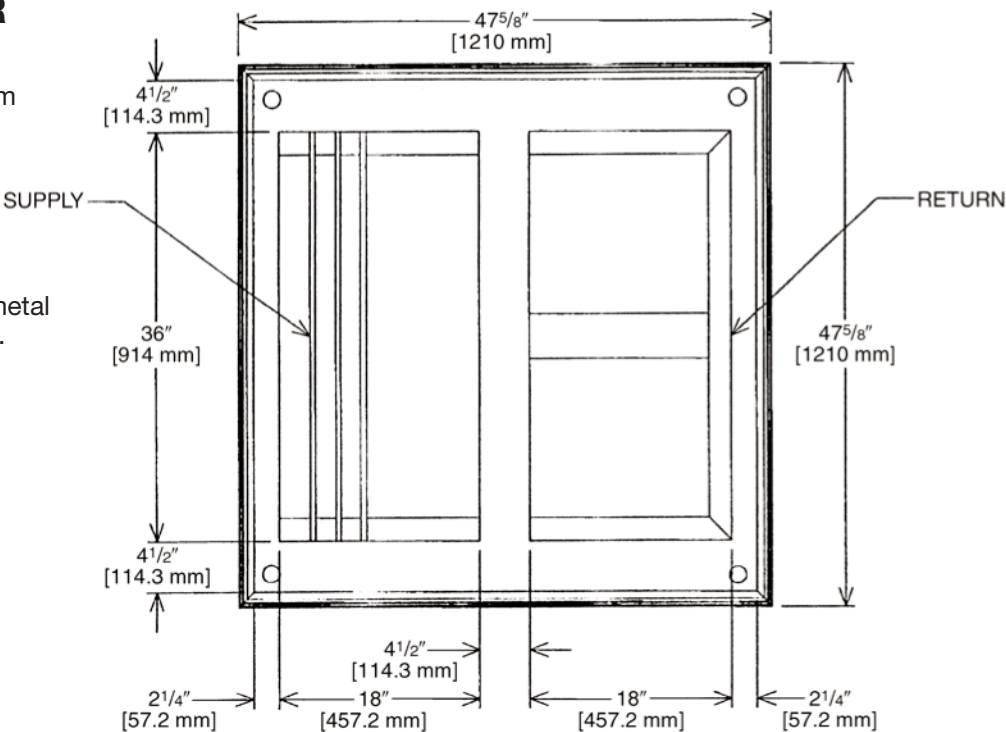

CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD80	5600 [2643]	0.36	28-37	1000	2082
	5800 [2737]	0.39	29-38	1036	2156
	6000 [2832]	0.42	40-50	1071	2230
	6200 [2926]	0.46	42-51	1107	2308
	6400 [3020]	0.50	43-52	1143	2379
	6600 [3115]	0.54	45-56	1179	2454




[] Designates Metric Conversions

CONCENTRIC DIFFUSER SPECIFICATIONS (Con't.)

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD81	5600 [2643]	0.36	39-49	920	920
	5800 [2737]	0.39	42-51	954	954
	6000 [2832]	0.42	44-54	1022	1022
	6200 [2926]	0.46	45-55	1056	1056
	6400 [3020]	0.50	46-55	1090	1090
	6600 [3115]	0.54	47-56	1124	1124
RXRN-AD86	7200 [3398]	0.39	33-38	827	827
	7400 [3492]	0.41	35-40	850	850
	7600 [3587]	0.43	36-41	873	873
	7800 [3681]	0.47	38-43	896	896
	8000 [3776]	0.50	39-44	918	918
	8200 [3870]	0.53	41-46	941	941
	8400 [3964]	0.56	43-49	964	964
	8600 [4059]	0.59	44-50	987	987
	8800 [4153]	0.63	47-55	1010	1010

CONCENTRIC DIFFUSER
30 TON [96.7 kW] DOWN

- All aluminum diffuser with aluminum return air eggcrate
- Built-in anti-sweat gasket
- Molded fiberglass supports
- Built-in hanging supports
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner
- Double deflection diffuser with the blades secured by spring steel

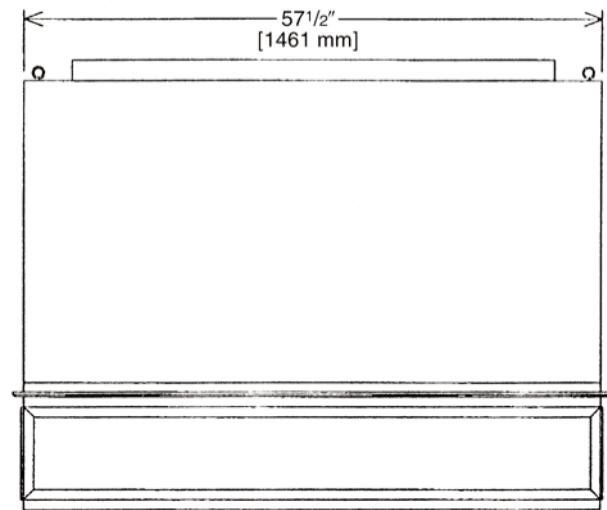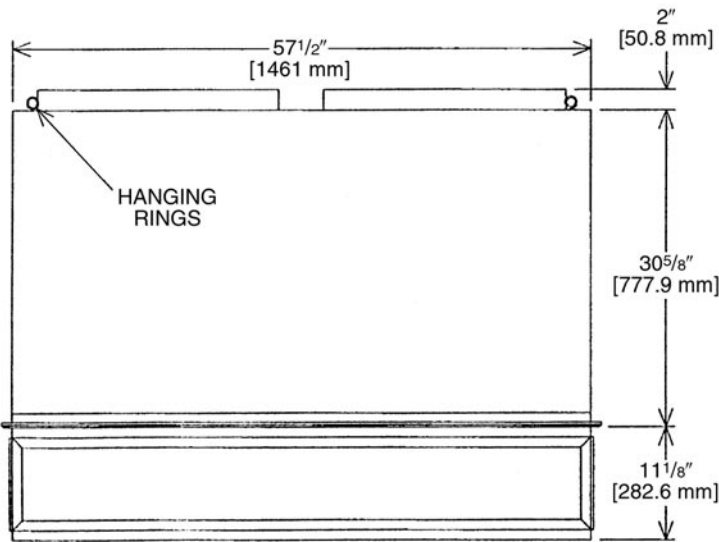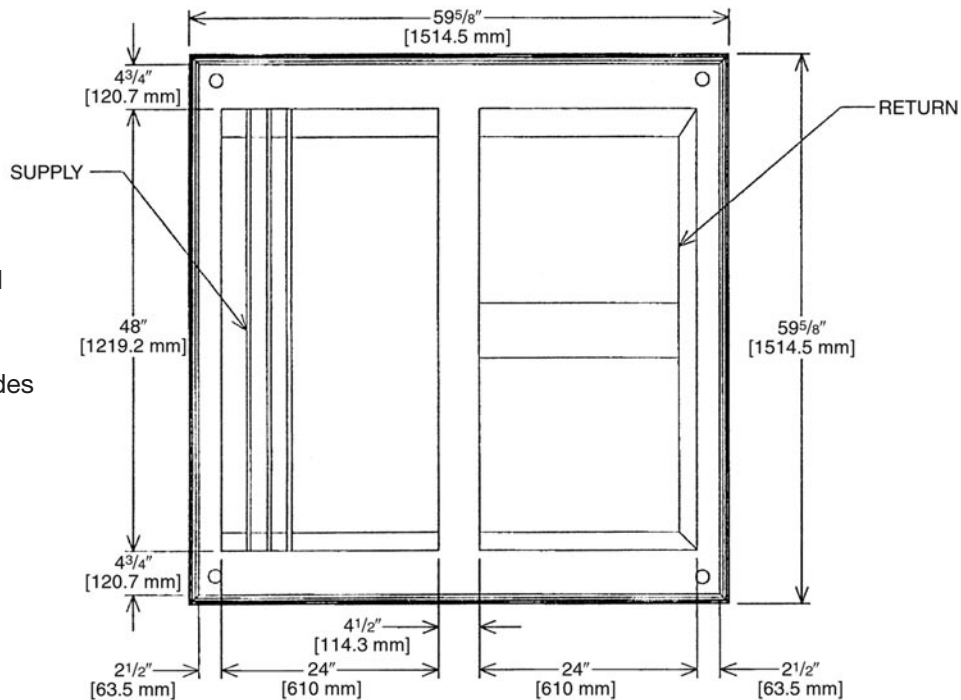

CONCENTRIC DIFFUSER SPECIFICATIONS

PART NUMBER	CFM [L/s]	STATIC PRESSURE	THROW FEET	NECK VELOCITY	JET VELOCITY
RXRN-AD86	7200 [3398]	0.39	33-38	827	827
	7400 [3492]	0.41	35-40	850	850
	7600 [3587]	0.43	36-41	873	873
	7800 [3681]	0.47	38-43	896	896
	8000 [3776]	0.50	39-44	918	918
	8200 [3870]	0.53	41-46	941	941
	8400 [3964]	0.56	43-49	964	964
	8600 [4059]	0.59	44-50	987	987
	8800 [4153]	0.63	47-55	1010	1010

[] Designates Metric Conversions

Guide Specifications RACH

Note about this specification: Please feel free to copy this specification directly into your building spec. This specification is written to comply with the 2004 version of the "master format" as published by the Construction Specification Institute www.csinet.org.

ELECTRIC HEAT PACKAGED ROOFTOP

HVAC Guide Specifications

Size Range: 30 Nominal Tons

Section	Description
---------	-------------

23 06 80	Schedules for Decentralized HVAC Equipment
----------	--

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

23 07 16	HVAC Equipment Insulation
----------	---------------------------

23 07 16.13	Decentralized, Rooftop Units:
-------------	-------------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 3/4-in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, with aluminum foil facing on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13	Instrumentation and Control Devices for HVAC
----------	--

23 09 13.23	Sensors and Transmitters:
-------------	---------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat
 - a. Unit controlled by return air or optional duct/space sensor.
 - b. Building Management System is recommended.

23 09 33	Direct-Digital Control System for HVAC
----------	--

23 09 23.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 09 23.13.A.	RTU-C controller
----------------	------------------

1. Shall be ASHRAE 62-2001 compliant.
2. Shall accept 18-32VAC input power.
3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% - 95% RH (non-condensing).
4. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, fire shutdown, return air enthalpy, fan status, remote time clock/door switch.
5. Shall accept a CO₂ sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.
6. Shall provide the following outputs: Economizer, fan, cooling stage 1, cooling stage 2, cooling stage 3, cooling stage 4, cooling stage 5, heat stage 1, heat stage 2 exhaust/ occupied.
7. Unit shall provide surge protection for the controller through a circuit breaker.
8. Shall have a field installed communication card allowing the unit to be Internet capable, and communicate at a Baud rate of 19.2K or faster.
9. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.
10. Shall have a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port.
11. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.
12. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.
13. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.
14. Shall support a bus length of 4000 ft. max, 60 devices per 1000 ft section, and 1 RS-485 repeater per 1000 ft. sections.

23 09 23.13.B.	Open protocol, direct digital controller:
----------------	---

1. Shall be ASHRAE 62-2001 compliant.
2. Shall accept 18-30VAC, 50-60Hz, and consume 15VA or less power.
3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).
4. Shall have a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port.
5. The BACnet® plug in communication card shall include built-in protocol for BACNET (MS/TP and PTP modes)
6. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers
7. Baud rate Controller shall be selectable through the EIA-485 protocol communication port.

8. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
9. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy.
11. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, cooling stage 3, cooling stage 4, cooling stage 5, heat stage 1, heat stage/ exhaust.
12. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC 23 09 33.13

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side.
2. Shall utilize color-coded wiring.
3. Unit shall include a minimum of one 9-pin screw terminal connection board for connection of control wiring.
4. Standard DDC ClearControl.
5. Standard Variable Air Volume controls.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Loss of charge switch.
 - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
 - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and/or troubleshoot the rooftop unit.
 - c. Loss of charge switch shall have a different sized connector than the high pressure switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
3. High-pressure switch.
 - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
 - b. High pressure switch shall use a different color wire than the low pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.
 - c. High pressure switch shall have a different sized connector than the loss of charge switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
4. Freeze protection sensor, evaporator coil.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filter face velocity shall not exceed 365 fpm at nominal airflows.
4. Filters shall be accessible through an access panel as described in the unit cabinet section of the specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small Capacity Self-Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and electric resistance heat for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2019 minimum efficiency requirements.
2. Unit shall be rated in accordance with AHRI Standard 340/360.
3. Unit shall be designed to conform to ASHRAE 15, 2001.
4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
7. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
8. Unit shall be designed in accordance with ISO 9001:2015, and shall be manufactured in a facility registered by ISO 9001:2015.
9. Roof curb shall be designed to conform to NRCA Standards.
10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
11. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at $\pm 10\%$ voltage.
2. Compressor with standard controls shall be capable of operation down to 40°F (4°C), ambient outdoor temperatures. Access- sory low ambient kit is necessary if mechanically cooling at ambient temperatures below 40°F (4°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F / 16°C): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standard 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 3/4-in. thick, 1 lb. density, flexible fiberglass insulation, aluminum foil-faced coated on the air side.
4. Base of unit shall have locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
5. Base Rail
 - a. Unit shall have base rails on all sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 14 gauge thickness.
6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 1" x 11 1/2 NPT drain connection through the side of the drain pan. Connection shall be made per manufacturer's recommendations.

7. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - i. Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - ii. No basepan penetration, other than those authorized by the manufacturer, is permitted.
8. Component hinged access panels (standard)
 - a. Cabinet panels shall be hinged for servicing.
 - b. Stainless steel metal hinges are standard on all doors.
 - c. Panels covering control box, indoor fan, indoor fan motor, and electric or gas heater components (where applicable), shall have 1/4 turn latches.

23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator and condenser coils shall be leak tested to 150 psig, pressure tested to 550 psig, and qualified to UL 1995 burst test at 2,200 psi.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermal Expansion Valve (TXV) with orifice type distributor.
 - b. Refrigerant filter drier.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through an access port in the front and rear panel of the unit.
2. Compressors
 - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - c. Compressors shall be internally protected from high discharge temperature conditions. Advanced Scroll Temperature Protection on 240-300 sizes.
 - d. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
 - e. Compressor shall be factory mounted on rubber grommets.
 - f. Compressor motors shall have internal line break thermal and current overload protection.
 - g. Crankcase heaters shall not be required for normal operating range.

23 81 19.13.L. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by sliding filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filter face velocity shall not exceed 365 fpm at nominal airflows.
5. Filters shall be standard, commercially available sizes.
6. Only one size filter per unit is allowed.
7. Optional MERV 8 and MERV 13 filters.

23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic-reset thermal overload protection.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design. Shaft-up designs including those with "rain-slinger devices" shall not be allowed.
2. Condenser Fans shall:
 - a. Shall be a direct-driven propeller type fan
 - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features

1. Integrated Economizers:
 - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configurations shall be available. Only Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Shall be capable of introducing up to 100% outdoor air.
 - g. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
 - h. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - i. An outdoor single enthalpy sensor shall be provided as standard. Outdoor air enthalpy set point shall be adjustable and shall range from the enthalpy equivalent of 63°F @ 50% rh to 73°F @ 50% rh. Additional sensor options shall be available as accessories.
 - j. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
 - k. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper set point.
 - l. Economizer controller shall accept a 2-10Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
 - m. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - n. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
2. Two-Position Damper
 - a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven damper and actuator motor.
 - d. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
 - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter.
3. Manual damper
 - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.
4. Head Pressure Control Package
 - a. Controller shall control coil head pressure by condenser-fan cycling.
5. Convenience Outlet:
 - a. Non-Powered convenience outlet.
 - b. Outlet shall be powered from a separate 115-120v power source.
 - c. A transformer shall not be included.

- d. Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
- e. Outlet shall include 15 amp GFI receptacles.
- f. Outlet shall be accessible from outside the unit.
6. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit electrical connections to be brought to the unit through the unit basepan.
7. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
8. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate airstreams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
9. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
10. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
11. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in wall mount with LED display. The set point shall have adjustment capability.
12. Smoke detectors:
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel
 - Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - Capable of direct connection to two individual detector modules.
 - Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
13. Blower:
 - a. Blower shall be removable without removing the roof of the unit or the condenser fan motors. Blower shall be able to slide out from the blower compartment of the unit.
14. Hinged Panels:
 - a. All hinged panels are standard.

26 29 23. 12 Adjustable Frequency Drive

1. Unit shall be supplied with an electronic variable frequency drive for the supply air fan.
2. Drive shall be factory installed in an enclosed cabinet.
3. Drive shall meet UL Standard 95-5V.
4. The completed unit assembly shall be UL listed.
5. Drives are to be accessible through a tooled access hinged door assembly.
6. The unit manufacturer shall install all power and control wiring.
7. The supply air fan drive output shall be controlled by the factory installed main unit control system and drive status and operating speed shall be monitored and displayed at the main unit control panel.
8. Drive shall be programmed and factory run tested in the unit.

BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.

GENERAL TERMS OF LIMITED WARRANTY*

Ruud will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.

***For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.**

Compressor	
3 Phase, Commercial Applications	Five (5) Years
Parts	
3 Phase, Commercial Applications	One (1) Year



Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

© 2023 Ruud Manufacturing Company. Ruud trademarks owned by Ruud Manufacturing Company.

In keeping with its policy of continuous progress and product improvement, Ruud reserves the right to make changes without notice.

Ruud Heating, Cooling & Water Heating • 5600 Old Greenwood Road
Fort Smith, Arkansas 72908 • www.ruud.com

Ruud Canada • 125 Edgeware Road, Unit 1
Brampton, Ontario • L6Y 0P5

RELY ON RUUD.™

PRINTED IN U.S.A. 4/23 QG FORM NO. S22-986 REV. 1