

RELY ON RUUD.™


SUBMITTAL COVER SHEET

SUBMITTED BY DATE							
UNIT SUMMARY							
NOTES:							
	DA UNIT SUMMARY	UNIT SUMMARY Image: I					

		• 7
	OMINAL	TON [7.03, 10.6, 14.06 AND 17.6 kW]
DATE		AIR HANDLER MODEL NO
		 FEATURES FOR (-)P17 SERIES HEAT PUMP UNITS EcoNet® Enabled product. The EcoNet Smart Home System provides advanced air & water control for maximum energy savings and ideal comfort. The inverter driven variable speed compressor provides three stages of heating and cooling
UNIT DATA	L	LOCATION ORDER NO. UNIT MODEL NO. PROVAL RECORD COLL MODEL NO. ARH HANDLER MODEL NO. - The inverte driven variable apeed compressor provides stream stages of heating and cooling - The inverte driven variable apeed compressor provides three stages of heating and cooling - The inverte driven variable apeed compressor provides three stages of heating and cooling - The inverte driven variable apeed compressor provides three stages of heating and cooling - The inverte driven variable apeed compressor provides three stages of heating and cooling - Peription of maximum constraint driven to preside variable refigerant flow. - New composite base pan - dampens sound, captures lower panels, eliminates corosion and increased life of the system. - Peription B - PF (C) DB - PS (D) DB (DC) CB (DC)
COOLING PERFORM		New composite base pan – dampens sound, captures louver panels, eliminates corrosion and reduces number of fasteners needed
TOTAL CAPACITY*		opportunity for leaks
SENSIBLE CAPACITY*		Optimized reversing valve sizing – improves shifting performance for quieter unit operation and
	°F [°C] DB	
TEMP. OF AIR ENTERING EVAPORATOR COIL	°F [°C] DB	Modern cabinet aesthetics – increased curb appeal with visually appealing design
-	°F [°C] WB	
POWER INPUT REQUIREMENT (*uses blower motor heat)	kW	
		• PlusOne® Expanded Valve Space – 3"-4"-5" service valve space – provides a minimum
HEATING PERFORM	IANCE	
EFFICIENCY		
		unit components. Individual louver panels come out once fastener is removed, for faster coil
	°F [°C] DB	• Diagnostic service window with two-fastener opening – provides access to the TXV valves and
TEMP. OF AIR ENTERING EVAPORATOR COIL	°F [°C] DB	
SUPPLY AIR BLOWER PE	RFORMANCE	Single-row condenser coil – makes unit lighter and allows thorough coil cleaning to maintain "out of the box" performance
TOTAL AIR SUPPLY	CFM [L/s]	
TOTAL RESISTANCE EXTERNAL TO UNIT	IWG	
BLOWER SPEED		• Fan motor harness with extra-long wires – allows unit top to be removed without disconnecting
POWER OUTPUT REQUIREMENT	BHP	
MOTOR RATING	HP [W]	
POWER INPUT REQUIREMENT	kW	WiFi Kit for Heating & Cooling
ELECTRICAL D	ATA	Heat Pump Riser 6 in. (686020)
POWER SUPPLY	Hz	
TOTAL UNIT AMPACITY	AMPS	ONDERGUIDE
MINIMUM WIRE SIZE	AWG	Seasonal Energy Efficiency Hatro (SEER)
MAXIMUM OVERCURRENT DEVIC FUSES/HACR BREAKER		ENERGY STAR
CLEARANCE	S	Performance Review Institute Regulationary Automatical Automatica Automatical Automatical Automatica Automatical Automatical Automatica Automatical Automatical Automatica Automatical Automatical Automatica Automatical Auto
ACCESS SIDE	24" [609.6 mm]	Activering Excellence logistiner
AIR INLETS	12" [304.8 mm]	Iso 90012015 Certified Company
	60" [1524 mm]	

ABOVE UNIT

60" [1524 mm]

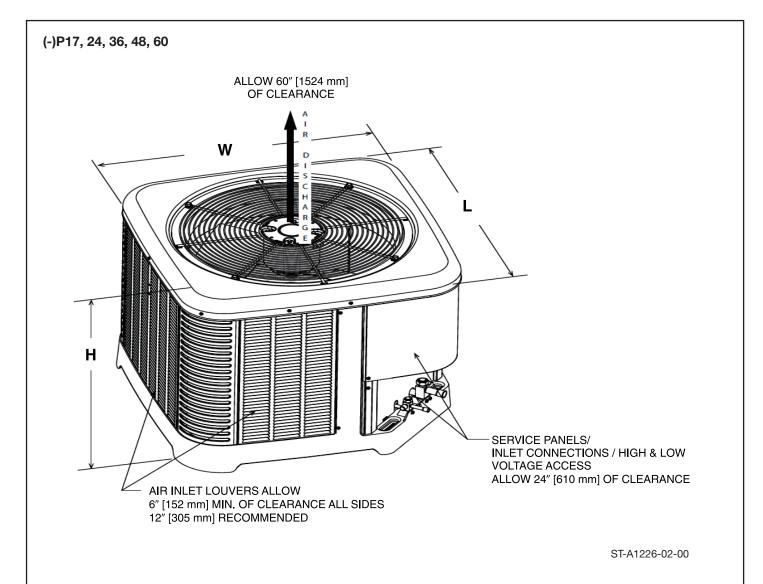

Unit Dimensions

MODEL NO.	OPERATING					SHIPPING						
	H (He	eight)	L (Length)		W (Width)		H (Height)		L (Length)		W (Width)	
	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm
(-)P1724	35	889	33.75	857	33.75	857	35.75	908	36.38	924	36.38	924
(-)P1736	35	889	33.75	857	33.75	857	36.75	933	36.38	924	36.38	924
(-)P1748	39	990	35.75	908	35.75	908	40.75	1035	38.38	974	38.38	974
(-)P1760	45	1143	35.75	908	35.75	908	46.75	1187	38.38	974	38.38	974

[] Designates Metric Conversions

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

Rheem Sales Company, Inc. 5600 Old Greenwood Road, Fort Smith, AR 72908

"In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice." PRINTED IN U.S.A. 11-19 QG FORM NO. X33-1554 REV. 2