
7 Tankless Units Installation- Common Venting

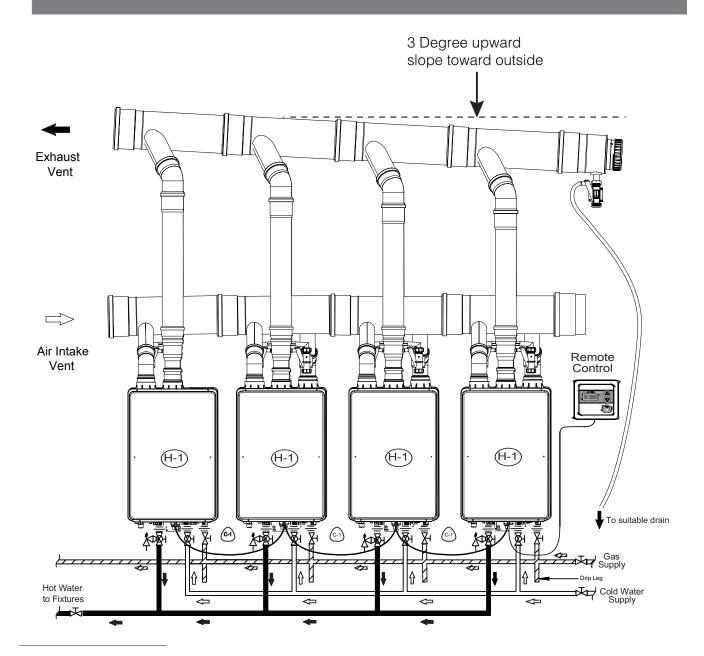

Written System Description

| Seven Unit Tankless Back to Back installation: Seven tankless water heaters shall be installed in a back to back configuration, connected with an EZ-Link cable, a single remote control, and vented to the outside per the Rheem Common Venting Installation instructions. The tankless units shall be plumbed in | H-1: (7) Tankless RTGH-CM95DVLN Water Heaters C-1: (6) EZ-Link Cable (7) Tankless Service Valve Kits (Webstone EXP2 or equivalent) (7) Pressure Relief Valve for tankless (1) Common Vent kit: 7 Units back to back direct vent |
|--|---|
| parallel with a minimum gas and water header of 1" pipe or as code requires. Cold water shall feed the tankless units. The tankless units shall supply a single temperature setting of water for application use. | NOTE: Common Vent is only approved for Natural Gas Applications. Legend Drawing No: 7-Tankless-Units-Installation-Common-Venting |
| This drawing is intended as a guide only. It is not to be used as an alternative to a professionally engineered project drawing. This drawing does not imply compliance with local building codes. Installation may vary, depending on installation location, and must be done in accordance with all local building codes. Consult with local building officials prior to installation. | Cold Water Isolator Pressure Relief Shut-off Valve Cold Water Pipe Hot Water Isolator Cold Water Pipe Hot Water Pipe Hot Water Solator Check Valve Hot Water Pipe |

System Components