

PROJECT NAME			
ARCHITECT			
ENGINEER			
CONTRACTOR			
SUBMITTED BY		DATE	
	UNIT SUMMAR	Y	
Quantity			
Unit Designation			
Model No.			
Total Cooling			
Sensible Cooling			
Air Ent. Evaporator			
Air Lvg. Evaporator			
Heating Input			
Heating Output			
CFM/ESP			
EER/SEER			
Electrical			
Minimum Ampacity			
MinMax. Breaker			
Net Unit Weight			
Accessory			
Catalog Form Number			
ACCESSORIES:	NOTES:		

Vantix™ Line SA18AZ iM / Cooling Effic Nominal Size	Air Conditio	to: 20.0 \$	SEER2/13 EER2 17.6 kW]	
JOB NAME			LOCATION	
CONTRACTOR			ORDER NO.	
ENGINEER			UNIT MODEL NO.	
SUBMITTED FOR			COIL MODEL NO	
DATE			AIR HANDLER MODEL NO	
	FORMANCE	*		$\left( \begin{array}{c} & & & \\ & & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & & \\ & & & $

## **FEATURES**

- EcoNet® Enabled: Automatic system configuration and optimization
- **Diagnostics & Bluetooth®1 Connectivity:** With the Contractor & EcoNet® Apps, built-in technology makes advanced set-up, monitoring, troubleshooting, and repairing the product easier than ever before
- Brushless DC Condenser Motors (BLDC): Enhances reliability and allows for easier serviceability
- Swept Wing Fan Technology: Features quieter operation and improved unit acoustics
- Expanded Valve Space: 3 in. 4 in. 5 in. service valve space provides a minimum working area of 27-square inches for easier access
- **Triple Service Access:** 15 in. wide, industry leading corner service access, makes repairs easier and faster

## **ACCESSORIES/OPTIONS**

Compressor Sound Cover	
EcoNet® Smart Thermostat	
Supply/Return Sensor	

<sup>1</sup>The Bluetooth<sup>®</sup> word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. and any use of such marks by Rheem<sup>®</sup> is under license. Other trademarks and trade names are those of their respective owners.













 8 mm]
 \*Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet Energy Star.

 4 mm]
 Ask your Contractor for details or visit www.energystar.gov.

# TOTAL CAPACITY\* MBH [kW] SENSIBLE CAPACITY\* MBH [kW]

OUTDOOR DESIGN TEMP °F [°C] DB
TEMP. OF AIR ENTERING EVAPORATOR COIL °F [°C] DB
°F [°C] WB
POWER INPUT REQUIREMENT kW (*uses blower motor heat)

## **HEATING PERFORMANCE**

EFFICIENCY	HSPF
TOTAL CAPACITY* M	1BH [kW]
OUTDOOR DESIGN TEMP °F	= [°C] DB
TEMP. OF AIR ENTERING EVAPORATOR COIL °f	= [°C] DB

#### SUPPLY AIR BLOWER PERFORMANCE


TOTAL AIR SUPPLY CFM [L/s]
TOTAL RESISTANCE EXTERNAL TO UNIT IWG
BLOWER SPEED RPM
POWER OUTPUT REQUIREMENT BHP
MOTOR RATING HP [W]
POWER INPUT REQUIREMENT kW

## ELECTRICAL DATA

POWER SUPPLY	Hz
TOTAL UNIT AMPACITY	AMPS
MINIMUM WIRE SIZE	AWG
MAXIMUM OVERCURRENT DEVICE FUSES/HACR BREAKER	AMPS

## CLEARANCES

ACCESS SIDE	24" [609.6 mm]
AIR INLETS	12" [304.8 mm]
ABOVE UNIT	60" [1524 mm]

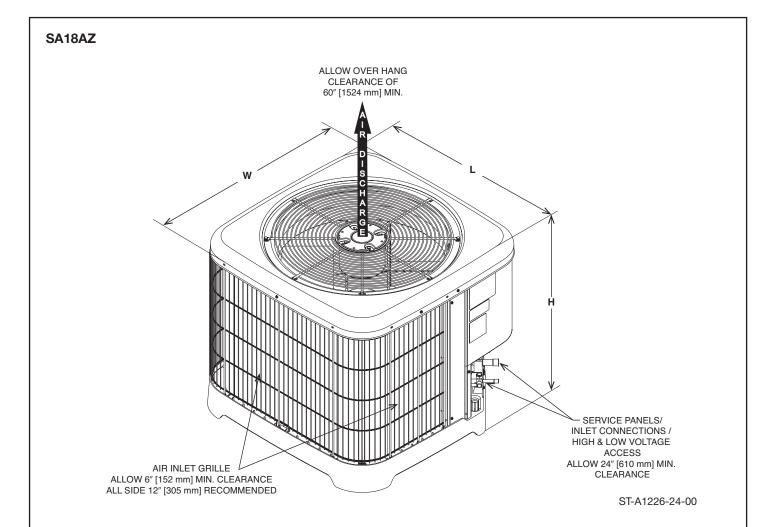

## **Unit Dimensions**

		OPERATING						SHIPPING				
MODEL NO.	H (He	eight)	L (Le	L (Length) W (Width)		H (Height) L (Le		ength) W (Widt		'idth)		
	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm	INCHES	mm
SA18AZ24AJVCA	39	990	33.75	857	33.75	857	41.56	1055	37.64	956	37.56	954
SA18AZ36AJVCA	39	990	33.75	857	33.75	857	41.56	1055	37.64	956	37.56	954
SA18AZ48AJVCA	51	1295	35.75	908	35.75	908	53.56	1360	39.37	999	39.64	1006
SA18AZ60AJVCA	51	1295	35.75	908	35.75	908	53.56	1360	39.37	999	39.64	1006

[ ] Designates Metric Conversions

Before proceeding with installation, refer
to installation instructions packaged
with each model, as well as complying
with all Federal, State, Provincial, and
Local codes, regulations, and practices.

Rheem Sales Company, Inc. 5600 Old Greenwood Road Fort Smith, Arkansas 72908

© 2023 Rheem Manufacturing Company. Russell By Rheem and Sure Comfort trademarks owned by Rheem Manufacturing Company. "In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice."