

PROJECT NAME		_
LOCATION		_
ARCHITECT		-
ENGINEER		-
CONTRACTOR		-
SUBMITTED BY	DATE	-
	UNIT SUMMARY	
Quantity		
Unit Designation		
Model No.		
Total Cooling		
Sensible Cooling		
Air Ent. Evaporator		
Air Lvg. Evaporator		
Heating Input		
Heating Output		
CFM/ESP		
EER/SEER		
Electrical		
Minimum Ampacity		
MinMax. Breaker		
Net Unit Weight		
Accessory		
Catalog Form Number		
ACCESSORIES:	NOTES:	

Versus[™] Line (-)H2TZ Air Handlers Nominal Sizes: 2 to 5 Ton [7.03 to 17.58 kW]

JOB NAME		 LOCATION
CONTRACTOR		 ORDER NO.
ENGINEER		UNIT MODEL NO
SUBMITTED FOR	☐ APPROVAL	COIL MODEL NO
DATE		 AIR HANDLER MODEL NO

UNIT DATA

COOLING PERFORMANCE

EFFICIENCY	SEER
TOTAL CAPACITY*	_ MBH [kW]
SENSIBLE CAPACITY*	_ MBH [kW]
OUTDOOR DESIGN TEMP	_ °F [°C] DB
TEMP. OF AIR ENTERING EVAPORATOR COIL	_ °F [°C] DB _ °F [°C] WB
POWER INPUT REQUIREMENT(*uses blower motor heat)	kW

HEATING PERFORMANCE

EFFICIENCY	HSPF
TOTAL CAPACITY*	MBH [kW]
OUTDOOR DESIGN TEMP	°F [°C] DB
TEMP. OF AIR ENTERING	°F [°C] DB

SUPPLY AIR BLOWER PERFORMANCE

TOTAL AIR SUPPLY	CFM [L/s]
TOTAL RESISTANCE EXTERNAL TO UNIT	IWG
BLOWER SPEED	RPM
POWER OUTPUT REQUIREMENT	BHP
MOTOR RATING	HP [W]
POWER INPUT REQUIREMENT	kW

ELECTRICAL DATA

POWER SUPPLY	Hz
TOTAL UNIT AMPACITY	AMPS
MINIMUM WIRE SIZE	_ AWG
MAXIMUM OVERCURRENT DEVICE FUSES/HACR BREAKER	AMPS

CLEARANCES

ACCESS SIDE	24" [609.6 mm]
AIR INLETS	12" [304.8 mm]
ABOVE UNIT	60" [1524 mm]

FEATURES


- Quiet Operation¹: Provided by a cabinet construction with 1.0 inch of foil faced insulation for quieter sound characteristics
- Aluminum Indoor Coil Design: Constructed of aluminum fins bonded to internally grooved aluminum tubing and are more corrosion resistant
- Versatile 4-Way Convertible Compact Design: Allow for upflow, downflow, horisontal left and horizontal right applications even in the smallest of spaces
- Rugged Steel, Compact Cabinet Construction: Designed for added strength and versatility
- Field Installed Auxiliary Heater Kits: Provide exact heat for indoor comfort and include circuit breakers which meet UL and cUL requirements for service disconnect
- Cabinet Air Leakage at 1-inch H₂O: When tested in accordance with ASHRAE Standard 193

¹Based on manufacturer's air handler offering, and the product's airflow stages, motor type and cabinet insulation. Sound levels are also dependent on air handler location and installation.







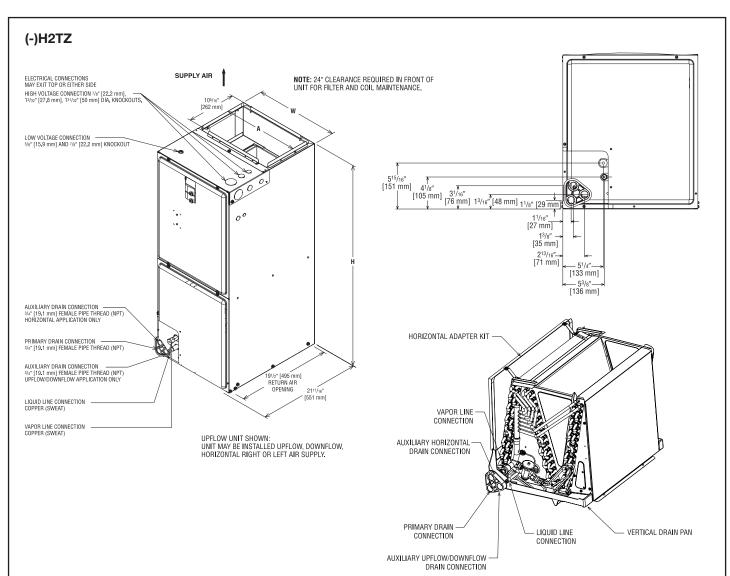

Unit Dimensions

Model Size	Refrigerant Connections Sweat (In.) [mm] ID		Unit Width	Unit Height	Unit Weight/Shipping Weight (Lbs.) [kg]
(-)H2TZ	Liquid	Vapor	"W" In. [mm]	"H" In. [mm]	Unit With Coil (Max. KW)
2417ST	3/8 [9.53]	3/4 [19.05]	171/2 [445]	421/2 [1080]	92/106 [42/48]
3617ST	3/8 [9.53]	3/4 [19.05]	171/2 [445]	421/2 [1080]	96/110 [44/50]
3621ST	3/8 [9.53]	3/4 [19.05]	21 [533]	421/2 [1080]	111/126 [50/57]
3621MT**N	3/8 [9.53]	7/8 [22.23]	21 [533]	501/2 [1282]	126/142 [57/64]
3621MT**A	3/8 [9.53]	⁷ /8 [22.23]	21 [533]	57 [1448]	137/149 [62/68]
4821ST**N	3/8 [9.53]	⁷ /8 [22.23]	21 [533]	501/2 [1282]	128/144 [56/65]
4821ST**A	3/8 [9.53]	⁷ /8 [22.23]	21 [533]	57 [1448]	139/151 [63/68]
4824ST**N	3/8 [9.53]	7/8 [22.23]	241/2 [622]	551/2 [1410]	128/146 [58/66]
6021ST**A	3/8 [9.53]	7/8 [22.23]	21 [533]	57 [1448]	139/151 [63/68]
6024ST	3/8 [9.53]	7/8 [22.23]	241/2 [622]	551/2 [1410]	161/178 [73/81]

[] Designates Metric Conversions

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

© 2023 Rheem Manufacturing Company. WeatherKing trademarks owned by Rheem Manufacturing Company.

"In keeping with its policy of continuous progress and product improvement, WeatherKing reserves the right to make changes without notice."

PRINTED IN U.S.A. 8-23 QG FORM NO. X66-1647