


Four Tank Units Installation- Single Temperature TRITON™

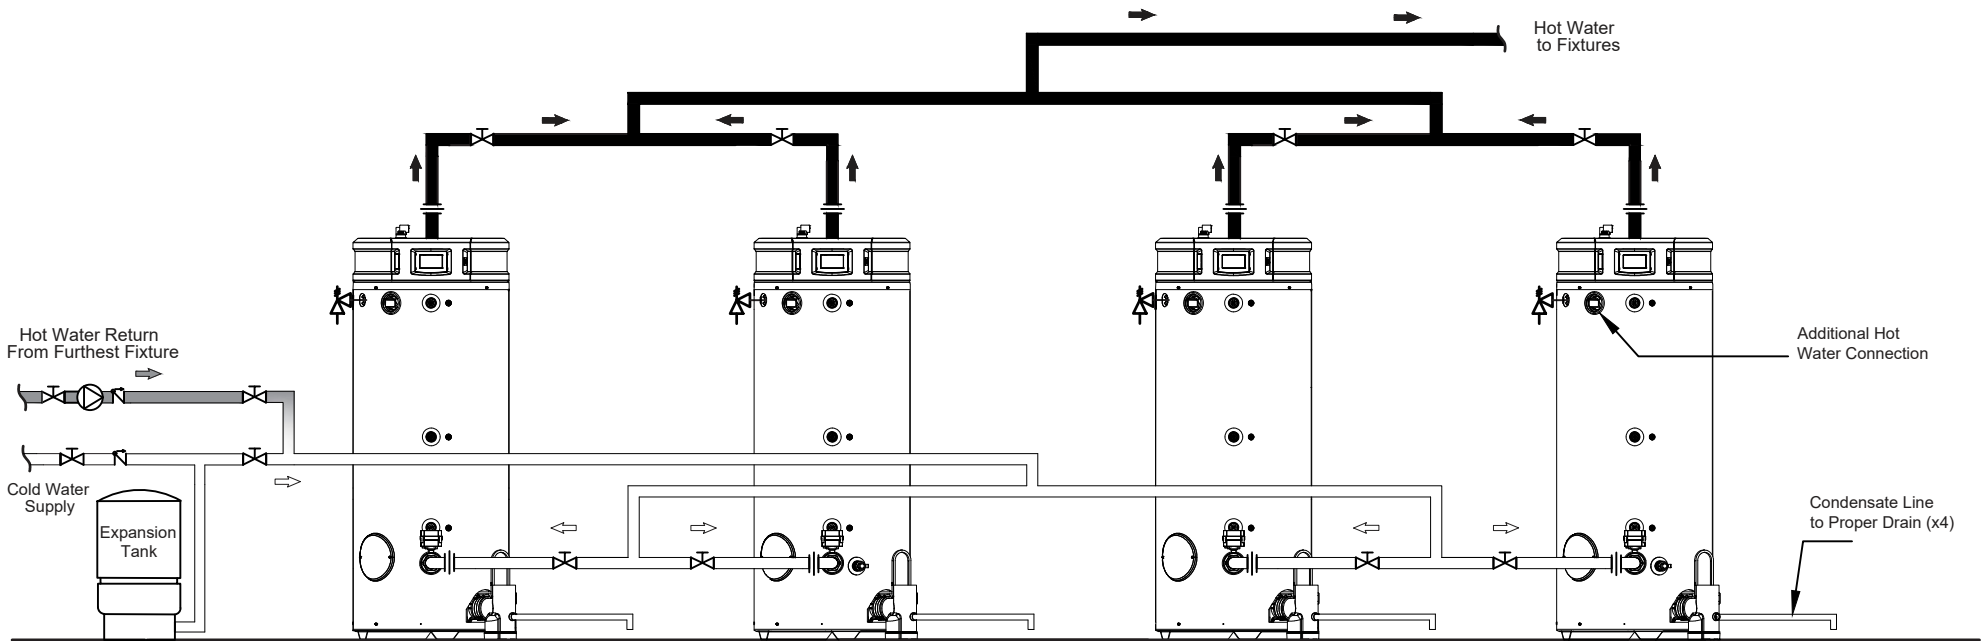

Written System Description

Four Triton Tank Units Installation:

Four Triton Tank Water Heaters shall be installed and vented to the outside per the manufacture instructions. Cold water will feed the tank units, the tanks shall supply a single temperature setting of water for appliance use. Inlet water connections are made to the lower coupling on the heater, and outlet water connections are made to the upper coupling. Cap or plug unused connections. Use only clean, new galvanized steel, copper or approved plastic pipe for water connections. Local codes or regulations shall govern the exact type of material to be used. The installation of unions on the inlet and outlet water lines and a shut-off valve in at least the cold water inlet line is recommended, so the water heater may be easily disconnected for servicing. Dielectric unions are not required for protection of the water heater. Thermometer(s) should be installed so that they indicate the temperature of the water at or near the outlet of the water heater and storage tank(s) if provided.

Plumbing, pipe size, and valves are all to be determined by mechanical engineer or the installing contractor.

NOTICE: This drawing is intended as a guide only. It is not to be used as an alternative to a professionally engineered project drawing. This drawing does not imply compliance with local building codes. Installation may vary, depending on installation location, and must be done in accordance with all local building codes. Consult with local building officials prior to installation.

System Components

- (4) GHE Water Heater
- (8) Unions
- (4) T&P Relief Valve
- (8) Shut-Off Valves
- (2) Check Valves
- (1) Expansion Tank

Legend

-  T&P Relief Valve
-  Shut-off Valve
-  Union
-  Cold Water Pipe
-  Circulation Pump
-  Check Valve
-  Return Circulation Line
-  Hot Water Pipe

Drawing: PD_Triton_4Units
Updated: 05/2018

In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice.

05/18 PD-Triton-4U