

# MODEL RXGY - G01 (SP20286) or PTX-129 (SP20286-1) 3" SIDE WALL VENT KIT

**DIRECT VENT: FURNACE AND TANKLESS WATER HEATER**  
**NON-DIRECT VENT: FURNACE ONLY**

FOR FURNACE MODELS NOT LISTED SEE UNIT INSTALLATION INSTRUCTIONS OR 92-102340-01 FOUND ON MYRHEEM.COM/PTS/RXGY

**FOR USE WITH FURNACE MODELS: R92P, R95P, R95T, R96P, R96V & R97V**

## KIT CONTENTS:

- Vent Cap
- Vent Plate
- 4- # 8 pan head screws 2" long" SMS type A18-8 stainless steel.
- 4- #8 pan head screws 1" long , SMS type A18-8 stainless steel.

## IMPORTANT:

This manual covers the installation of the multiple side wall vent kit. The RXGY-G01 (SP20286) or PTX-129 (SP20286-1) is intended for:

- Direct Venting: furnace and tankless water heaters
- Non-Direct Vent: furnaces only

The RXGY-G01 (SP20286) Vent Kit can be used for all above listed furnace models. For RXGY-G01 (SP20286) or PTX-129 (SP20286-1) vent kits refer to Condensing Tankless water heater manufacturer's installation instructions for model exclusions!



## ⚠ WARNING

THIS VENT KIT MUST BE INSTALLED BY A QUALIFIED SERVICE TECHNICIAN. CODES AND LOCAL UTILITY REQUIREMENTS GOVERNING THE INSTALLATION OF GAS FIRED EQUIPMENT, WIRING, PLUMBING, AND FLUE CONNECTIONS MUST BE ADHERED TO. IN THE ABSENCE OF LOCAL CODES, THE INSTALLATION MUST CONFORM TO THE NATIONAL FUEL GAS CODE ANSI Z223.1 "LATEST EDITION," OR CSA-B149 INSTALLATION CODES. THE LATEST CODE MAY BE OBTAINED FROM CSA-INTERNATIONAL, 8501 EAST PLEASANT VALLEY ROAD, CLEVELAND, OHIO 44131 OR CSA-INTERNATIONAL, 178 REXDALE BLVD., TORONTO, ONTARIO, CANADA M9W, 1R3

## ⚠ WARNING

DO NOT OPERATE THE FURNACE OR TANKLESS WATER HEATER WITHOUT THE SIDE WALL CAP IN PLACE AS RECIRCULATION OF COMBUSTION PRODUCTS MAY OCCUR. WATER MAY ALSO COLLECT INSIDE THE COMBUSTION AIR PIPE AND FLOW TO THE BURNER ENCLOSURE. FAILURE TO FOLLOW THIS WARNING COULD RESULT IN PRODUCT DAMAGE OR IMPROPER OPERATION, PERSONAL INJURY OR DEATH.

## ⚠ WARNING

THESE INSTRUCTIONS ARE INTENDED AS AN AID TO QUALIFIED SERVICE PERSONNEL FOR PROPER INSTALLATION, ADJUSTMENT AND OPERATION OF THIS UNIT. READ THESE INSTRUCTIONS THOROUGHLY BEFORE ATTEMPTING INSTALLATION OR OPERATION. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE, POSSIBLY RESULTING IN FIRE, CARBON MONOXIDE POISONING, EXPLOSION, PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.

**DO NOT DESTROY THIS MANUAL. PLEASE READ CAREFULLY AND KEEP  
IN A SAFE PLACE FOR FUTURE REFERENCE BY A SERVICEMAN.**

# INSTALLATION – Side Wall Vent

This termination is for horizontal venting only.

**Important:** Avoid installing on the prevailing winter wind side of the structure

**Note:** Multi-venting-No common venting. Refer to specific product I & O for instructions.


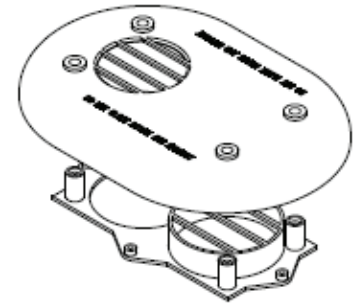


FIGURE 1  
VENT KIT INSTALLATION OPTIONS

FIGURE 1  
VENT KIT INSTALLATION OPTIONS

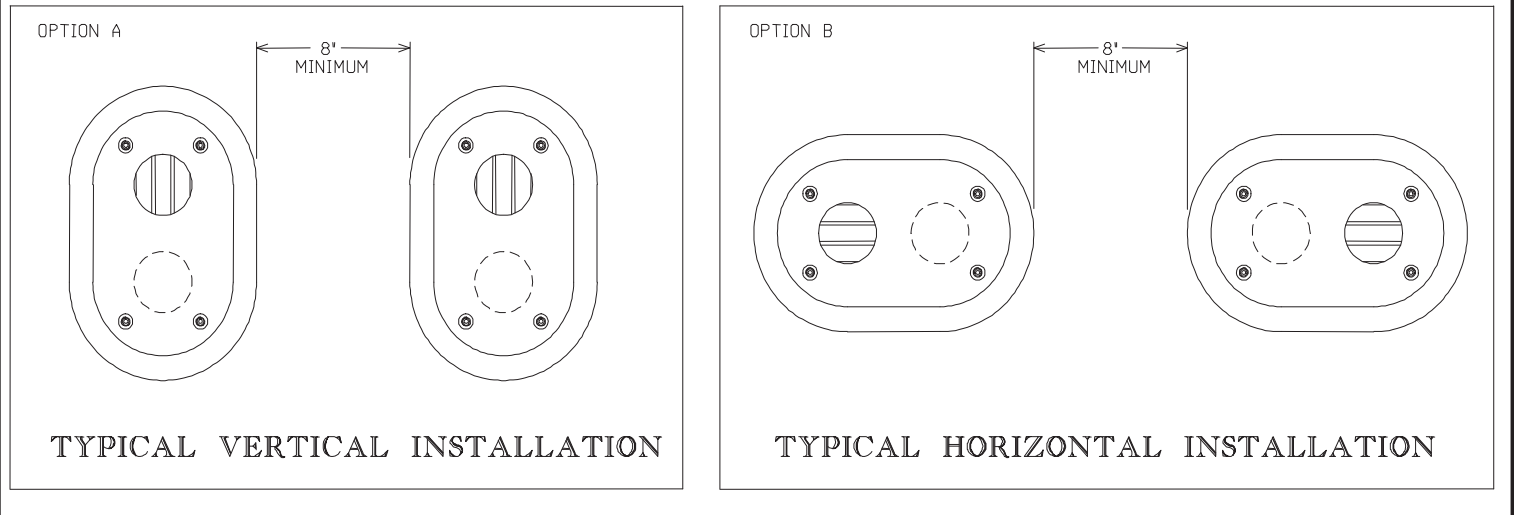


**NOTE:**

Install the vent and air intake piping into the vent plate openings. Seal all gaps between the pipes and wall.

**Be Sure to Use Silicone Sealant** to seal the vent pipe to the vent cap to permit field disassembly for annual inspection and cleaning. Also seal all pipe penetrations in wall. To prevent possibility of condensate freeze-up or recirculation, **do not install vent kits one above the other.**

**Note :** The Vent illustration in Figures 1 & 2 can be used for Non-direct furnace vent termination also.

FIGURE 2  
TYPICAL INSTALLATION

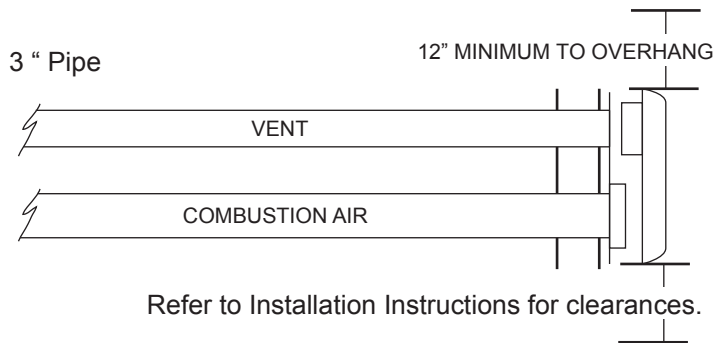

**Note:**

Vent should protrude a maximum of 2-1/4" beyond vent plate. Air intake should protrude a maximum of 1 inch beyond vent plate. Use the vent plate as a template to locate vent, combustion air and (4) mounting holes. Observe minimum clearances. Cut (2) 3-7/8" diameter holes for the vent and combustion air openings. Drill (4) 3/16" diameter holes for inserting the plastic anchors into the wall. Attach the vent plate to the wall with (4) - 2" long stainless steel screws.

Assemble the vent cap to the vent plate. Insert the (4) 1" long stainless steel screws into the vent cap screw hole openings and securely attach the vent cap to the vent plate. Seal all wall cavities.