



The new degree of comfort.®

PROJECT NAME _____
LOCATION _____
ARCHITECT _____
ENGINEER _____
CONTRACTOR _____
SUBMITTED BY _____ DATE _____

UNIT SUMMARY

| | | | | | | |
|---------------------|--|--|--|--|--|--|
| Quantity | | | | | | |
| Unit Designation | | | | | | |
| Model No. | | | | | | |
| Total Cooling | | | | | | |
| Sensible Cooling | | | | | | |
| Air Ent. Evaporator | | | | | | |
| Air Lvg. Evaporator | | | | | | |
| Heating Input | | | | | | |
| Heating Output | | | | | | |
| CFM/ESP | | | | | | |
| EER/SEER | | | | | | |
| Electrical | | | | | | |
| Minimum Ampacity | | | | | | |
| Min.-Max. Breaker | | | | | | |
| Net Unit Weight | | | | | | |
| Accessory | | | | | | |
| Catalog Form Number | | | | | | |

ACCESSORIES:

NOTES:

Endeavor® Line (-)801V Upflow/Horizontal Gas Furnaces

Heating Stages: Single Stage

Input Rates: 50-125 kBTU [14.6-36.6 kW]

JOB NAME _____ LOCATION _____

CONTRACTOR _____ ORDER NO. _____

ENGINEER _____ UNIT MODEL NO. _____

SUBMITTED FOR ☐ APPROVAL ☐ RECORD COIL MODEL NO. _____

DATE _____ AIR HANDLER MODEL NO. _____

UNIT DATA

HEATING PERFORMANCE

TOTAL CAPACITY INPUT* MBH [kW]

TOTAL CAPACITY OUTPUT* MBH [kW]

DESIGN TEMP. RISE °F [°C] DB

AFUE %

CALIFORNIA SEASONAL EFFICIENCY %

(*uses blower motor heat)

SUPPLY AIR BLOWER PERFORMANCE

TOTAL AIR SUPPLY CFM [L/s]

TOTAL RESISTANCE EXTERNAL TO UNIT IWG

BLOWER SPEED RPM

POWER OUTPUT REQUIREMENT BHP

MOTOR RATING HP [W]

POWER INPUT REQUIREMENT kW

ELECTRICAL DATA

POWER SUPPLY Hz

TOTAL UNIT AMPACITY AMPS

MINIMUM WIRE SIZE AWG

MAXIMUM OVERCURRENT DEVICE FUSES/HACR BREAKER AMPS



FEATURES

- **PlusOne® Diagnostics:** With the Contractor & EcoNet® Apps, built-in EcoNet® & Bluetooth®¹ technology makes monitoring, troubleshooting and repairing the product easier than ever before
- **Dip Switch Free Installation Commissioning via Bluetooth® Technology:** Seamless final install step without DIP switch configuration using the Contractor App
- **PlusOne® Ignition System:** Proven Direct Spark Ignition (DSI) for reliability and longevity
- **Constant CFM Motor:** Truly variable speed technology allows for ultimate humidity control, quieter sound levels and year-round energy savings
- **Quieter Operation²:** A fully insulated blower cabinet, solid bottom and truly variable speed airflow technology makes this furnace one of the quieter options available
- **EcoNet® Enabled Furnace:** The latest in sensor technology and the EcoNet® monitoring system provides a new level of protection, control and energy savings
- **Allows on-the-go control** and receipt of system alerts by the homeowner via the EcoNet® Smart Thermostat and EcoNet® App³

ACCESSORIES/OPTIONS

- External Bottom Filter Rack RXGF-CB ☐
- External Side Filter Rack RXGF-CD ☐
- Indoor Coil Casing RXBC-D14A1 ☐
- Indoor Coil Casing RXBC-D17A1 ☐
- Indoor Coil Casing RXBC-D21A1 ☐
- Indoor Coil Casing RXBC-D21B1 ☐
- Indoor Coil Casing RXBC-D24A1 ☐
- Solid Bottom Kit RXGB-D14 ☐
- Solid Bottom Kit RXGB-D17 ☐
- Solid Bottom Kit RXGB-D21 ☐
- Solid Bottom Kit RXGB-D24 ☐
- 4" Flue Adapter RXGW-C01 ☐



¹The Bluetooth® word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. and any use of such marks by Rheem® is under license. Other trademarks and trade names are those of their respective owners

²Based on manufacturer's furnace offering, and the product's heating stages, motor type and cabinet insulation. Sound levels are also dependent on furnace location and installation.

³Wifi broadband internet connection required. Download the EcoNet® App from the App Store® or Google Play® to set up your EcoNet® Smart Thermostat. Receipt of notifications depend on home WiFi set up. Amazon, Alexa and all related logos are trademarks of Amazon.com, Inc. or its affiliates.

WARNING

THIS FURNACE IS NOT APPROVED
OR RECOMMENDED FOR INSTALLATION
ON ITS BACK, WITH ACCESS DOORS
FACING UPWARDS.

Upflow Application

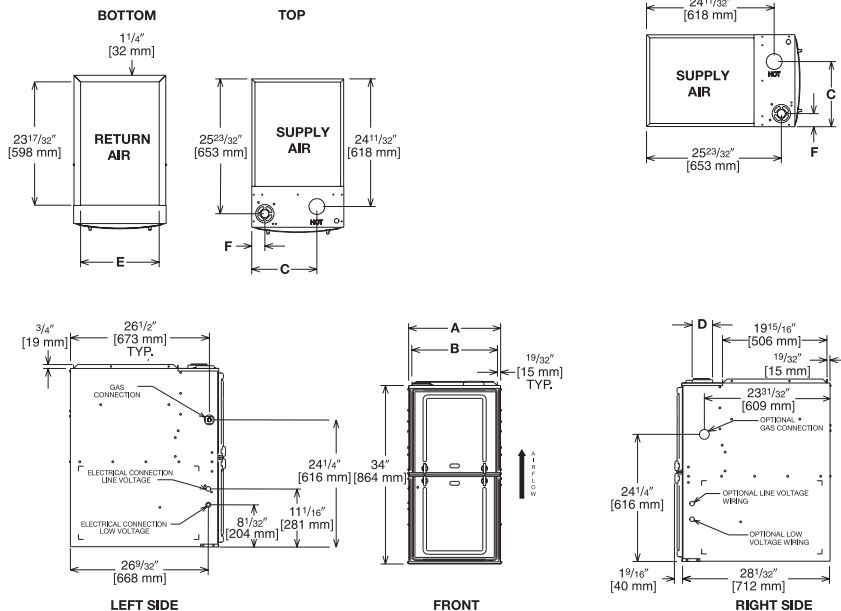


Illustration
ST-A1220-04-00
FIGURE 1

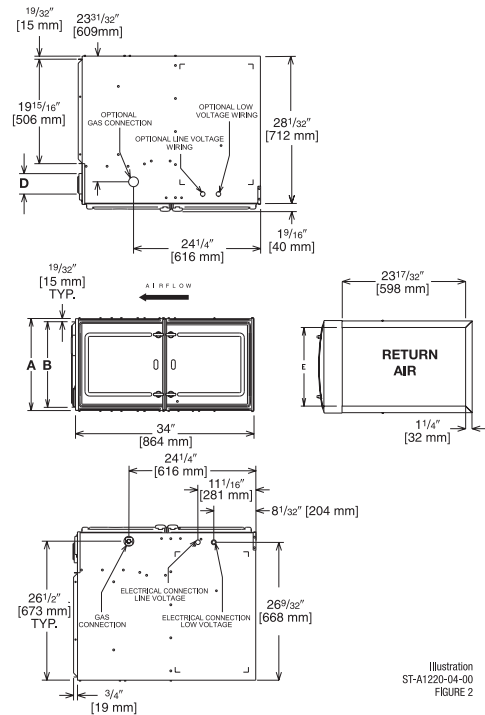


Illustration
ST-A1220-04-00
FIGURE 2

Unit Dimensions: Upflow Model

| MODEL (-)801V UH | A | B | C | D | E | F | MINIMUM CLEARANCE (IN.) [mm] | | | | | |
|---------------------|--------------|----------------|--------------|---|--------------|------------|------------------------------|------------|------|--------|--------|-----------|
| | | | | | | | LEFT SIDE | RIGHT SIDE | BACK | TOP | FRONT | VENT |
| 050314 | 14 [356] | 12 27/32 [326] | 10 5/8 [270] | ① | 11 1/2 [292] | 1 7/8 [48] | 0 | 4 [102] ② | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 050417/75417 | 17 1/2 [445] | 16 11/32 [415] | 12 3/8 [314] | ① | 15 [381] | 2 1/2 [64] | 0 | 3 [76] ② | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 075521/100 | 21 [533] | 19 27/32 [504] | 14 1/8 [359] | ① | 18 1/2 [470] | 2 1/2 [64] | 0 | 0 | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 125 | 24 1/2 [622] | 23 11/32 [593] | 15 7/8 [403] | ① | 22 [559] | 2 1/2 [64] | 0 | 0 | 0 | 1 [25] | 3 [76] | 6 [152] ③ |

Unit Dimensions: Horizontal Model

| MODEL (-)801V UH | A | B | C | D | E | F | MINIMUM CLEARANCE (IN.) [mm] | | | | | |
|---------------------|--------------|----------------|--------------|---|--------------|------------|------------------------------|-----------------|------|--------|--------|-----------|
| | | | | | | | SUPPLY AIR SIDE | RETURN AIR SIDE | BACK | TOP | FRONT | VENT |
| 050314 | 14 [356] | 12 27/32 [326] | 10 5/8 [270] | ① | 11 1/2 [292] | 1 7/8 [48] | 4 [102] ② | 4 [102] ② | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 050417/75417 | 17 1/2 [445] | 16 11/32 [415] | 12 3/8 [314] | ① | 15 [381] | 2 1/2 [64] | 3 [76] ② | 3 [76] ② | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 075521/100 | 21 [533] | 19 27/32 [504] | 14 1/8 [359] | ① | 18 1/2 [470] | 2 1/2 [64] | 0 | 0 | 0 | 1 [25] | 3 [76] | 6 [152] ③ |
| 125 | 24 1/2 [622] | 23 11/32 [593] | 15 7/8 [403] | ① | 22 [559] | 2 1/2 [64] | 0 | 0 | 0 | 1 [25] | 3 [76] | 6 [152] ③ |

NOTES: ① May require a 3" [76 mm] to 4" [102 mm] or 3" [76 mm] to 5" [127 mm] adapter.

② May be 0" [0 mm] with type B vent.

③ May be 1" [25 mm] with type B vent.

[] Designates Metric Conversions

Furnaces must be vented in accordance with the National Fuel Gas Code, ANSI Z223.1 and in accordance with local codes.

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

5600 Old Greenwood Road
Fort Smith, Arkansas 72908