



Indoor Coils  
RCCL Series

## Ruud Indoor Cooling Coils For Dual Furnace Application



### RCCL- Series

Featuring Industry Standard R-410A  
Refrigerant



**WARNING**  
RCCL COOLING COIL  
FOR USE IN  
UPFLOW APPLICATIONS ONLY

- The RCCL- series cooling coils are designed for use with two Upflow Gas Furnaces and a single 6.5 or 7.5 ton [22.9 or 26.4 kW] commercial condensing unit.
- For twinning furnaces, please refer to the appropriate Installation Instructions.
- RCCL coils are single circuit coils with a mounted expansion valve in a completely assembled and insulated plenum.
- Sheet metal transitions and block-offs for dual furnace applications are packaged with the RCCL coil assembly.

RELY ON RUUD.™

FORM NO. C22-225

TABLE OF CONTENTS

Coil Specifications .....3

Coil Dimensions and Weights.....4-6

## 6.5 & 7.5 Ton Single Circuit Evaporator Coils

### MODEL RCCL-D5013S

6.5 & 7.5 Ton [22.9 & 26.4 kW] high efficiency evaporator coil.

**NOTE:** Sheet metal transition and block-offs for dual furnace applications are packaged with the RCCL coil assembly.

### THE FOLLOWING FURNACES MAY BE USED IN 6.5 & 7.5 TON UPFLOW APPLICATIONS

80% GAS UPFLOW
R801TA125525MSA

90 PLUS GAS UPFLOW
R95TA1151524SA

**NOTE:** See gas furnace specification sheets to determine appropriate models and fan speeds for 6.5 & 7.5 ton [22.9 & 26.4 kW] applications.

## Pressure Drop (Inches, Water Column) [kPa]

RCCL-D5013S					
CFM [L/s]	DRY COIL	WET COIL	CFM [L/s]	DRY COIL	WET COIL
2400 [1133]	.15 [.04]	.18 [.04]	3800 [1793]	.25 [.06]	.32 [.08]
2600 [1227]	.16 [.04]	.20 [.05]	4000 [1888]	.26 [.06]	.34 [.08]
2800 [1321]	.18 [.04]	.22 [.05]	4200 [1982]	.28 [.07]	.36 [.09]
3000 [1416]	.19 [.05]	.24 [.06]	4400 [2077]	.30 [.07]	.38 [.09]
3200 [1510]	.20 [.05]	.26 [.06]	4600 [2171]	.31 [.08]	.40 [.10]
3400 [1605]	.22 [.05]	.28 [.07]	4800 [2265]	.32 [.08]	.42 [.10]
3600 [1699]	.23 [.06]	.30 [.07]			

[ ] Designates Metric Conversions



Airflow Correction Factors

RCCL-D5013S													
ACTUAL—CFM [L/s]	2400 [1133]	2600 [1227]	2800 [1321]	3000 [1416]	3200 [1510]	3400 [1605]	3600 [1699]	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2077]	4600 [2171]	4800 [2265]
TOTAL MBH	0.80	0.84	0.87	0.90	0.92	0.95	0.97	1.00	1.03	1.05	1.07	1.09	1.11
SENSIBLE MBH	0.75	0.80	0.84	0.87	0.90	0.94	0.97	1.00	1.03	1.06	1.09	1.12	1.14



NOTES: 1. Multiply correction factor times gross performance data.  
2. Resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions

## Coil Piping And Expansion Valve Bulb Location

1. An oil trap in the suction line should be provided.
2. The expansion valve sensing bulb must be strapped securely to the top of the suction line on the outside of the coil cabinet. Both the bulb and suction line must be insulated. See figure 3.
3. The condensate drain connection is 3/4" [19 mm] NPT. A 3" [76.2 mm]: A trap with adequate pitch must be provided. See figure 3.

**FIGURE 1**  
BLOCKOFF CHANNEL INSTALLATION

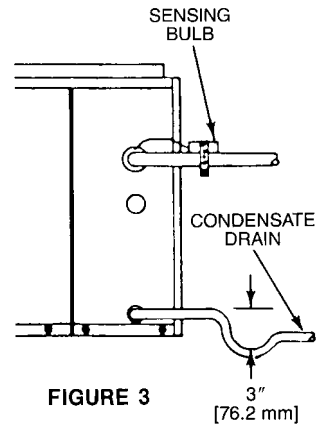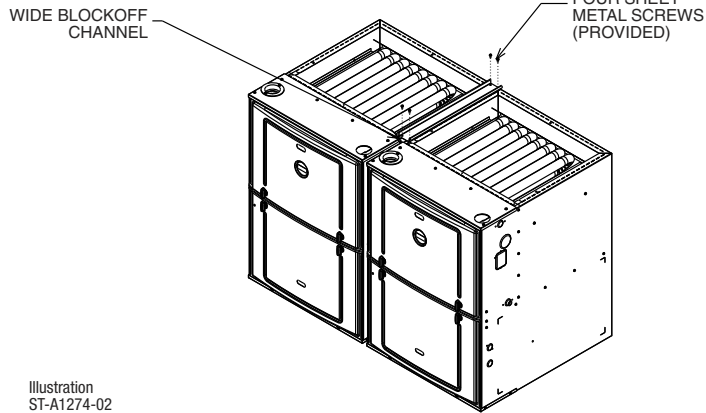

**(Field Supplied)**

[ ] Designates Metric Conversions





*In keeping with its policy of continuous progress and product improvement, Ruud reserves the right to make changes without notice.*

Ruud Heating, Cooling & Water Heating • P.O. Box 17010  
Fort Smith, Arkansas 72917 • [www.ruud.com](http://www.ruud.com)

Ruud Canada • 125 Edgeware Road, Unit 1  
Brampton, Ontario • L6Y 0P5

**RELY ON RUUD.™**

PRINTED IN U.S.A. 8/18 QG FORM NO. C22-225